

# ViewPAC (WinCE-Based) User Manual

Version 1.0.13, July 2017

Service and usage information for

VP-23W1

VP-25W1

VP-4131



Written by Sean

Edited by Anna Huang

## Warranty

---

All products manufactured by ICP DAS are under warranty regarding defective materials for a period of one year, beginning from the date of delivery to the original purchaser.

## Warning

---

ICP DAS assumes no liability for any damage resulting from the use of this product. ICP DAS reserves the right to change this manual at any time without notice. The information furnished by ICP DAS is believed to be accurate and reliable. However, no responsibility is assumed by ICP DAS for its use, not for any infringements of patents or other rights of third parties resulting from its use.

## Copyright

---

Copyright © 2017 by ICP DAS Co., Ltd. All rights are reserved.

## Trademark

---

The names used for identification only may be registered trademarks of their respective companies.

## Contact US

If you have any problem, please feel free to contact us.

You can count on us for quick response.

Email: [service@icpdas.com](mailto:service@icpdas.com)

# Table of Contents

---

<b>1. Introduction .....</b>	<b>7</b>
1.1. Features .....	8
1.2. Specifications .....	10
1.3. Overview .....	12
1.4. Dimensions .....	20
1.5. Companion CD.....	23
<b>2. Getting Started .....</b>	<b>24</b>
2.1. Mounting the Hardware .....	24
2.1.1. Installation Instructions for VP-23W1/VP-25W1 .....	25
2.1.2. Installation Instructions for VP-4131 .....	37
2.2. Installing the Tools and Utilities .....	43
2.3. Configuring the Boot Mode.....	44
2.4. Changing the User Interface Language .....	48
2.5. Testing the ViewPAC .....	50
2.6. Using ViewPAC Utility to manage the ViewPAC .....	53
2.7. Using DCON Utility to Configure the I/O Modules .....	54
2.8. Using Backup Utility to Backup the settings and files .....	57
2.9. A caution about using System_Disk .....	59
<b>3. Tools and Tasks.....</b>	<b>60</b>
3.1. DCON Utility.....	63
3.2. NAPOPC_CE5 .....	64
3.3. SendToCOM.....	65

3.4. VCEP .....	66
3.5. ViewPAC Utility.....	67
3.5.1. Menu Bar.....	68
3.5.2. Property Tabs .....	73
<b>4. Your First ViewPAC Program .....</b>	<b>86</b>
4.1. Preparing the Development Tools .....	86
4.2. Installing ViewPAC Platform SDKs.....	87
4.3. Understanding the ViewPAC APIs.....	88
4.3.1. ViewPAC SDK Overview .....	89
4.3.2. ViewPAC SDK Reference .....	93
4.4. Your First Program in C#.....	95
4.4.1. Create a new project.....	96
4.4.2. Add project reference for an application.....	98
4.4.3. Design and Build an application program.....	99
4.4.4. Execute the application on the ViewPAC .....	103
4.5. Your First Program in VB.net.....	105
4.5.1. Create a new project .....	106
4.5.2. Add project reference for an application.....	108
4.5.3. Design and Build an application program.....	109
4.5.4. Execute the application on the ViewPAC .....	112
4.6. Your First Program in eMbedded Visual C++ .....	114
4.6.1. Create a new Forms-Based project.....	115
4.6.2. Configure compiler options.....	120
4.6.3. Specify the path for project reference.....	121
4.6.4. Design and Build an application program.....	125
4.6.5. Execute the application program on ViewPAC .....	130
<b>5. APIs and Demo References.....</b>	<b>131</b>

5.1. Demo programs with C# .....	132
5.1.1. C# Demo program for WinPAC Standard API .....	132
5.1.2. C# Demo program for PAC IO API .....	134
5.1.3. C# Demo program for ViewPAC Particular API .....	137
5.2. Demo Programs with eMbedded Visual C++ .....	139
5.2.1. eVC Demo program for WinPAC Standard API .....	140
5.2.2. eVC Demo program for PAC IO API.....	142
5.2.3. eVC Demo program for ViewPAC Particular API.....	145
<b>6. I/O Modules and SDK Selection .....</b>	<b>147</b>
<b>7. ViewPAC Updates.....</b>	<b>151</b>
7.1. OS updates .....	152
7.1.1. Updating the Boot Loader and the ViewPAC OS image from files .....	155
7.1.2. Updating the ViewPAC OS image from eshell.....	162
7.2. SDKs Updates.....	168
7.2.1. WinPAC SDK updates for C# or VB.net .....	169
7.2.2. WinPAC SDK updates for eMbedded Visual C++ .....	170
<b>8. ViewPAC Download Center .....</b>	<b>171</b>
<b>9. How to change the batteries .....</b>	<b>173</b>
<b>Appendix A. I-8K and I-87K Modules.....</b>	<b>175</b>
<b>Appendix B. Application of RS-485 Network.....</b>	<b>176</b>

B.1. Basic RS-485 Network.....	177
B.2. Daisy Chain RS-485 Network .....	178
B.3. Star Type RS-485 Network .....	179
B.4. Random RS-485 Network .....	181
B.5. Master/Slaves Settings .....	182
B.5.1. ViewPAC as a Master (default) .....	183
B.5.2. ViewPAC as a Slave: .....	184

## **Appendix C. Tips – How to ..... 186**

C.1 How to change the batteries .....	187
C.2. How to add a user account to remote login the ViewPAC from PC .....	189
C.2.1. How to add a user account .....	189
C.2.2. How to Use telnet to remote login the ViewPAC from PC.....	191
C.2.3. How to remove the user from the login list.....	193
C.3. How to online debug ViewPAC .....	195
C.3.1. Debug ViewPAC programs in EVC++ .....	195
C.3.2. Debug ViewPAC programs in Visual Studio 2005/2008 .....	205
C.4. How to recompile WinCon programs .....	214
C.4.1. Compiler old programs which ran on Wincon 8x3x and 8x4x .....	215
C.4.2. Modify .vcp file to upgrade the old WinCon project.....	219
C.5. How to recalibrate the touch screen .....	220
C.6. How to use the printer .....	222
C.6.1. How to use network printer .....	223
C.6.2. How to use printer via USB.....	225
C.7. How to use services tool.....	226

## **Appendix D. Revision History ..... 229**

# 1. Introduction



ViewPAC combines WinPAC, graphic display and keypad in one unit. It is equipped with a PXA270 CPU (520 MHz) running Windows CE.NET 5.0 operating system, various connectivity (USB, Ethernet, RS-232/485), 3 slots to expand I/O modules, 3.5"/5.7"/10.4" TFT LCD and a rubber keypad.

Its operating system, Windows CE.NET 5.0, has many advantages, includes hard real-time capability, small core size, fast boot speed, interrupt handling at a deeper level, achievable deterministic control and low cost. Running Windows CE.NET 5.0 in the ViewPAC gives it the ability to run PC-based control software such as Visual Basic.NET, Visual C#, Embedded Visual C++, SCADA software, Soft PLC ...etc.

Compared with traditional IPC + PLC solutions, ViewPAC reduces overall system cost, space and gives you all the best features of IPC and PLC

# 1.1. Features

The ViewPAC offers the most comprehensive configuration and remote system upgrade solutions to meet specific application requirements. The following list shows the hardware and software features designed to simplify installation, configuration and application.

---

## Software Features

- ▶ Windows CE .Net 5.0 Inside
- ▶ Easy Remote Maintenance via Ethernet
  1. FTP Server
  2. VCEP Software
- ▶ Built-In OPC Server: NAPOPC\_CE5
  1. An OPC Server for SCADA Software
  2. Integrates Local/Remote I/O Modules via RS-232/485 or Ethernet
  3. Provides Library for eVC, C#, or VB.NET
  4. Supports Modbus and DCON Protocols
- ▶ Development Software
  - Visual Studio.NET 2005/2008, and eVC
- ▶ SDK/Demo Programs for C#, VB.NET & eVC



---

## Hardware Features

- PXA 270 CPU (32-bit & 520 MHz)
- IP65 Compliant Front Panel
- 3.5"/5.7"/10.4" TFT LCD (5.7"/10.4" LCD is with Touch Panel)
- Rubber Keypad with 24/6 Keys (for VP-23W1/VP-25W1 series only)
- Audio with MIC-In and Line-Out (MIC-in is not included with VP-41xx series)
- 64-bit Hardware Serial Number for Software Protection
- 3 Slots for High Profile I/O Modules
- Rich I/O Expansion Ability
  1. Ethernet
  2. RS-232/422/485
  3. FRnet
  4. CAN bus
- Dual Battery Backup SRAM (512 KB)
- One Ethernet Port
- 2 Serial Ports (RS-232, RS-485)
- Operating Temperature: -20 ~ +70 °C

## 1.2. Specifications


The table below summarizes the specifications of the ViewPAC.

Models	VP-23W1	VP-25W1	VP-4131
<b>System Software</b>			
OS	Windows CE .NET 5.0		
.Net Compact Framework	2.0/3.5		
Embedded Service	FTP server, Web server (supports VB script, JAVA script), Embedded SQL server		
SDK Provided	DII for eVC, DII for Visual Studio.Net 2005/2008		
<b>CPU Module</b>			
CPU	PXA270 or compatible (32-bit and 520 MHz)		
SDRAM	128 MB		
Dual Battery Backup SRAM	512 KB (for 5 years data retention)		
Flash	96 MB	96 MB	128 MB
EEPROM	16 KB (data retention: 40 years; 1,000,000 erase/write cycles)		
Expansion Flash Memory	microSD socket with a microSD card (support up to 16 GB microSD card)		
RTC (Real Time Clock)	Provide seconds, minutes, hours, date of week /month; month and year, valid from 1980 to 2079		
64-bit Hardware Serial Number	Yes		
Dual Watchdog Timer	Yes (0.8 second)		
Rotary Switch	Yes (0 ~ 9)		
<b>I/O Expansion Slots</b>			
Slot Number	3 (for high profile I-8K and I-87K modules only)		
Hot Swap *Will be available	Yes (for high profile I-87K modules only)		
<b>Communication Interface</b>			
Ethernet Port	RJ45 * 1, 10/100 Base-TX (Auto-negotiating, Auto MDI/MDIX, LED indicators)		
USB 1.1 (host)	1	1	2
USB 1.1 (client)	--	--	1

COM0	Internal communication with the high profile I-87K series modules in slots		
COM2	RS-485 (D+, D-; self-tuner ASIC inside); 2500 V <sub>DC</sub> isolated		
COM3	RS-232 (RxD, TxD, CTS, RTS, DSR, DTR, CD, RI and GND); Non-isolated		
<b>Main Machine Interface</b>			
LCD	3.5" TFT	5.7" TFT	10.4" TFT
Resolution	320 x 240	640 x 480	800 x 600
Touch Panel	--	Yes	Yes
Rubber Keypad	24 Keys	6 Keys	--
Audio	Microphone-In and Earphone-Out		Earphone-Out
LED Indicators	3 Dual-Color LEDs (PWR, RUN, LAN1, L1, L2, L3; L1 ~ L3 for user programmable)		2 Dual-Color LEDs (PWR, RUN)
<b>Environmental</b>			
Operating Temperature	-20 ~ +70 °C		
Storage Temperature	-30 ~ +80 °C		
Ambient Relative Humidity	10 ~ 90%, non-condensing		
<b>Power</b>			
Input Range	+10 V ~ +30 V <sub>DC</sub>		
Isolation	1 kV		
Capacity	2.5 A, 5 V supply to I/O expansion slots		
Consumption	7.2 W (0.3 A @ 24 V <sub>DC</sub> )		
<b>Mechanical</b>			
Dimension (W x D x H)	182 mm x 158 mm x 125 mm		293 mm x 231 mm x 129 mm
Ingress Protection	Front panel: IP65		
Installation	Panel mounting		

## 1.3. Overview

The ViewPAC contains several interfaces and peripherals that can be integrated with external systems. Here is an overview of the components and its descriptions. The details of these items are as follows:

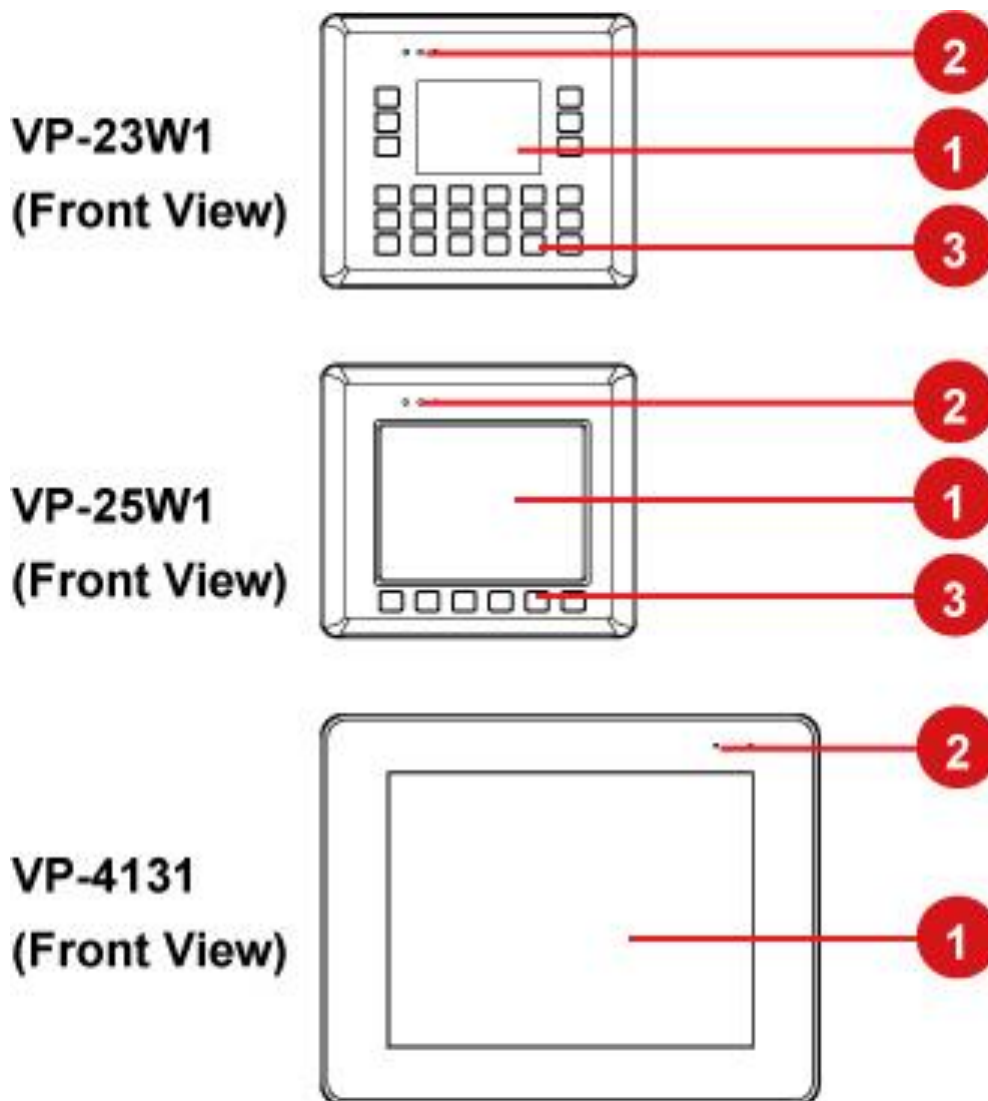


### 1. LCM

The LCM display allows users to view the status of the backup process.

## 2. LED Indicators

The diagram below shows the placement of the LED indicators for each ViewPAC.

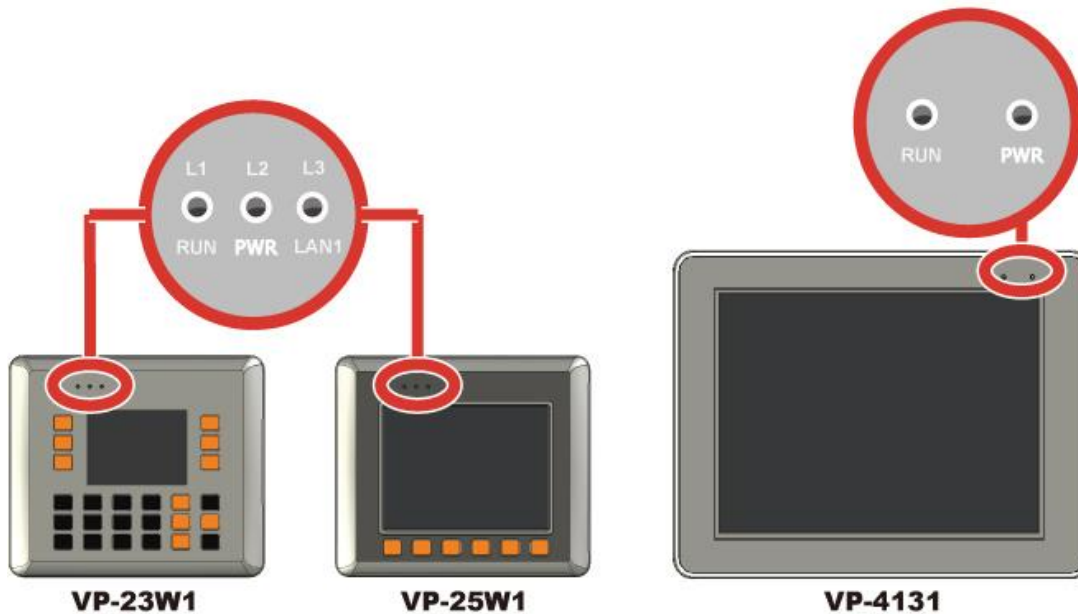

The LED indicators which can be used to indicate the power status, OS status and network link/activity are described as follows:





LED Indicator	Color	Description
L1/L2/L3 (for VP-23W1/VP-25W1 only)	Red, On	LED indicators controlled by user Program.
	Red, Off	
RUN	Green, On	System booted and ready.
	Green, Off	BIOS failure.
	Green, blinking	System memory mapped out, formatted or defragmented.
PWR	Green, On	System has power applied to it.
	Green, Off	System is not powered on.
LAN1 (for VP-23W1/VP-25W1 only)	Green, On	Link between system and network.
	Green, Off	Network disconnected.
	Green, blinking	Network Access.

### 3. Keypad (for VP-23W1/VP-25W1 only)

The keypad is used to provide support for keyboard input.

The F1 ~ F6 function keys can also be programmed by the user.

The Numerical Keypad allows you to enter numerical information.

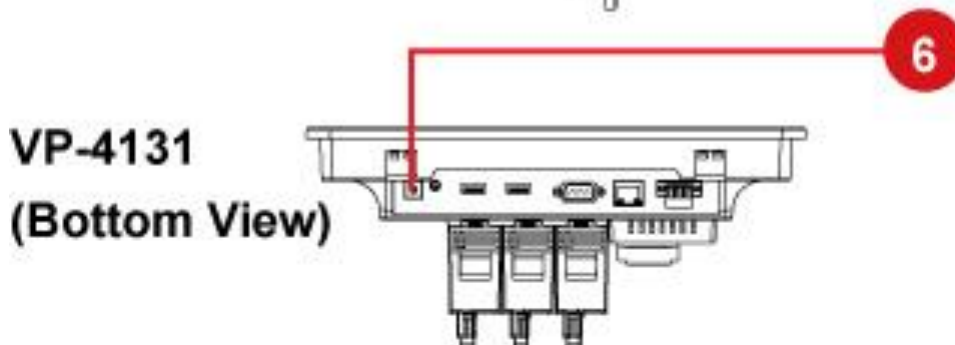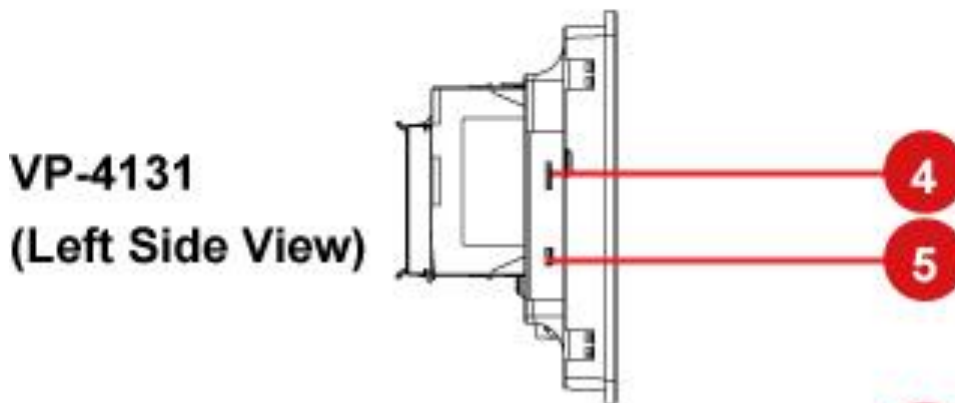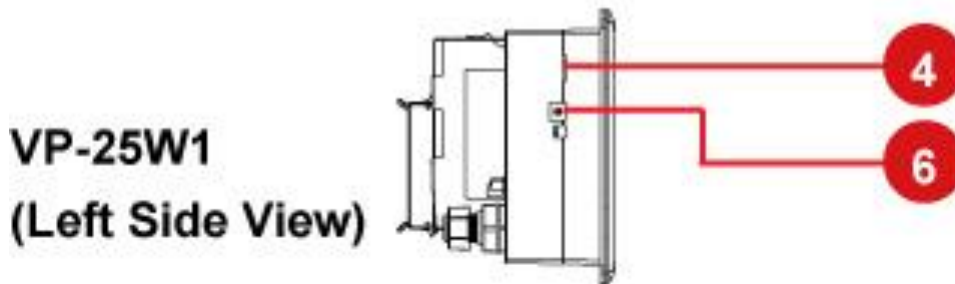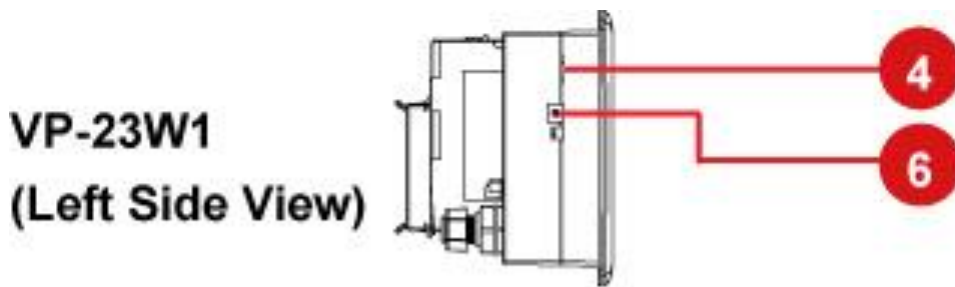

## 4. microSD Socket

microSD socket allows for memory expansion up to 16 GB.

## 5. USB Client (for VP-4131 only)

USB client allows you to connect your ViewPAC to another computer via a USB cable, and have that cable act as a network connection.


## 6. Rotary Switch




Rotary Switch is an operating mode selector switch which provides seven functions related to the selection of the operating mode and authorization control for the VP-2000.

For more information about the operating mode, please refer to “section 2.2. Configuring the Boot Mode”


**VP-23W1  
(Back View)**

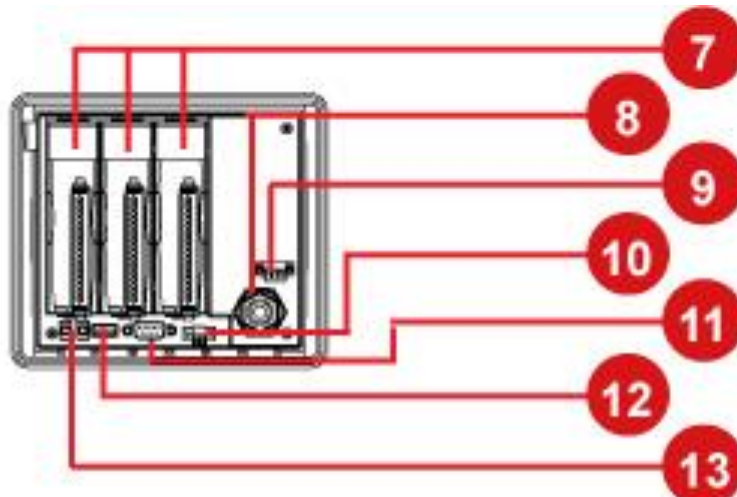


**VP-25W1  
(Back View)**

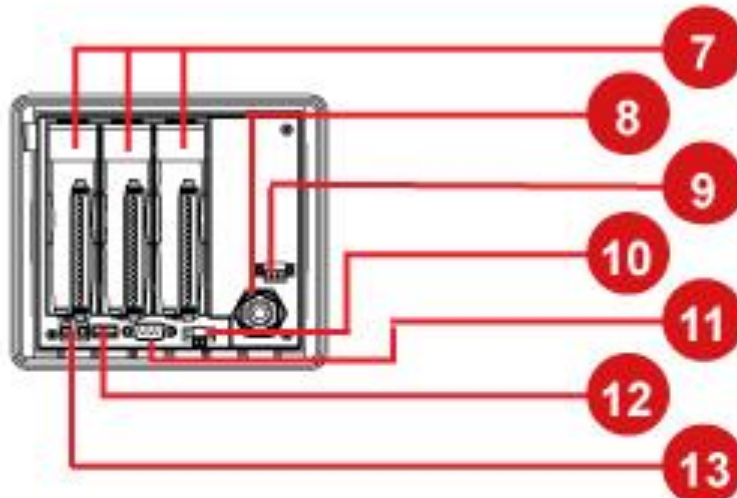

**VP-4131  
(Back View)**

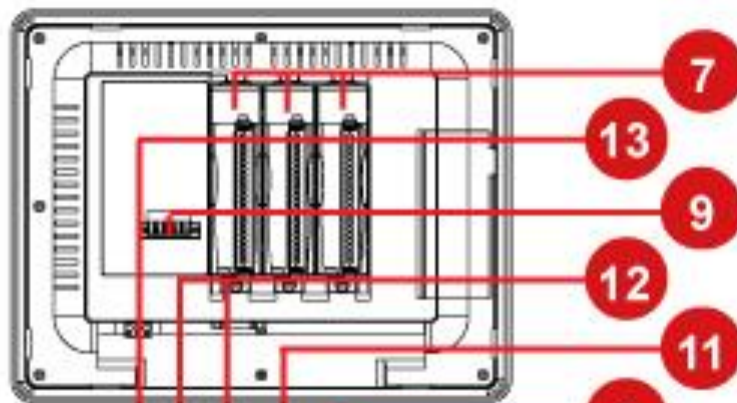

**VP-4131  
(Bottom View)**

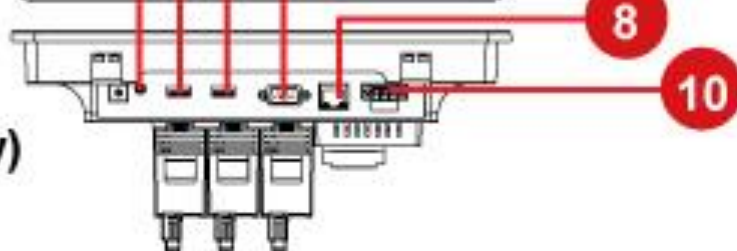



## 7. I/O Expansion Slots


ViewPAC has three I/O expansion slots to serve in the local and remote expansion.

## 8. Ethernet Port


Ethernet port allows you to connect your computer or other device to the internet or to a local network.

## 9. Power Input and Frame Ground

The VP-23W1/VP-25W1 has a terminal with 3 pins, there are 2 pins for power input and a pin for frame ground as follows:

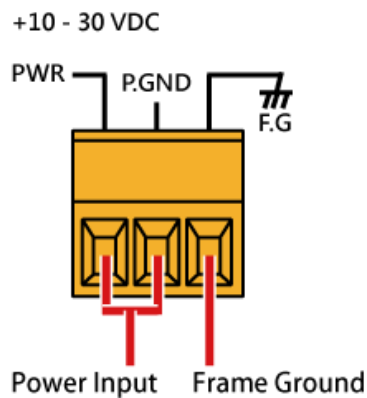

The VP-4131 has a terminal with 5 pins; there are 4 pins for redundant power input and a pin for frame ground as follows:

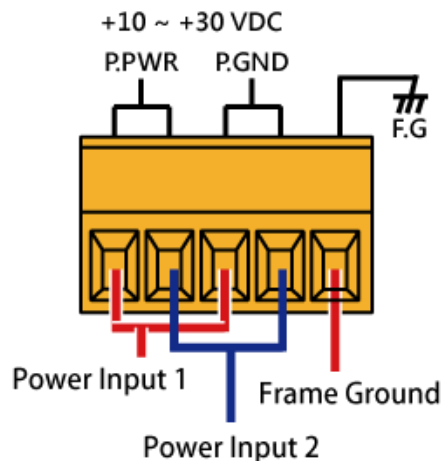

## 10. COM2 (RS-485)

COM2 port provides a connection to external RS-485 devices.

The COM2 has 2 pins, as follows:


**Baud Rate:** 115200, 57600, 38400, 19200, 9600, 4800, 2400, 1200 bps

**Data Bits:** 7, 8

**Parity:** None, Even, Odd, Mark (Always 1), Space (Always 0)


**Stop Bits:** 1, 2

**FIFO:** 16 bytes

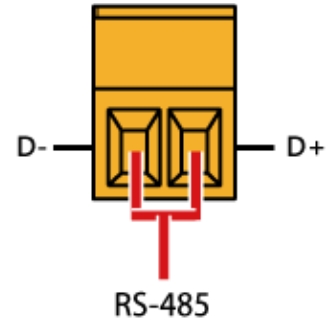

## 11. COM3 (RS-232)

ViewPAC offers one standard RS-232 serial communication interface port, COM3 (9-pin Sub-D plug connector), and it is located on the back of ViewPAC. Refer to figure below for RS-232 port pin assignment.

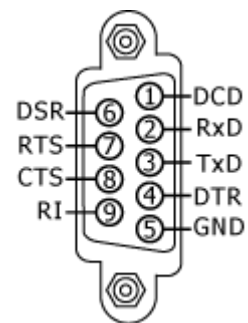

**Port Type:** Male

**Baud Rate:** 115200, 57600, 38400, 19200, 9600, 4800, 2400, 1200 bps

**Data Bits:** 5, 6, 7, 8

**Parity:** None, Even, Odd, Mark (Always 1), Space (Always 0)

**Stop Bits:** 1, 2

**FIFO:** 16 bytes

## Tips & Warnings

---



The table below shows the data bit of each COM port and their corresponding stop bit.

Word Length	Number of Stop Bits
5, 6, 7, 8	1
5	1.5
6, 7, 8	2

---

## 12. USB Port

The VP-23W1/VP-25W1 has a USB port, and the VP-4131 has two USB ports, that allow support for USB devices such as mouse, keyboard or an external USB hard drive.

## 13. Microphone and Earphone Jacks

Microphone and an earphone jack to allow the input and output of audio system.


## 1.4. Dimensions

The diagrams below provide the dimensions of the standard VP-2000 family to use in defining your enclosure specifications. Remember to leave room for potential expansion if you are using other components in your system.


All dimensions in millimeter.

---


### VP-23W1

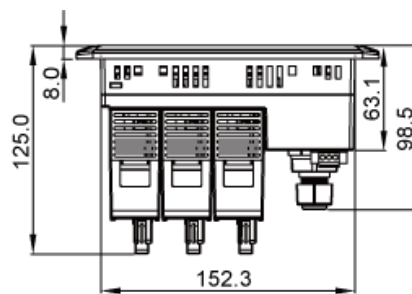


Top View

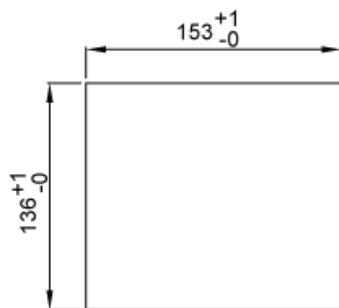


Recommended  
Panel Cut-Out

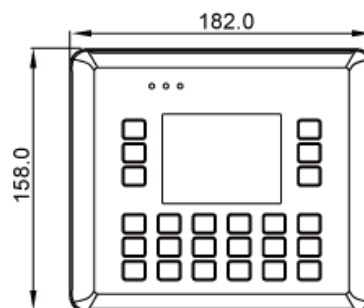

Front View




Right Side View

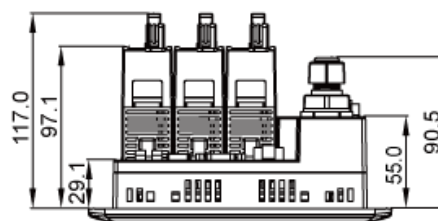


Bottom View

---


# VP-25W1

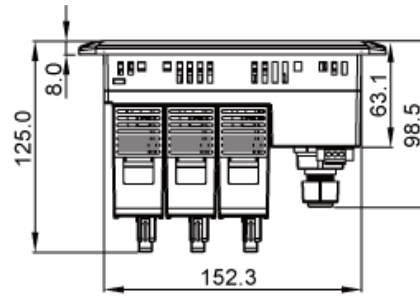


Top View

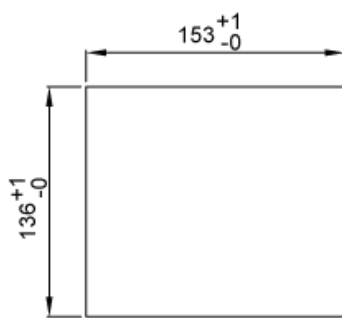


Recommended  
Panel Cut-Out

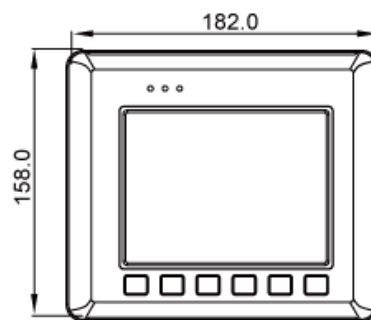

Front View





Right Side View

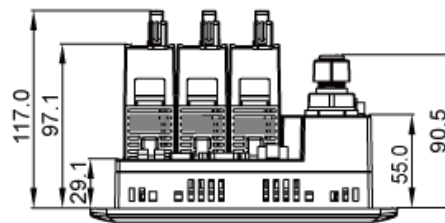




Bottom View

---

# VP-4131

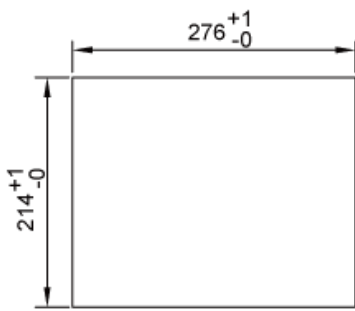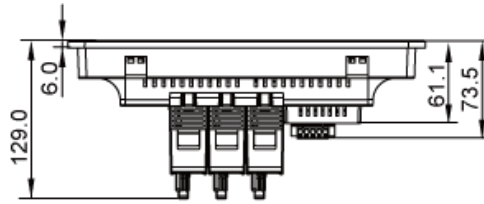


Recommended  
Panel Cut-Out

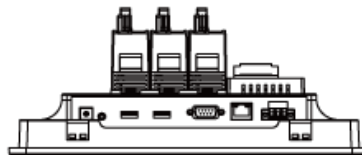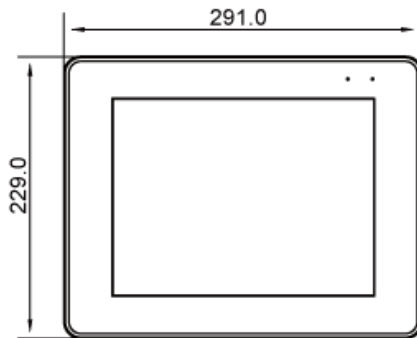

## 1.5. Companion CD

This diagram below describes the content of the companion CD, which provides the resource, tool kit, software and documentation related to the ViewPAC.

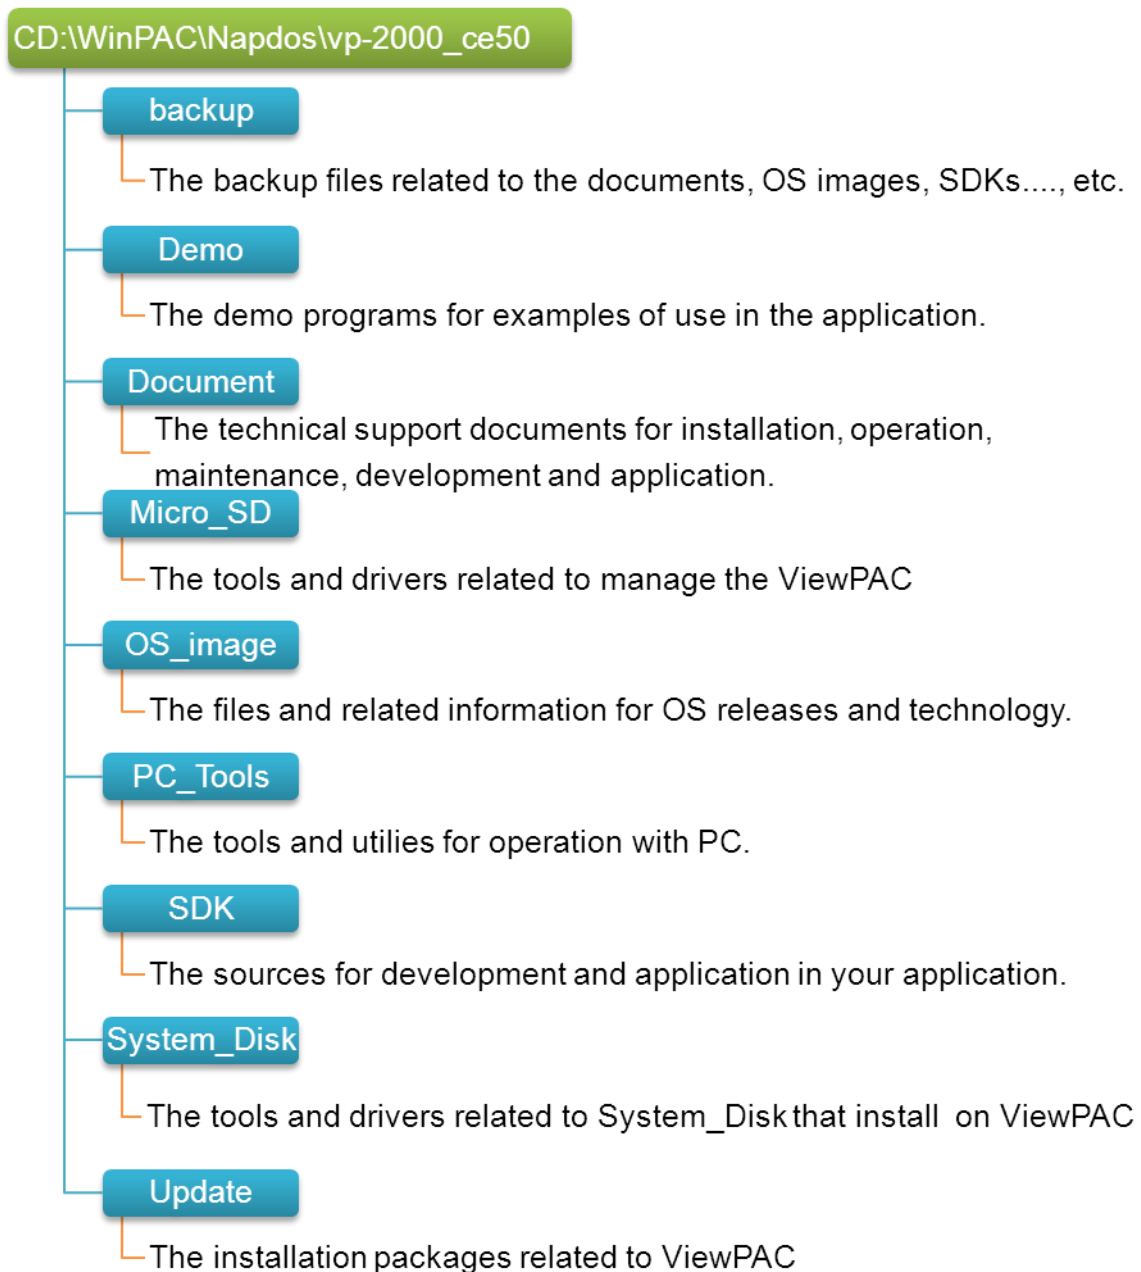

## 2. Getting Started

This chapter provides a guided tour that describes the steps needed to download, install, configure, and run the basic procedures for user working with the ViewPAC for the first time.

### 2.1. Mounting the Hardware

Before you work with the ViewPAC, you should have a basic understanding of hardware specification, such as the dimensions, the usable input-voltage range of the power supply, and the type of communication interfaces.

For more information about the hardware details, see section 1.2., “Specifications.”

For more information about the hardware dimensions, see section 1.4., “Dimension.”

The installation instructions differ depending on the ViewPAC you have.

➤ **For VP-23W1/VP-25W1**

Please see section 2.1.1. Installation Instructions for VP-23W1/VP-25W1

➤ **For VP-4131**

Please see section 2.1.2. Installation Instructions for VP-4131



## 2.1.1. Installation Instructions for VP-23W1/VP-25W1

Before starting any task, please check the package contents. If any of the following package contents are missing or damaged, contact your dealer, or distributor.

In addition to this guide, the package includes the following items:



**VP-23W1/VP-25W1**



**Touch Pen  
for VP-25w1 only**



**Expansion I/O Socket \* 3**



**Software Utility CD**



**A microSD Card and  
A microSD to SD Adapter**



**Screw Driver**



**RJ-45 Waterproofing Kit**




**Panel Clip \* 4**



**M4x30 L Screw \*4**


### 2.1.1.1. Removing the Slot Cover

The ViewPAC has a slot cover to protect the internal components from damage during shipping. Before starting any installation, please first remove the slot cover.

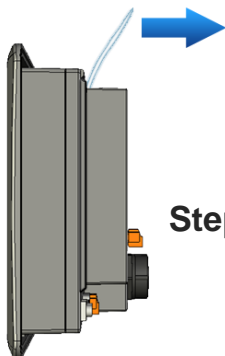

**Step 1: Hold the top of ViewPAC**

**Step 2: Pull the plastic wrap**

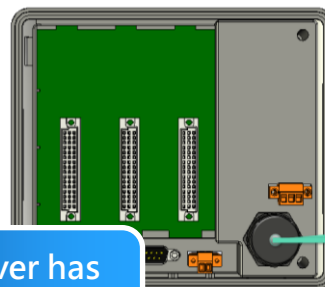


The slot cover has been removed


### 2.1.1.2. Installing Expansion I/O Sockets

The case (a socket and a top case) is included in the package. Before inserting the I/O modules you first need to install the expansion I/O socket.


If you do not expand the I/O module full, please keep the top case of the unused slot to protect the backplane from dirt, dust and damage from foreign objects.

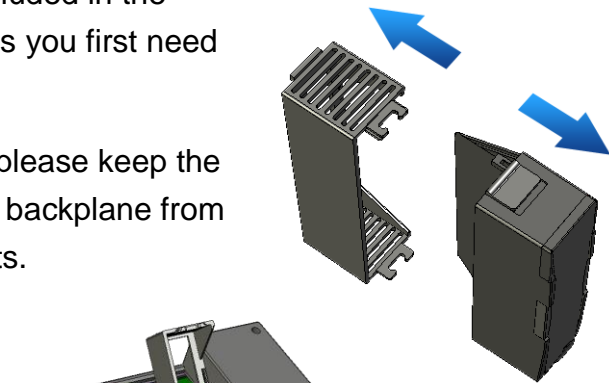

**Step 1: Take the socket out from the case**

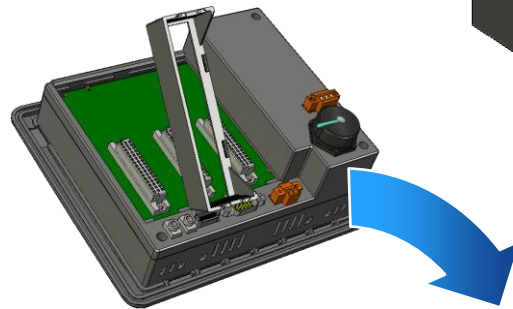

**Step 2: Padlock the bottom of the socket into the ViewPAC**

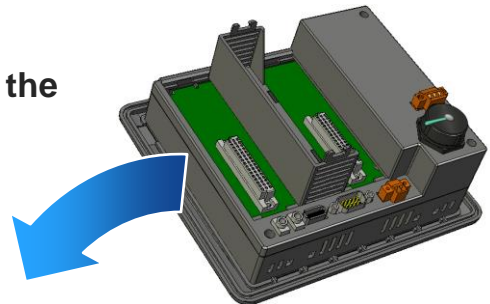

**Step 3: Slide the socket into the ViewPAC until it clicks**



### 2.1.1.3. Inserting the I/O Modules


ViewPAC supports a complete range of I/O modules for interfacing many different field devices.

For more information about I/O expansion modules, please refer to:

[http://www.icpdas.com/products/PAC/winpac/io\\_support\\_list.htm](http://www.icpdas.com/products/PAC/winpac/io_support_list.htm)

**Step 1: Hold the I/O module vertically and align the socket**

**Step 2: Carefully press the I/O module onto the socket**

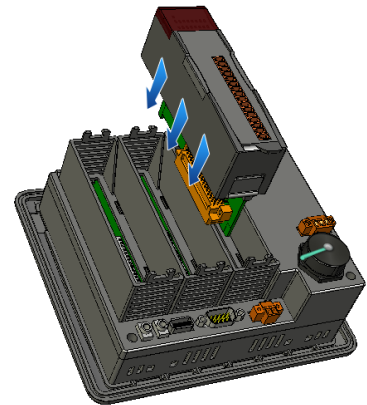

#### Tips & Warnings

---



If you do not expand the I/O module full, please keep the top case of the unused slot to protect the backplane from dirt, dust and damage from foreign objects.

---

**Step 3: Read the relevant documentation**



Manual

**For high profile I-8K series:**

CD:\napdos\io\_module\

[http://www.icpdas.com/products/PAC/winpac/io\\_support\\_list.htm](http://www.icpdas.com/products/PAC/winpac/io_support_list.htm)

**For high profile I-87K series:**


CD:\napdos\io\_module\

[http://www.icpdas.com/products/PAC/winpac/io\\_support\\_list.htm](http://www.icpdas.com/products/PAC/winpac/io_support_list.htm)

## Step 4 Wire the I/O channels

All documents include the I/O module specifications, pin assignments and wiring connections.

For example, Pin Assignments and Wiring connections for the I-87054W module are as follows:

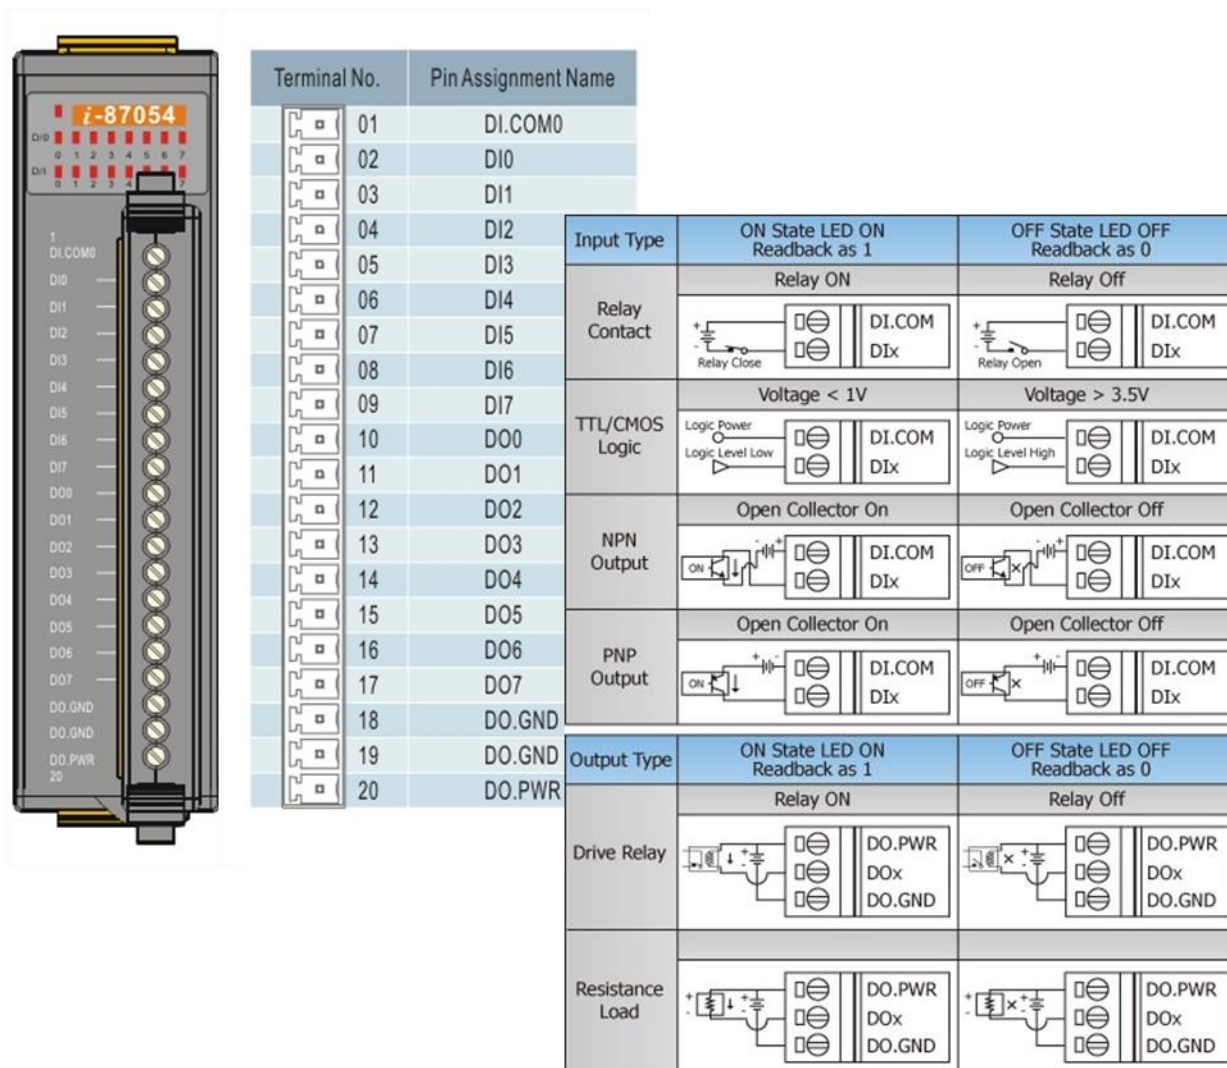

## Tips & Warnings



It is recommended that the power to the ViewPAC is switched off when wiring the I/O module which are plugging in the ViewPAC slots.


### 2.1.1.4. Mounting the Waterproof

The ViewPAC is equipped with an RJ-45 waterproof connector to withstand contaminant in dusty environment.


#### Step 1: Remove the RJ-45 connector from the RJ-45 cable




#### Step 2: Feed the end of the RJ-45 cable through the (A) sealing nut, (B) rubber sealing insert, (C) cable gland base, (D) clamping ring and (E) panel gasket

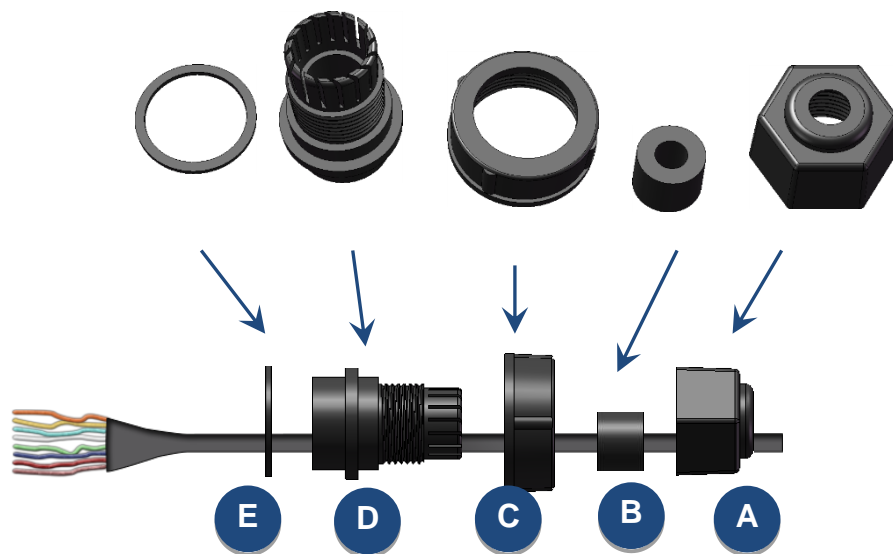


**Step 3: Wrap the (E) panel gasket around the (D) clamping ring**

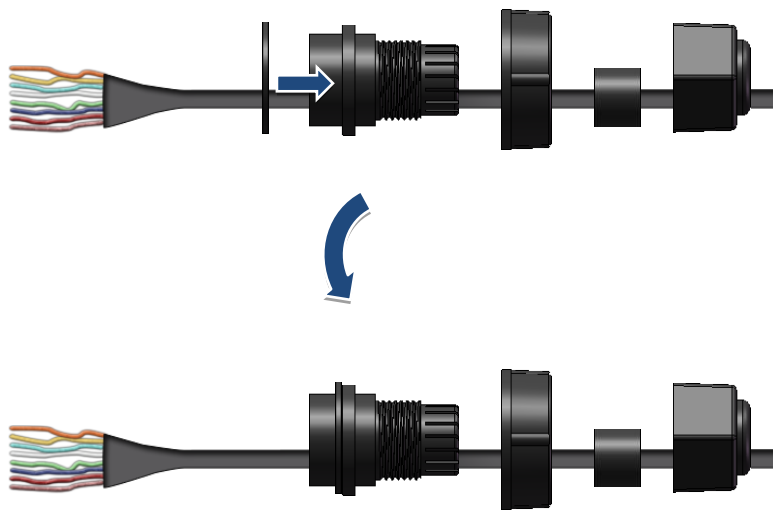


**Step 4: Wrap the (C) cable gland base around the (D) clamping ring**

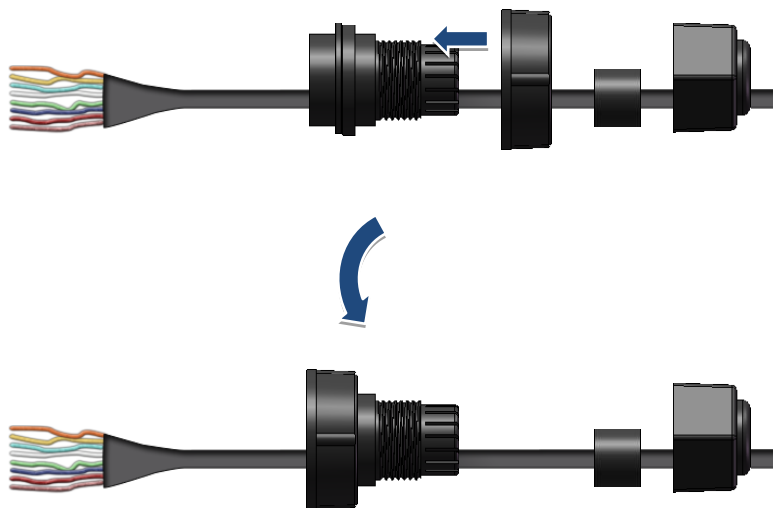

**Step 5: Insert the (B) rubber sealing insert into the (D) clamping ring**

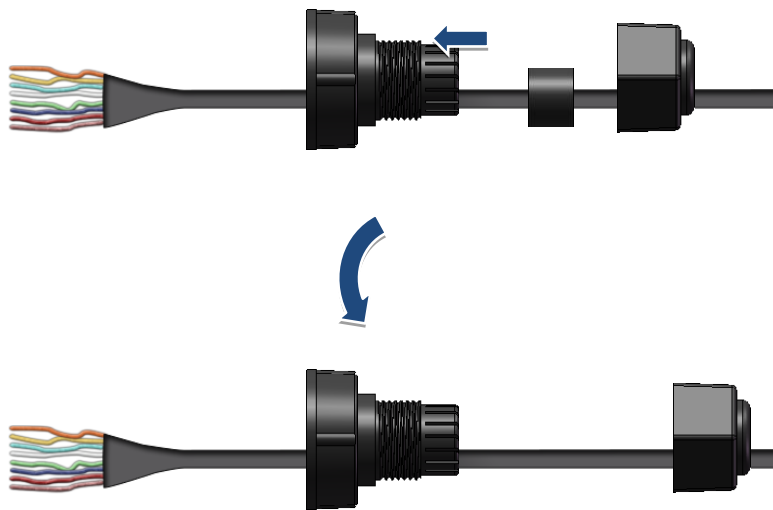


**Step 6: Push the (E) sealing nut forward and Hand-tighten it to seal the assembly**

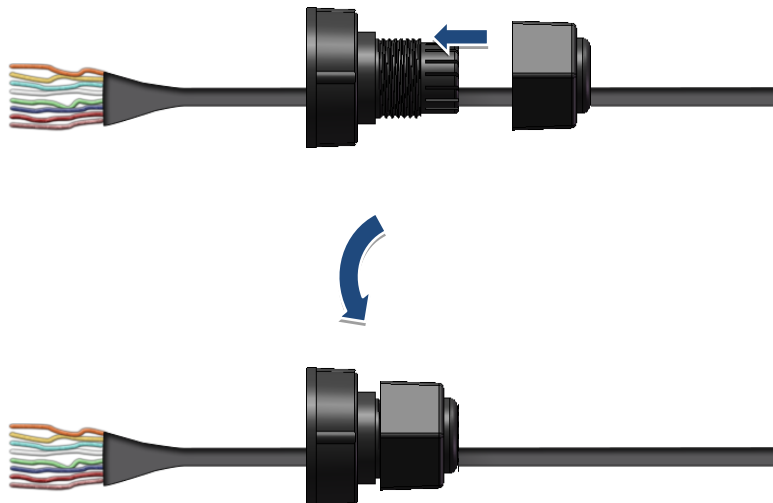



**Step 7: Insert the RJ-45 cable into the RJ-45 connector**

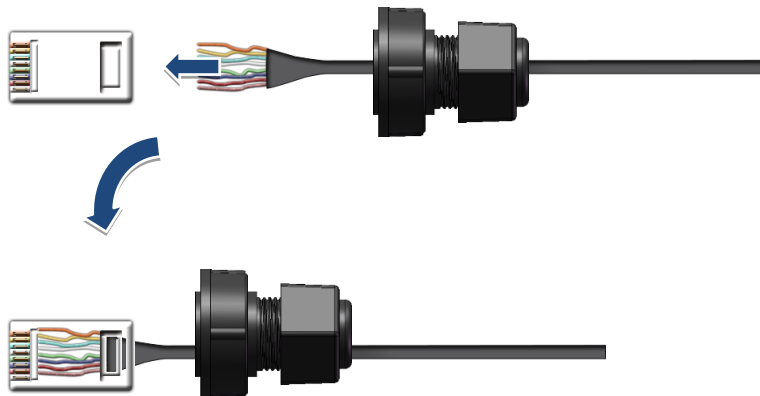


**Step 8: Push the RJ-45 waterproof connector assembly forward**



### 2.1.1.5. Mounting the ViewPAC

The ViewPAC can be mounted on a panel of maximum thickness 12 mm. Adequate access space can be available at the rear of the instrument panel for wiring and servicing purposes.


Panel thickness up to 12 mm

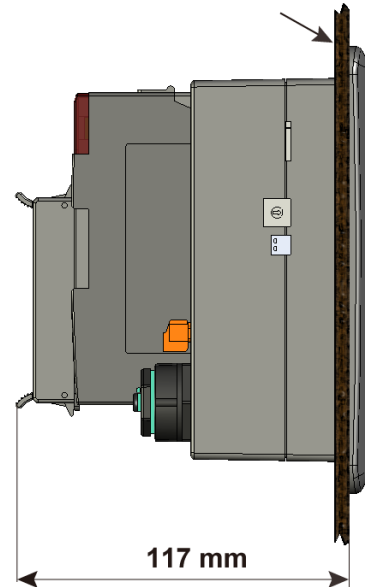

#### Tips & Warnings




To ensure proper ventilation for your ViewPAC, leave a minimum of 50mm space between the top and bottom edges of the ViewPAC and the enclosure panels.

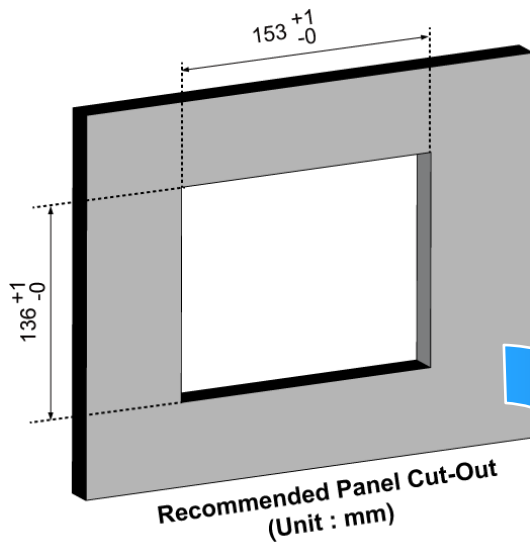


**Step 1: Prepare the panel and cut the hole to the specified size**


**Step 2: Attach the ViewPAC to the cut-out hole**

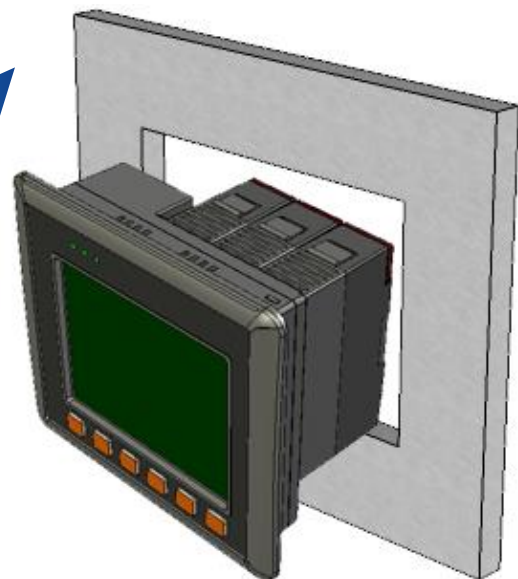

**Step 3: Insert the panel mounting clips into the upper and lower ventilation holes**

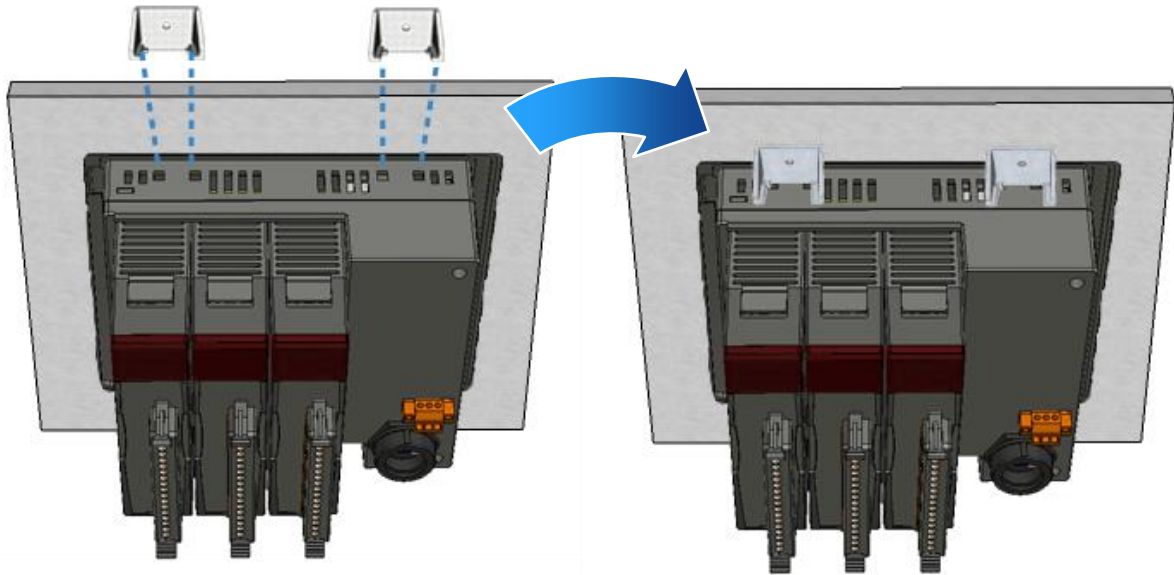

**Step 4: Screw the panel mounting clips to the panel**

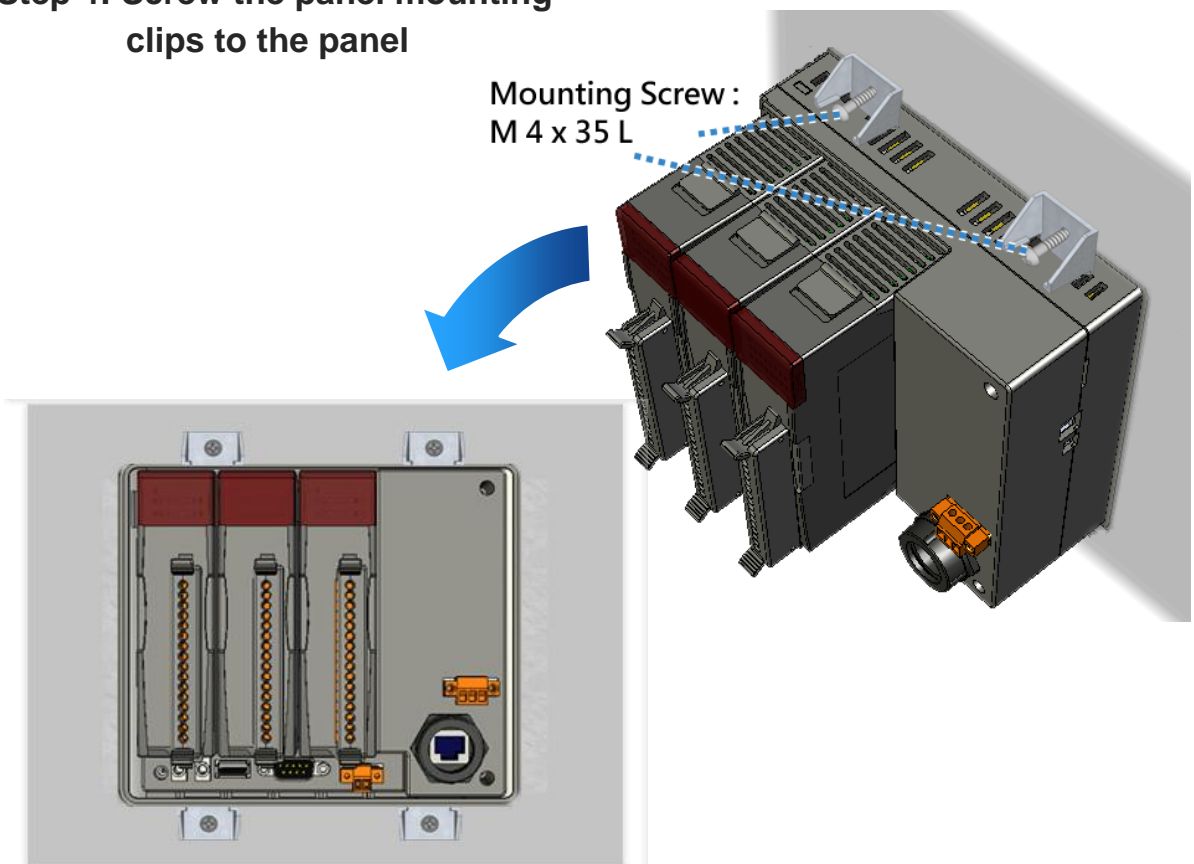

## 2.1.1.6. Deploying a Basic ViewPAC Application

The ViewPAC provides a variety of communication interface to suit a range of applications. Here is a simple application for using the ViewPAC that is shown below.

**Step 1: Connect the positive terminal (+) of the power supply to the terminal PWR and the negative terminal (-) of the power supply to the P.GND**

### Tips & Warnings

---




The input range of power supply is +10 ~ +30 V<sub>DC</sub>

---

**Step 2: Connect PC to the Ethernet port**

**Step 3: Connect the USB keyboard to the USB port**

**Step 4: Connect the audio to the microphone and earphone jack**

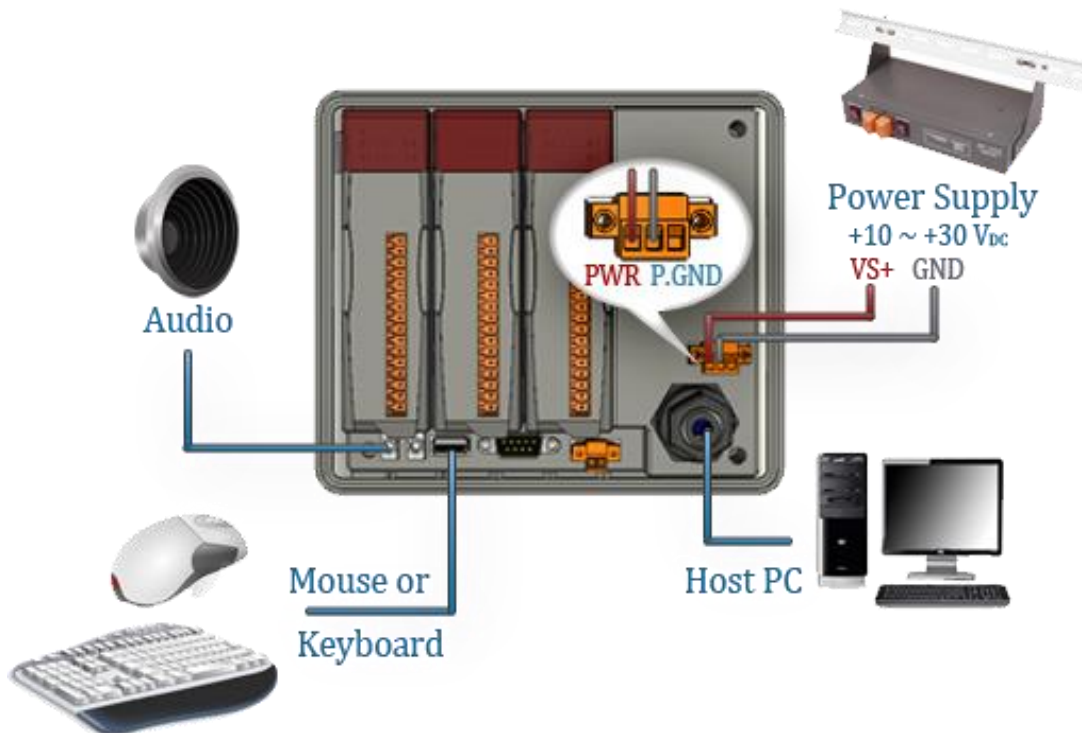

## 2.1.2. Installation Instructions for VP-4131

Before starting any task, please check the package contents. If any of the following package contents are missing or damaged, contact your dealer, or distributor.

In addition to this guide, the package includes the following items:



**VP-4131 & Touch Pen**



**A microSD card and  
A microSD to SD Adapter**



**Software Utility CD**



**Screw Driver**



**Panel Clip \* 4**




**M4x30 L Screw \*4**

### 2.1.2.1. Installing Expansion I/O Sockets

There is a top case on each I/O socket. Before inserting the I/O module you first need to remove it.

If you do not expand the I/O module full, please keep the top case of the unused slot to protect the backplane from dirt, dust and damage from foreign objects.

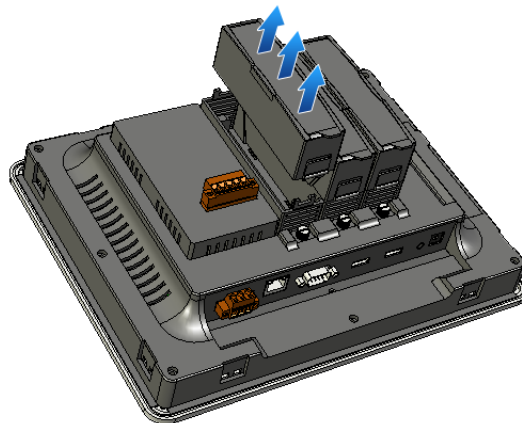

## 2.1.2.2. Inserting the I/O Modules


ViewPAC supports a complete range of I/O modules for interfacing many different field devices.

For more information about I/O expansion modules, please refer to:

[http://www.icpdas.com/products/PAC/winpac/io\\_support\\_list.htm](http://www.icpdas.com/products/PAC/winpac/io_support_list.htm)

**Step 1: Hold the I/O module vertically and align the socket**

**Step 2: Carefully press the I/O module onto the socket**

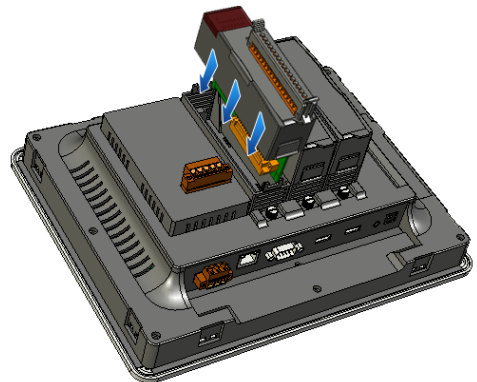

### Tips & Warnings

---



If you do not expand the I/O module full, please keep the top case of the unused slot to protect the backplane from dirt, dust and damage from foreign objects.

---

**Step 3: Read the relevant documentation**



Manual

**For high profile I-8K series:**

CD:\napdos\io\_module\

[http://www.icpdas.com/products/PAC/winpac/io\\_support\\_list.htm](http://www.icpdas.com/products/PAC/winpac/io_support_list.htm)

**For high profile I-87K series:**


CD:\napdos\io\_module\

[http://www.icpdas.com/products/PAC/winpac/io\\_support\\_list.htm](http://www.icpdas.com/products/PAC/winpac/io_support_list.htm)

## Step 4 Wire the I/O channels

All documents include the I/O module specifications, pin assignments and wiring connections.

For example, Pin Assignments and Wiring connections for the I-87054W module are as follows:

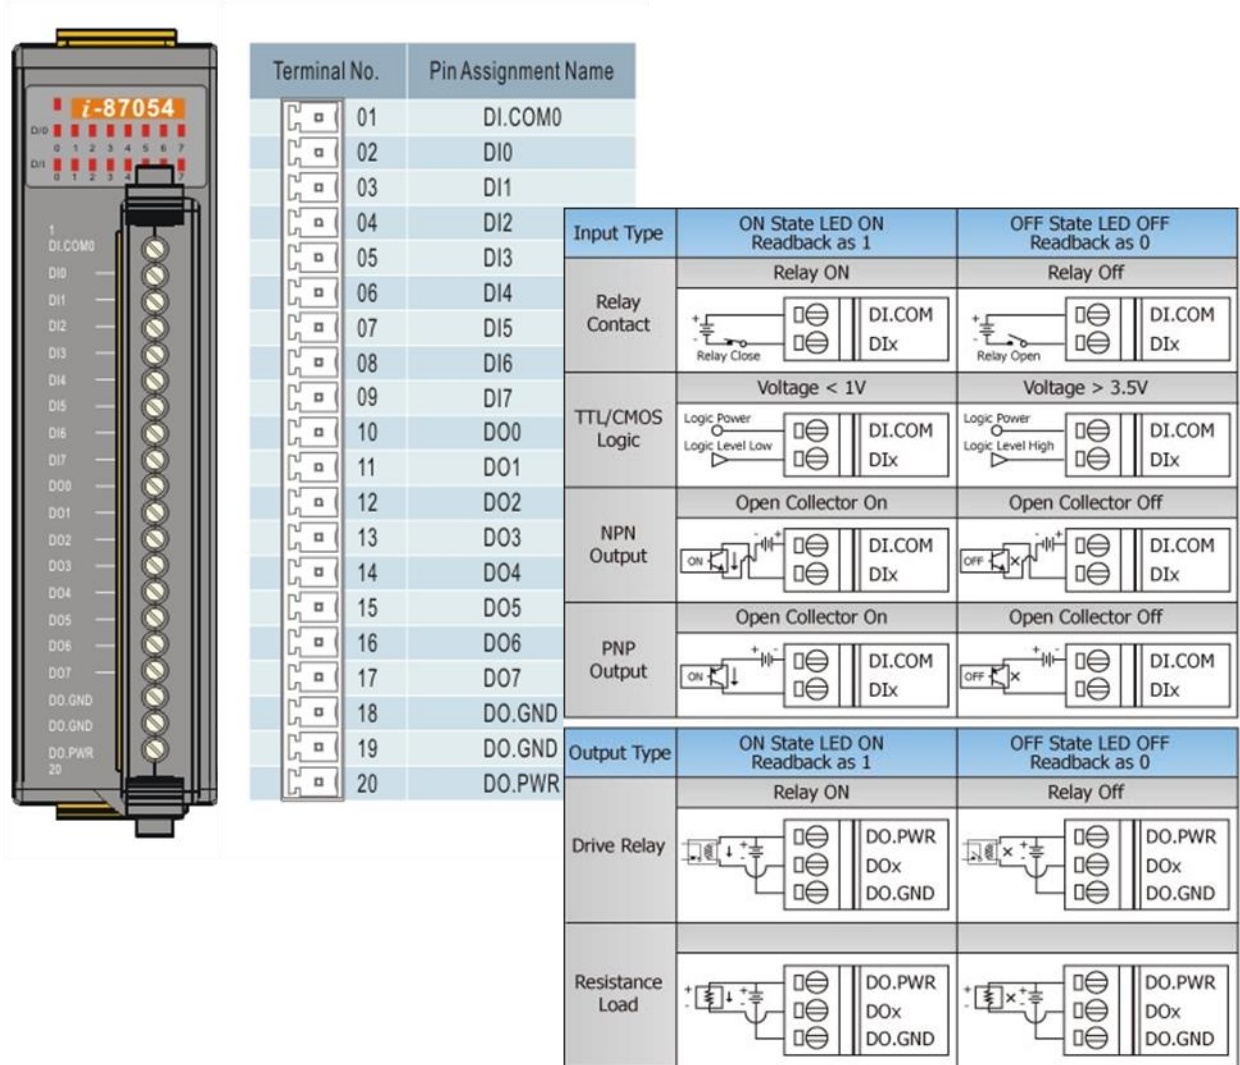

### Tips & Warnings



It is recommended that the power to the ViewPAC is switched off when wiring the I/O module which are plugging in the ViewPAC slots.




### 2.1.2.3. Mounting the ViewPAC

The ViewPAC can be mounted on a panel of maximum thickness 5 mm. Adequate access space can be available at the rear of the instrument panel for wiring and servicing purposes.





To ensure proper ventilation for your ViewPAC, leave a minimum of 50mm space between the top and bottom edges of the ViewPAC and the enclosure panels.

Panel thickness up to 5 mm

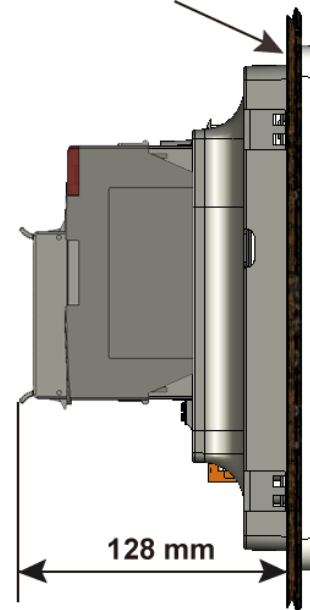


- 1) Prepare the panel and cut the hole to the specified size.

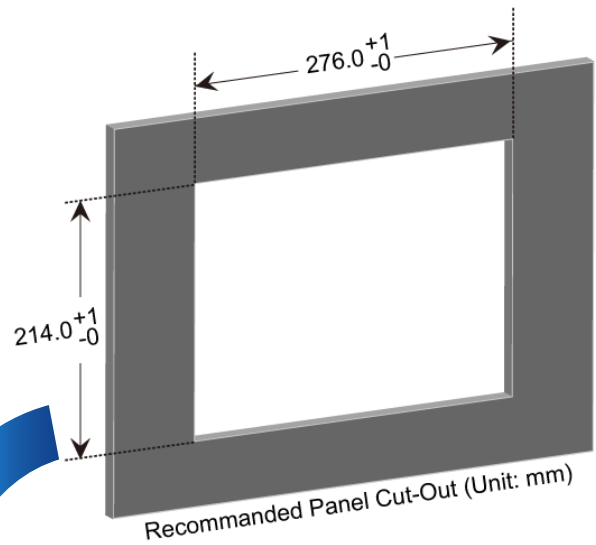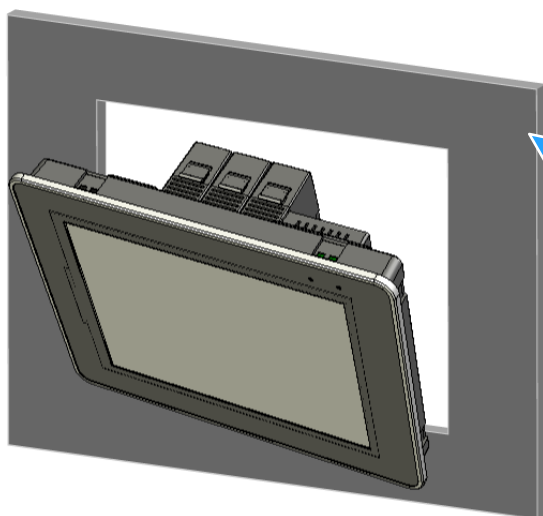


- 2) Attach the ViewPAC to the cut-out hole.

- 3) Insert the panel mounting clips into the upper and lower ventilation holes.

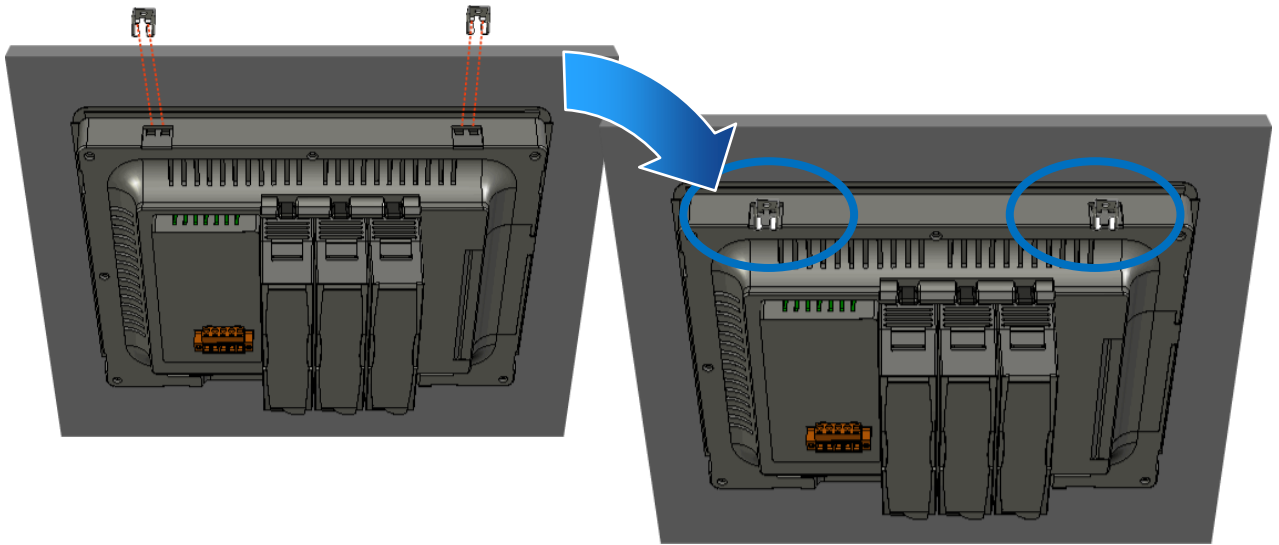

- 4) Screw the panel mounting clips to the panel.

Mounting Screw:  
M4 x 35L

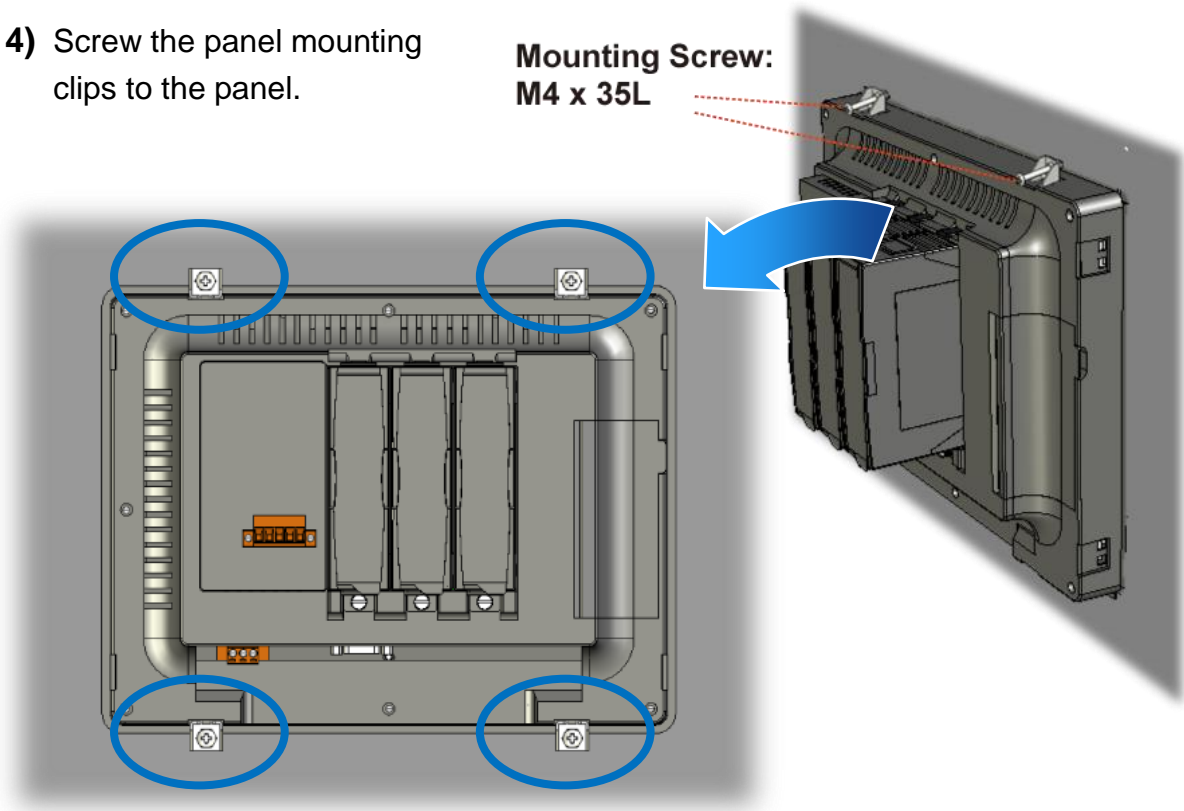

Recommended Screw Torque: 3.4 ~ 4.5 kgf-cm.

## 2.2. Installing the Tools and Utilities

The ViewPAC has several tools and utility that allows and supports you quickly and easily to manage the ViewPAC. Here we will introduce two practical of them and guide you through the installation.



cerhost.exe

**Remote Display** is one of the Windows CE operating system toolkits. If your ViewPAC is connected to PC through the network, you can use this utility to display the device screen on the host PC and control the ViewPAC remotely through this interface.

For more information on how to use Remote Display to control the ViewPAC remotely, please refer to section 2.6. Using Remote Display to Control the ViewPAC Remotely



DCON\_Utli...

**DCON Utility** is a toolkit that is designed to configure, manage and monitor the I/O modules from PC via COM port or Ethernet.

For more information on how to use DCON Utility to configure the I/O module, please refer to section 2.7. Using “DCON Utility” to configure the I/O Module.

### Step 1: Get the DCON Utility and Remote Display

The DCON Utility and Remote Display can be installed from the CD that was provided with the package or by downloading the latest version from ICP DAS web site.

CD:\napdos\vp-2000\_ce50\PC\_Tools\


[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/pc\\_tools/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/pc_tools/)

### Step 2: Follow the prompts until the installation is complete

## 2.3. Configuring the Boot Mode

The ViewPAC has seven boot modes that can be determined through a rotary switch.

The table below lists the operation mode selection.

	Position	Modes of operation
	0	Normal mode (Default)
	1	Safe mode
	2	Debug mode
	3	OS update mode
	4	Development mode
	5	DCON_CE
	6	VCEP
	7 ~ 9	(For user)

---

### Normal Mode (Default)

Normal mode is the default mode of operation and the one you will use most of the time. Use this mode for more tasks and configurations. Programs also are executed in this mode.

---

### Safe Mode

Safe mode is a troubleshooting option that starts your computer with only basic services and functionality. If an existing problem does not reappear when you start ViewPAC in safe mode, you can eliminate the default settings and basic device drivers as possible causes.

## Tips & Warnings


---



In normal mode, if the new settings are not saved when you change and save the settings using the ViewPAC Utility, to solve this problem, perform the following steps:


### Step 1: Restart the ViewPAC in safe mode

Turn the rotary switch to “1”, and then restart the ViewPAC.

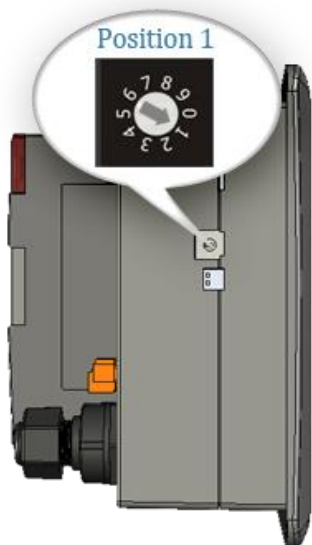


### Step 2: Start the ViewPAC Utility to restore the default settings

Start the ViewPAC Utility, and then click the “Restore Default Settings” command and “Save” command from the “File” menu

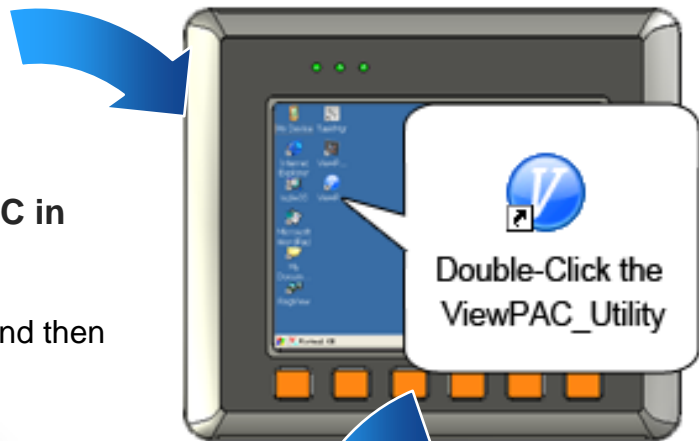

### Step 3: Restart the ViewPAC in normal mode

Turn the rotary switch to “0”, and then restart the ViewPAC.

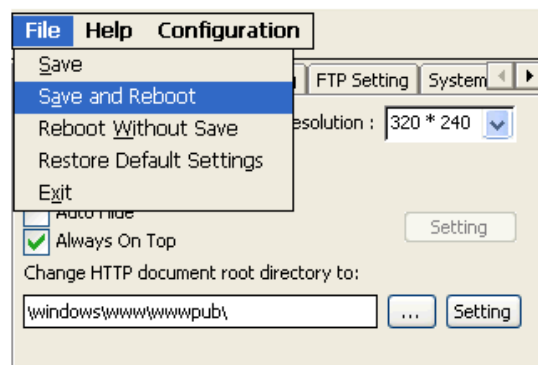

---

## Debug Mode

The debug mode is a function hidden in a program that provides options used for testing and debugging that are not available to users.

Debug mode is unsupported.

---

## OS Update Mode

OS update mode is a way that is used to update OS. To update the ViewPAC OS image, please refer to “6.1. OS updates”

---

## DCON\_CE Mode

This mode is the same as Normal mode. Besides, DCON\_CE.exe will be run automatically after booting

---

### Tips & Warnings



DCON\_CE.exe must be placed on the  
\System\_Disk\Tools\DCON\_CE, or else DCON\_CE.exe cannot  
be run automatically after booting.

---

## VCEP Mode

This mode is the same as Normal mode. Besides, VCEP.exe will be run automatically after booting.

### Tips & Warnings

---



VCEP.exe must be placed on the \System\_Disk\Tools\VCEP or else VCEP.exe cannot be run automatically after booting.

---

---


## User Mode

Rotary switch position 7, 8, 9 are reserved for user's applications.

When ViewPAC is boot with one of these rotary switch positions, it is boot at normal mode. User's application can check the rotary switch position to run at different mode.


## 2.4. Changing the User Interface Language

The "Regional Settings" is a Windows CE functionality that allows users to easily change the ViewPAC user interface to your native language.

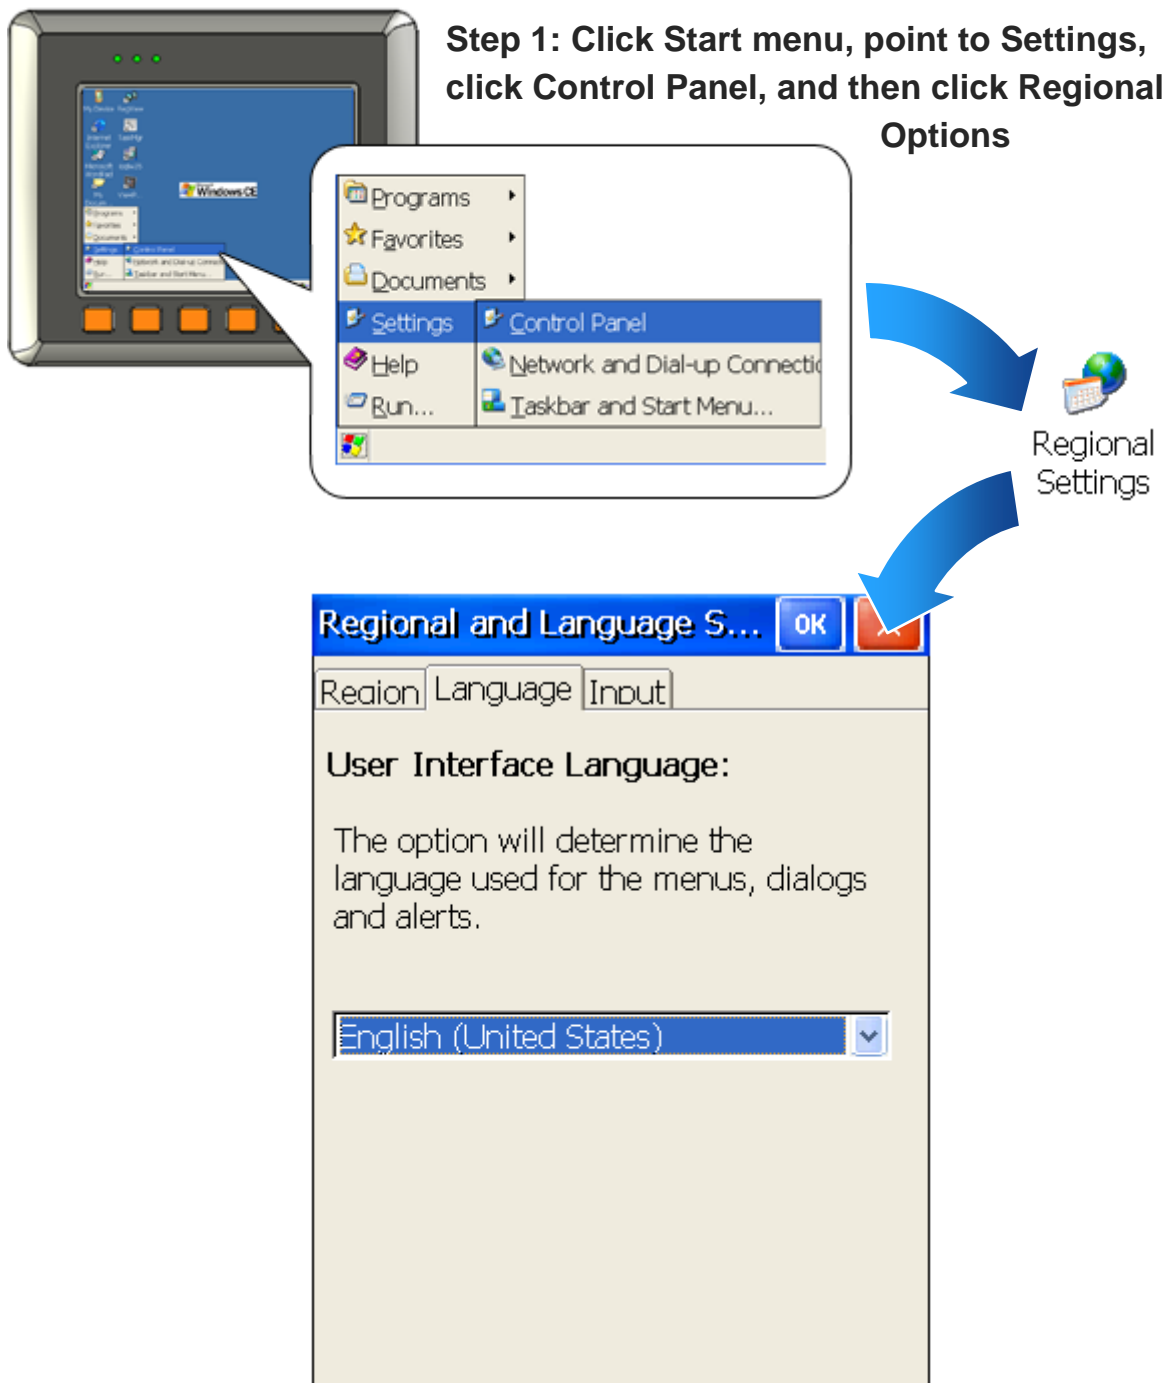





**Step 2: Click User Interface Language tab, choose your local language, and then click OK**

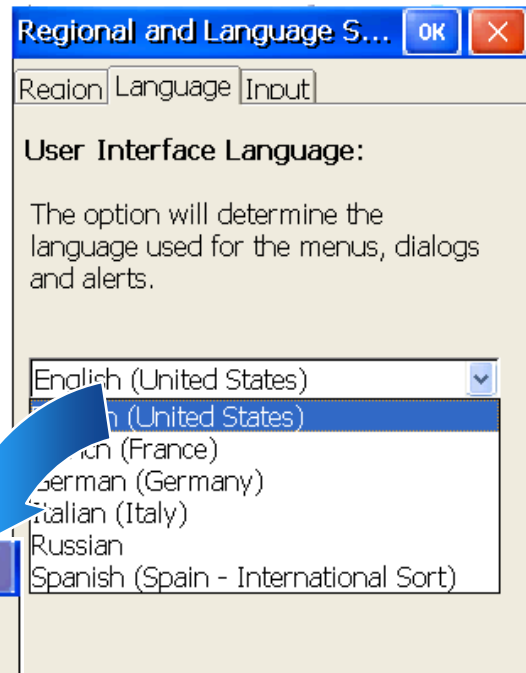

**Step 3: Click OK, and then run the ViewPAC Utility**

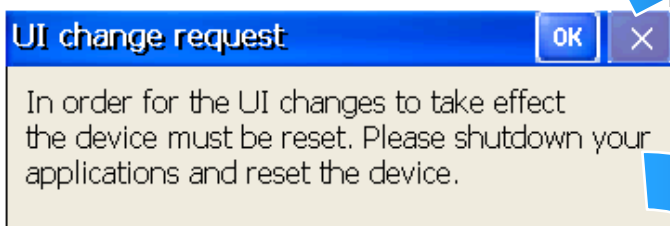

**Step 4: Save and reboot the ViewPAC**

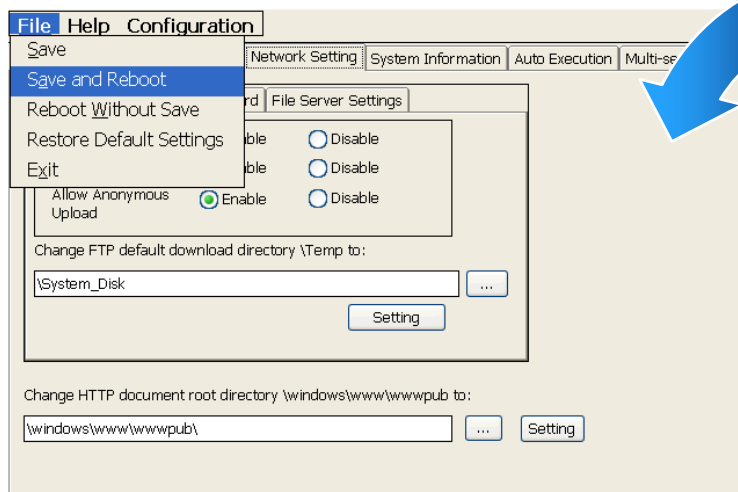


## 2.5. Testing the ViewPAC

ViewPAC combines WinPAC, graphic display and keypad dial in one unit. The ViewPAC Quick Test is a toolkit used to check out the ViewPAC particular function compared with WinPAC.

### VP-23W1:




#### Audio Options:



Play Audio button is used to check the audio output.

#### Buzzer Options:



Play Buzzer button is used to check the buzzer.


#### LED Options:

These buttons are used to check LEDs sign.

#### KeyPAD Option:

Checkboxes are used to check the KeyPAD.

Text field is used to check the input format.

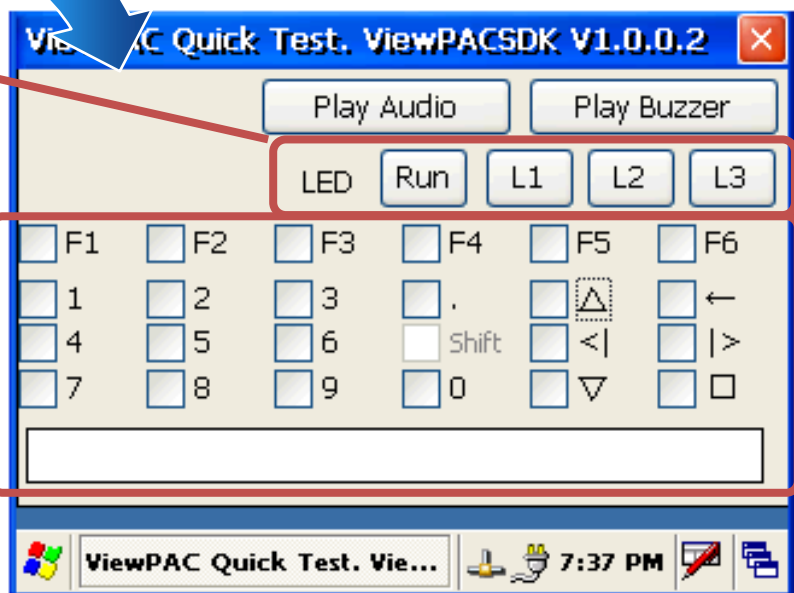

### Tips & Warnings




The shift key is a modifier key used to enter alternate upper letters or characters.

## VP-25W1:




### Audio Options:



Play Audio button is used to check the audio output.

### Buzzer Options:



Play Buzzer button is used to check the buzzer.

### LED Options:

These buttons are used to check LEDs sign.

### KeyPAD Option:


Checkboxes are used to check the KeyPAD.

### LCD Backlight Options:


The slider is used to check the LCD Backlight.



## VP-4131:

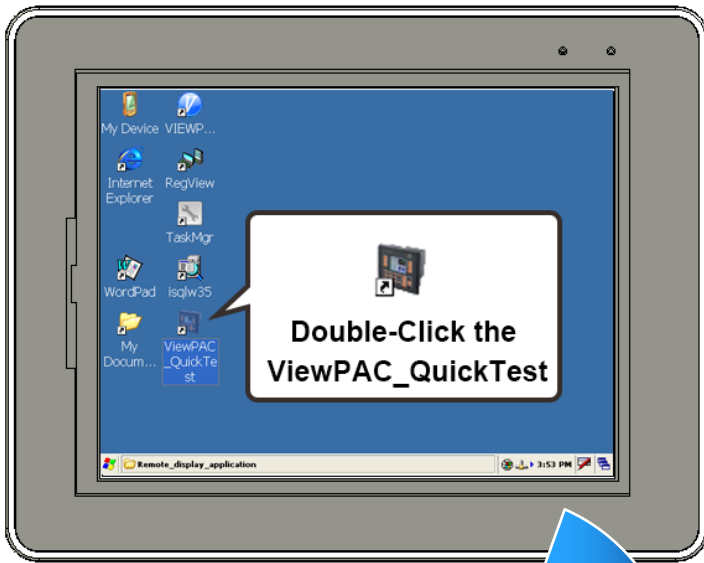


### Audio Options:



Play Audio button is used to check the audio output.

### Buzzer Options:




Play Buzzer button is used to check the buzzer.

### LED Options:

These buttons is used to check LEDs sign.

### LCD Backlight Option:

The slider is used to check the LCD backlight.

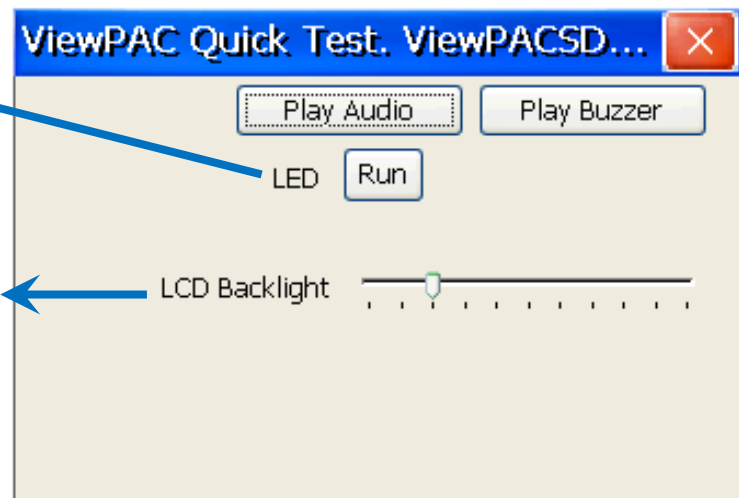

## 2.6. Using ViewPAC Utility to manage the ViewPAC


The ViewPAC Utility is a collection of the ViewPAC system tool that allows user quickly and easily manage and configure the ViewPAC.

For more detailed information on ViewPAC Utility applications, please refer to “3.5. ViewPAC Utility”


### Step 1: Run the ViewPAC Utility located on desktop



### Step 2: Configure IP address (DHCP), FTP Server, Auto Execution files..., etc

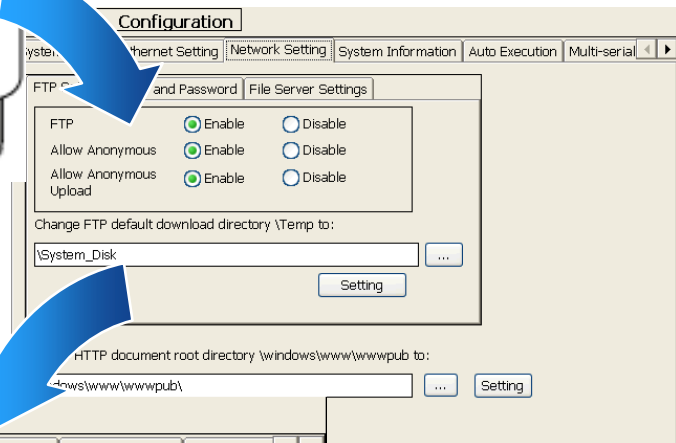

### Step 3: Save and Reboot the ViewPAC

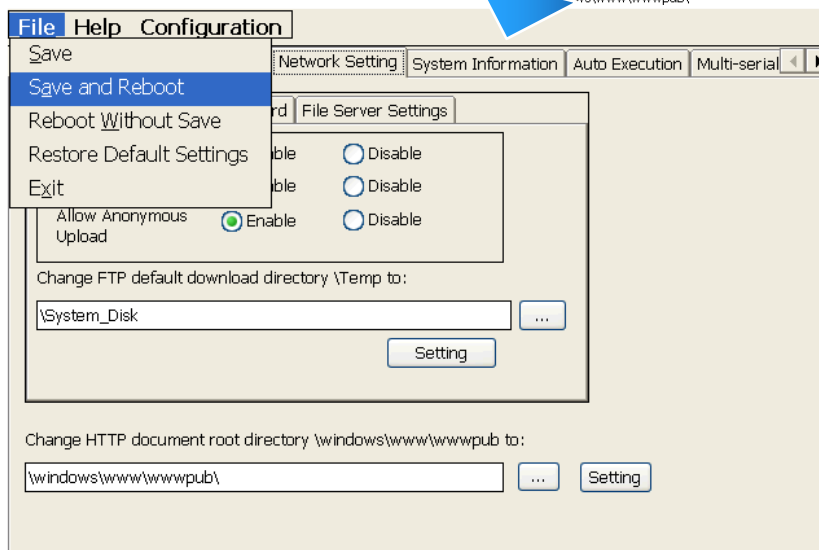


## 2.7. Using DCON Utility to Configure the I/O Modules

The DCON Utility is a client utility that runs on PC, and communicates with ViewPAC via DCON protocol. The DCON Utility allows users to remotely connect to I-7K and I-87K series I/O modules for management through the COM port and Ethernet port.

This tool is composed of two parts, a client and a server. The server is a program named DCON\_CE\_WP.exe running on ViewPAC. The client is a PC-based program named DCON\_UTILITY.exe running on PC.

### Step 1: Run the DCON firmware on the ViewPAC controller

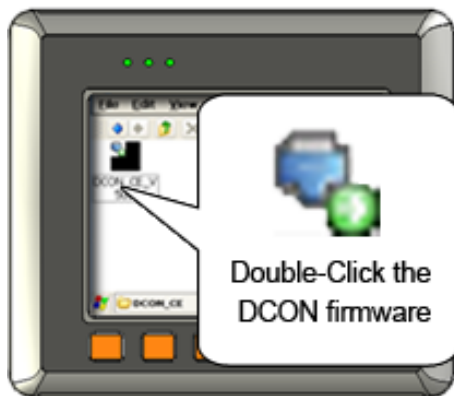

The DCON firmware is located at:  
\\System\_Disk\\Tools\\DCON\_CE\\

### Step 2: Run the DCON Utility on the host PC




The DCON Utility can be obtained from:


CD:\\napdos\\vp-2000\_ce50\\PC\_Tools\\DCON\_UTILITY\\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/pc\\_tools/dcon\\_utility/](http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/pc_tools/dcon_utility/)


### Step 3: Click the WIN CE button

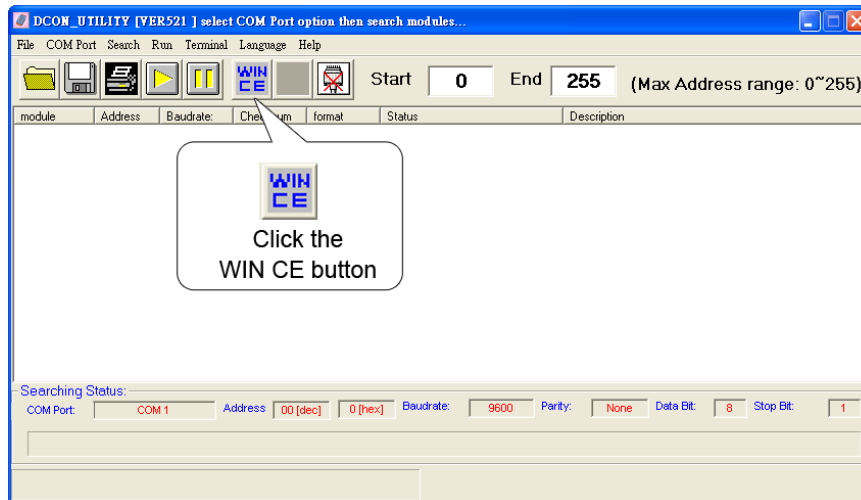

### Step 4: On the WINCE device connection, enter the IP address of the ViewPAC, and press the “Connect to WinPAC” button to search the I-87K series expansion I/O modules

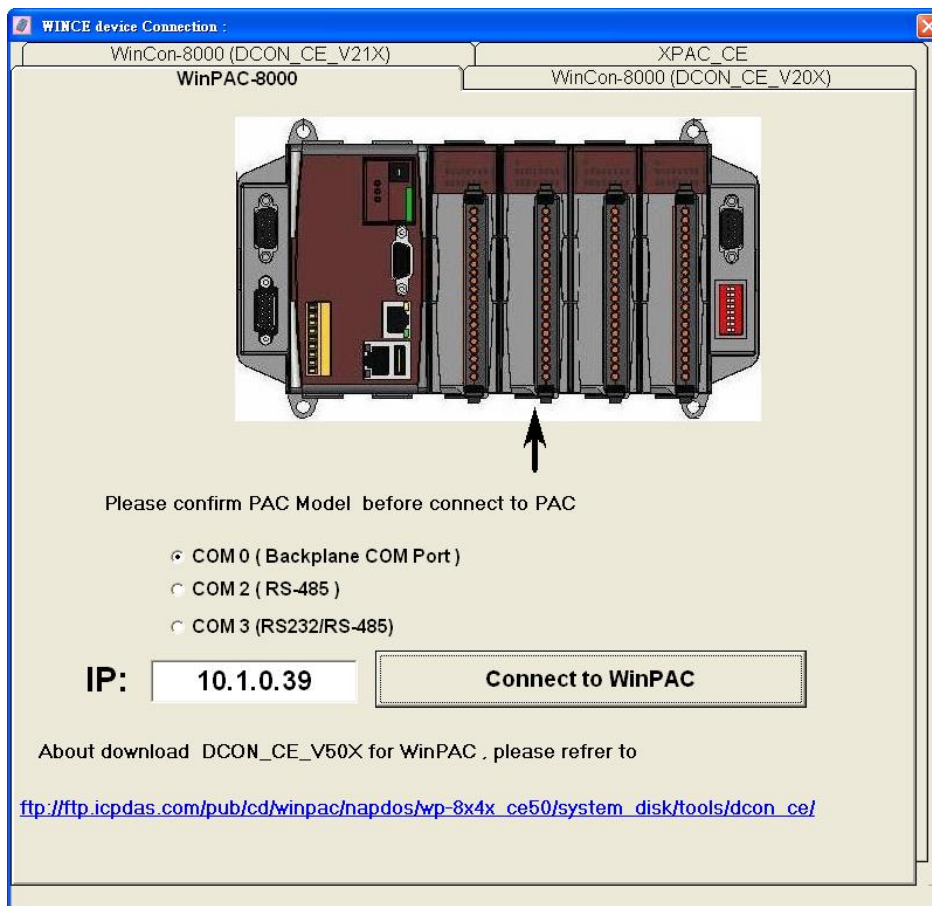

**Step 5: It will display a list of I-87K series expansion I/O modules, then select the module name that you want to configure**

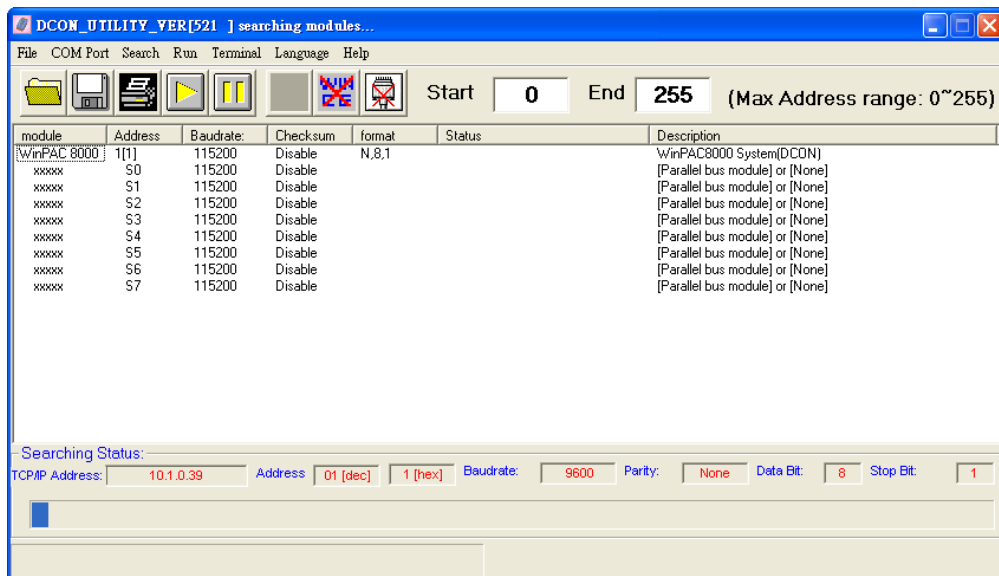




## 2.8. Using Backup Utility to Backup the settings and files

After saving the configuration settings for a ViewPAC device following the first use, it is recommended to use the Backup utility to back up all the settings and files.


### Step 1: Run the Backup Utility on the ViewPAC

The DCON firmware is located at:  
\\System\_Disk\\Tools\\Backup\_utility\\



### Step 2: Click the Backup menu

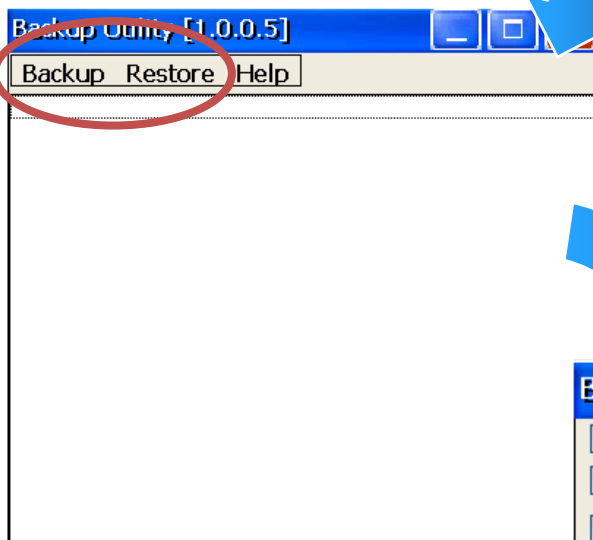

### Step 3: Select the options that you want to backup, enter text annotations and then click the Start backup button

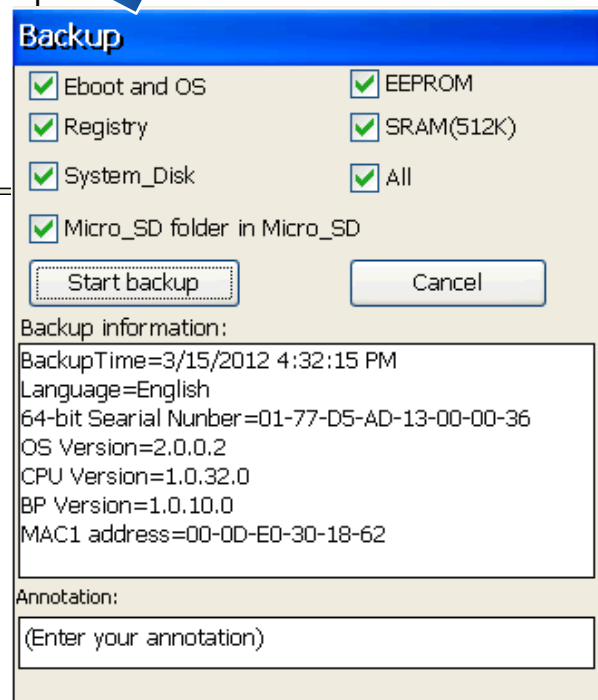


**Step 4: Confirm the backup options and then click Yes button**

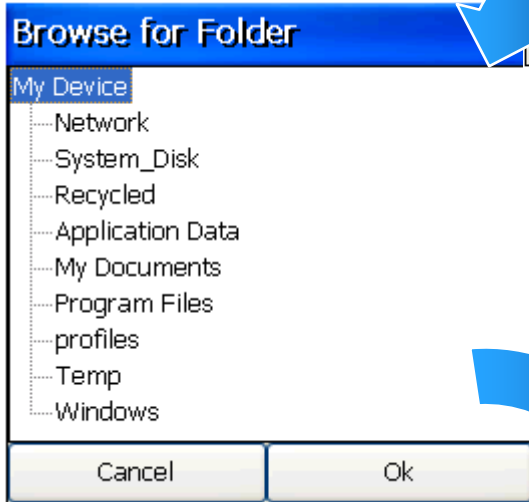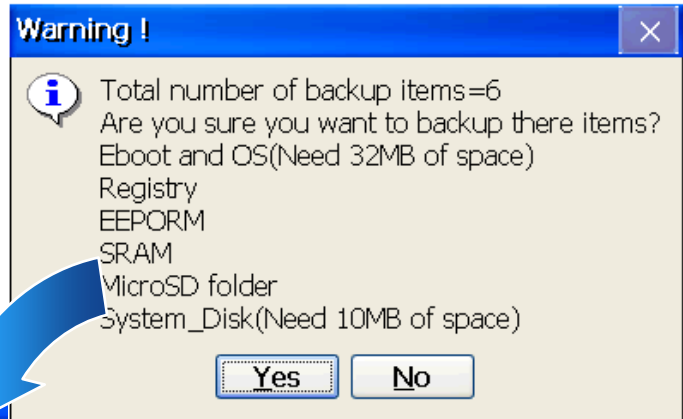

**Step 5: Choose the folder that you want to save backup file and click the Ok button**



**Step 6: Wait for process to finish**

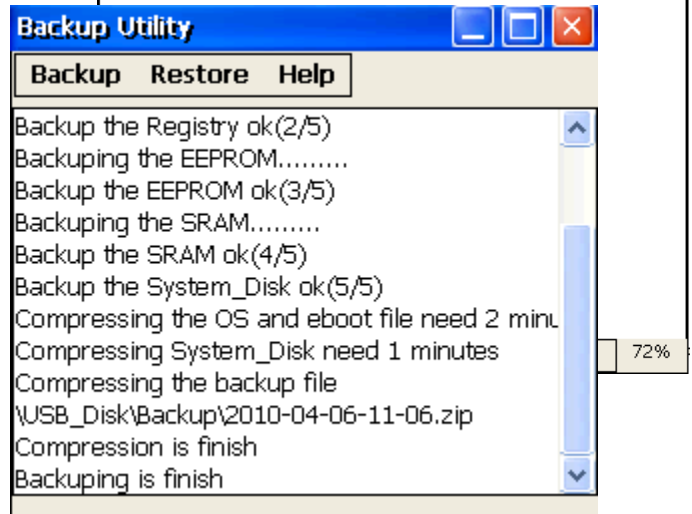

## 2.9. A caution about using System\_Disk

The System\_disk is an authoritative storage device, but is not suitable for frequent copying and deleting of files and is only suitable for storing important files that are not changed frequently.

If files are copied and deleted frequently, the system will automatically perform a System\_Disk defragment action, which will consume the total resources of the CPU and cause the OS not to function correctly.


When the OS System\_Disk defragment action is being performed, the run LED will blink and the defragment action icon will show in the system tray in the bottom right-hand of the pc screen.

### Tips & Warnings

---



Do not power off the ViewPAC while the defragment is being performed.

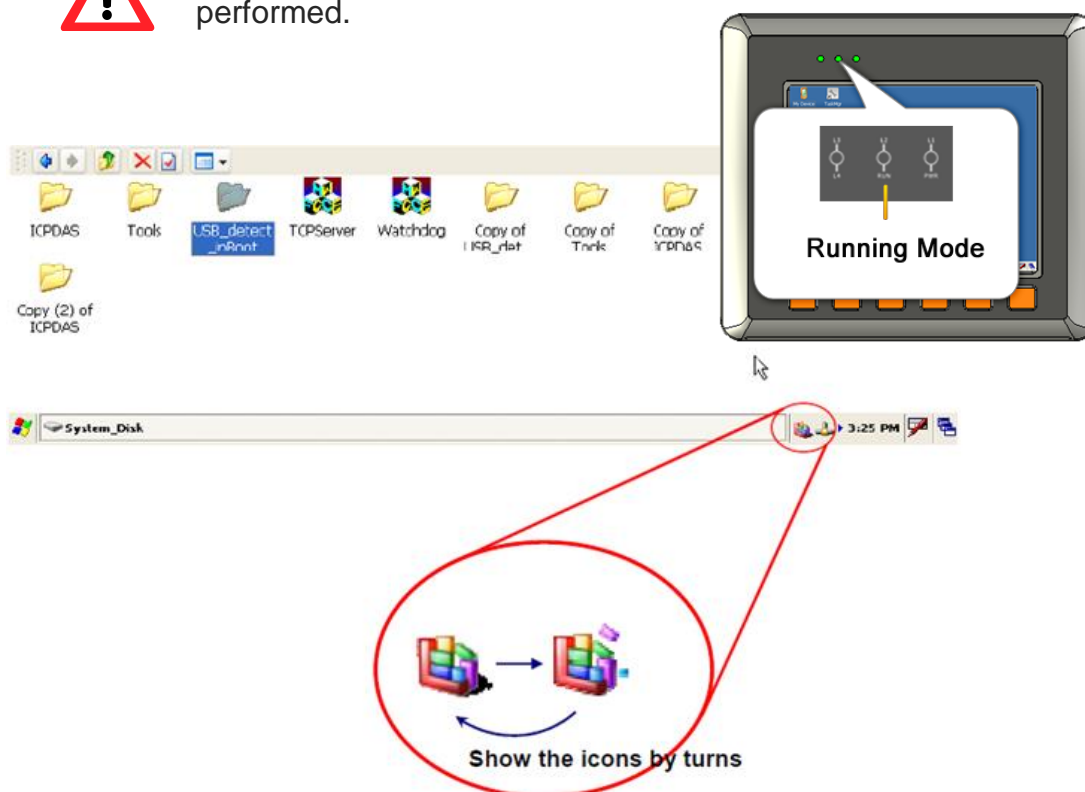


# 3. Tools and Tasks

This chapter briefly describes the functions of the ViewPAC tools and utilities.

There are several tools and utilities built-in and designed for use with ViewPAC. Some of these tools and utilities are installed on the ViewPAC controller, some are available on PC.

Both the tools and utilities of the ViewPAC side and PC side tools can be found separately on the CD that was provided with the package or by downloading the latest version from ICP DAS web site.

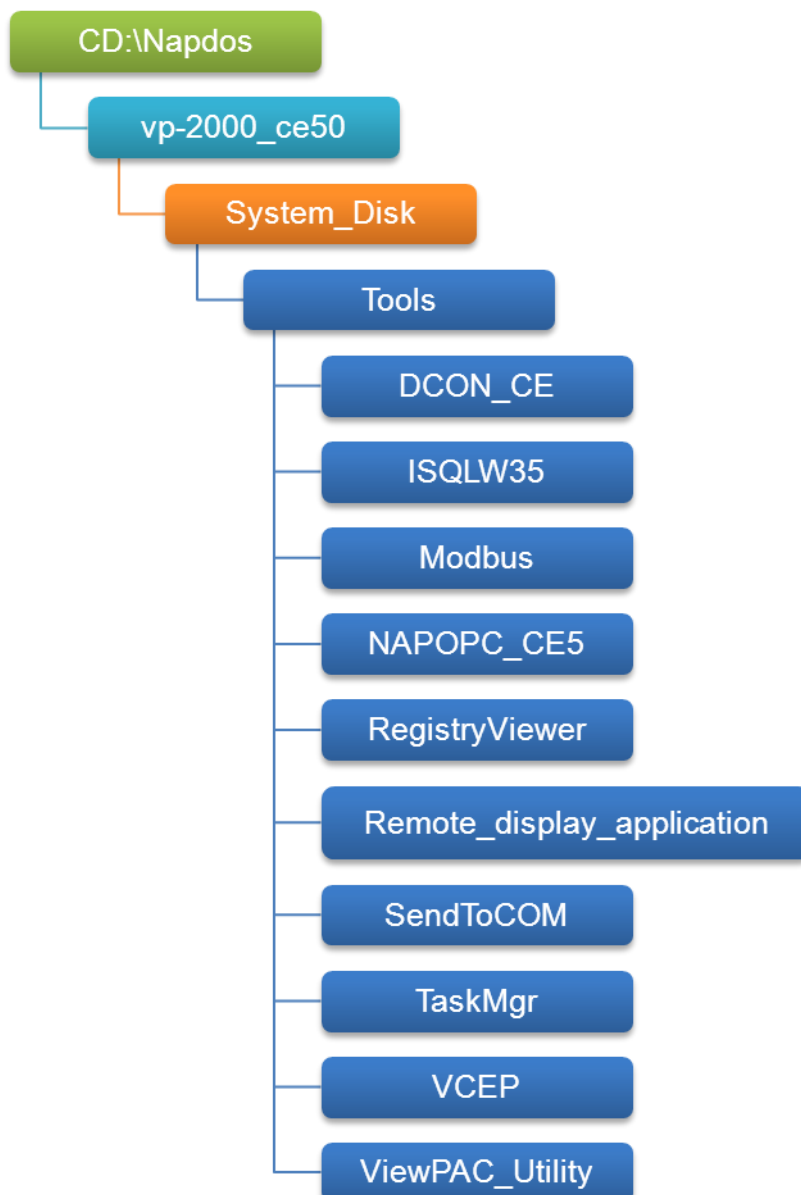

- **DCON\_CE**

---

With Host PC running the DCON Utility, on the ViewPAC, the DCON\_CE program allows user to view and monitor the I/O status from DCON Utility.

- **ISQLW35**

---

The ISQLW35 implements SQL server compact 3.5 Query Analyzer.

- **Modbus**

---

The Modbus provides various applications of Modbus protocol for configuring the ViewPAC.

- **NAPOPC\_CE5**

---

NAPOPC\_CE5 is an integrated omnibus software package, it allows user to quickly establish a DCS control system.

For more information about the NAPOPC\_CE5, please refer to “3.2. NAPOPC\_CE5”.

- **RegistryViewer**

---

The Registry Viewer allows user to view the registry value of Windows CE Operating System.

- **Remote display application**

---

The remote display application allows user to view the display remotely of the ViewPAC on a Host PC.

- **SendToCOM**

---

The SendToCOM allows user to send/receive data to/from the expansion module via serial port.

- **TaskMgr**

---

The TaskMgr provides details about programs and processes running on the ViewPAC.

- **VCEP**

---

The VCEP allows user to manage the ViewPAC remotely on a Host PC.

For more information about the VCEP, please refer to “3.4. VCEP (Virtual CE Pro)”.


- **ViewPAC Utility**

---

The ViewPAC Utility provides various useful functions such as configuring Ethernet settings, monitoring system settings and FTP services .etc for easy and quick management.

For more information about the ViewPAC Utility, please refer to “3.5. ViewPAC Utility”.

## 3.1. DCON Utility

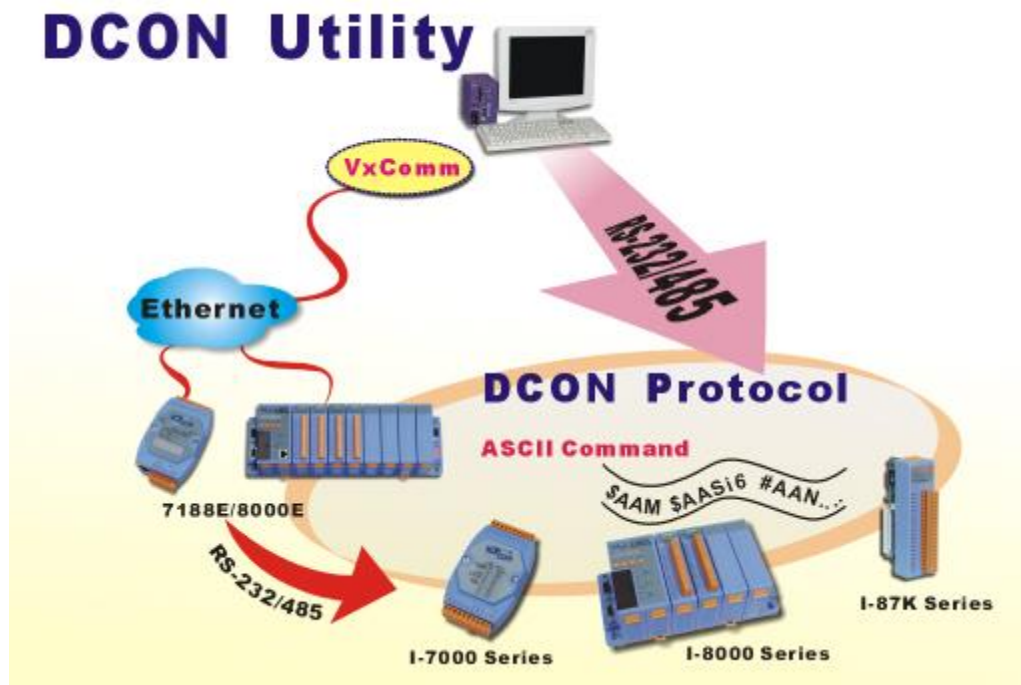

The DCON Utility is a tool kit that help user search the network, easily to Configure the I/O modules and test the I/O status via the serial port (RS-232/485) or Ethernet port (using virtual com port). It supports not only the DCON Protocol I/O modules but also the M Series I/O Modules (Modbus RTU M-7K, M-87K and will support Modbus ASCII M-87K) now.

For more detailed information on ViewPAC Utility applications, please refer to “2.7. Using DCON Utility to configure the I/O modules”

## 3.2. NAPOPC\_CE5



**NAPOPC\_CE5 DA Server** is a free OPC DA Server (The "OPC" stands for "OLE for Process Control" and the "DA" stands for "Data Access") working on WinPAC, ViewPAC & WinCon controllers provided by ICP DAS Ltd. The first standard (originally called simply the OPC Specification and now called the Data

Access Specification) resulted from the collaboration of a number of leading worldwide automation suppliers working in cooperation with Microsoft. Originally based on Microsoft's OLE COM (component object model) and DCOM (distributed component object model) technologies, the specification defined a standard set of objects, interfaces and methods for use in process control and manufacturing automation applications to facilitate interoperability. NAPOPC\_CE5 DA Server integrates OPC, Modbus TCP Slave and Modbus RTU Slave three kind Slave services, as well as integrates Modbus TCP Master, Modbus RTU Master and DCON three kind Master communication protocols. It also provides one advanced function "Rule Script" for use in the I/O integration and transformation, and some conditional Logic operation.

Any version before 2.1.0 of the NAPOPC\_CE5 was named "Quicker"




### 3.3. SendToCOM


The SendToCOM uses the serial port to communicate with expansion module. To use the SendToCOM, you can send data to expansion module through the serial port, and receive data from other device through the serial port.

For more information about these commands for communicating with expansion module, please refer to:

CD:\Napdos\io\_module\87k\_high\_profile\_modules.htm

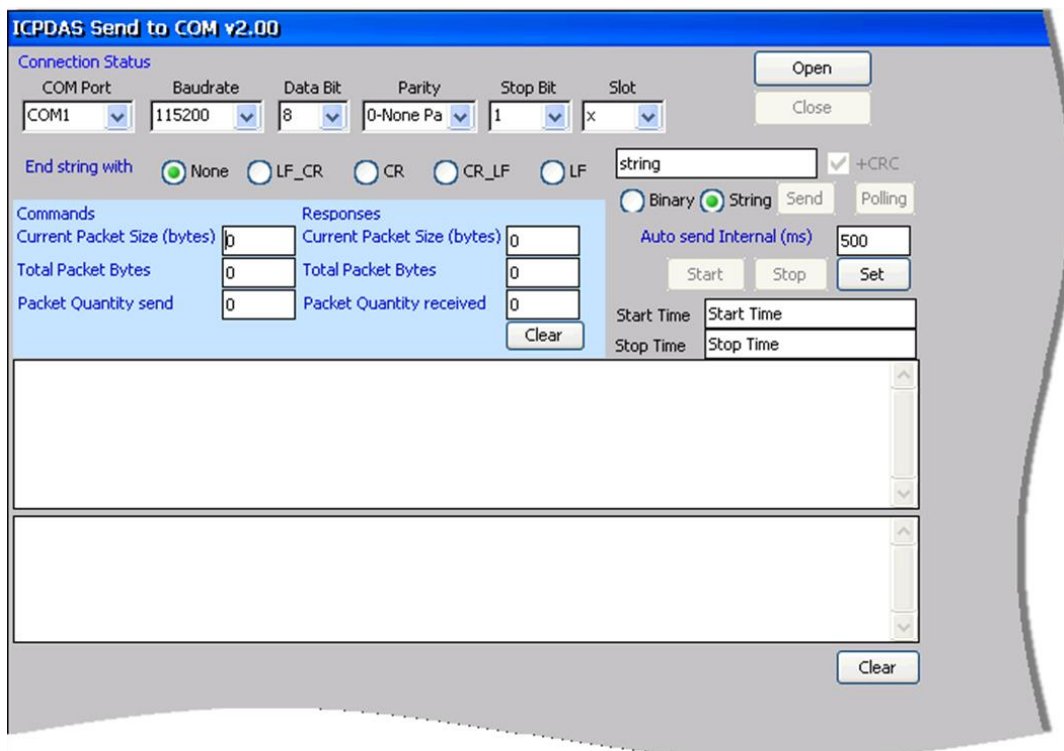

## 3.4. VCEP

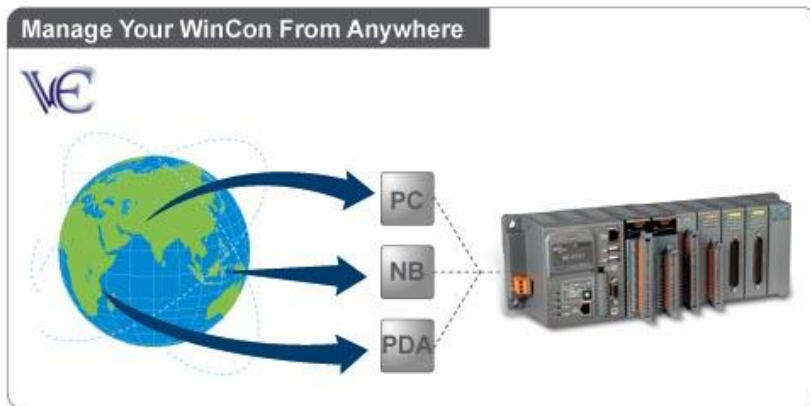

ICPDAS VCEP is designed for managing your ViewPAC anywhere. No matter where you are, ICPDAS VCEP provides a convenient environment on the Desktop PC and allows you control your ViewPAC remotely.

### **ICPDAS VCEP is composed of two main components:**

The “Server” which runs on ViewPAC.


The “Client” which runs on a Desktop PC.

Once a connection is established between the client and server (initiated by the client), the client will periodically send requests for screen updates and send mouse/key click information to the server to simulate. Each video frame is inter-compressed against the previous frame and then intra-compressed with a modified LZW scheme to minimize the amount of data transmitted from server to client.

For more detailed information on VCEP application, please refer to [http://www.icpdas.com/products/PAC/wincon-8000/wincon\\_VirtualCE.htm](http://www.icpdas.com/products/PAC/wincon-8000/wincon_VirtualCE.htm)

## 3.5. ViewPAC Utility


The ViewPAC Utility is a tool which is designed to quickly control and management the ViewPAC.

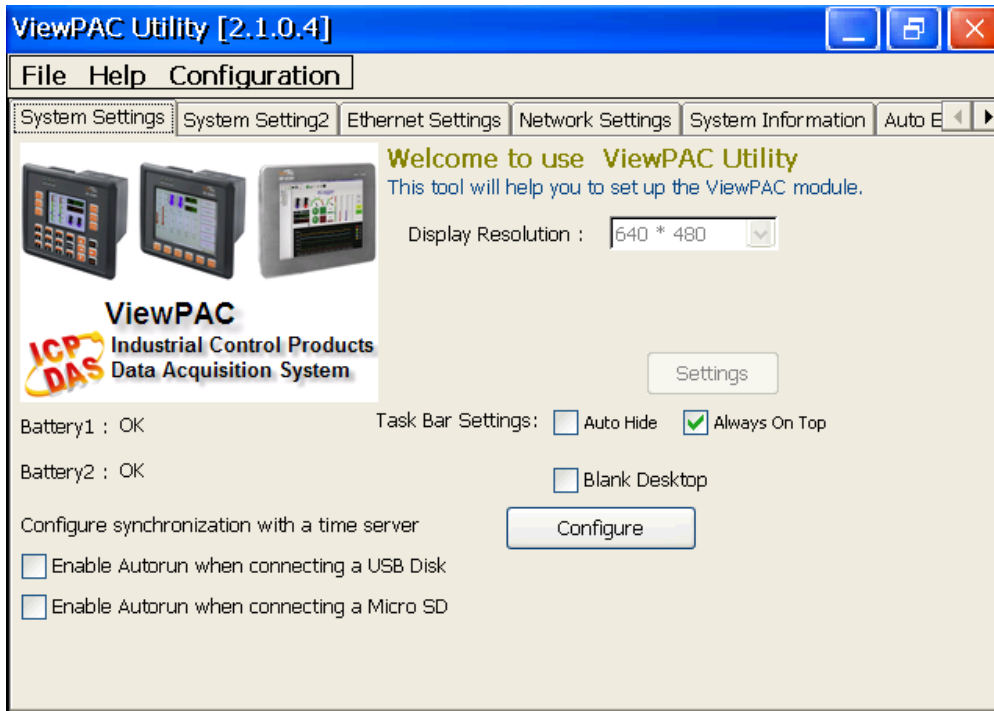


### 3.5.1. Menu Bar

The ViewPAC Utility includes the following function menu. All function menus will be explained later.


#### ✓ File Menu

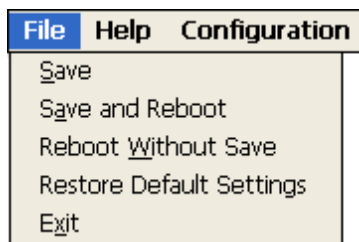

#### ✓ Help Menu

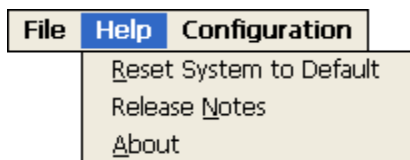


#### ✓ Configuration Menu

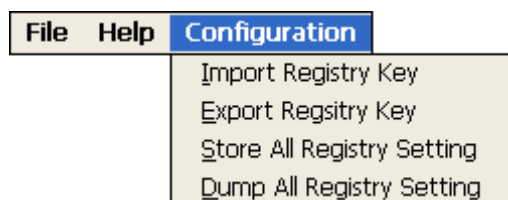

## File Menu


---

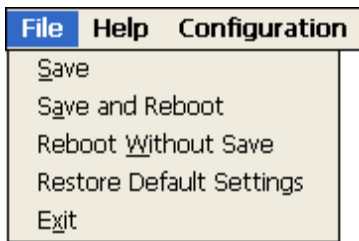

The menu commands	Use to
Save	Saves the settings into Flash. The new settings don't take effect until the ViewPAC restart.
Save and Reboot	Saves the settings into Flash and restart the ViewPAC. The new settings will take effect after the ViewPAC restart.
Reboot Without Save	Restarts the ViewPAC without save the settings into Flash.
Restore Default Settings	Restarts the settings of ViewPAC to its factory default values. The settings include configuration setting, network setting, auto execution, etc.
Exit	Exits the ViewPAC Utility.

## Help Menu

---

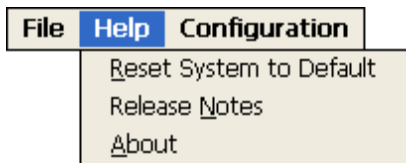

The menu commands	Use to
Reset System to Default	Resets the system interrupt status to default. The operation used in the situation when the interrupt crash. You can select this operation to reset the interrupt status without rebooting the device.
Release Notes	Checks out what's new and the know issues.
About	Displays a dialog box with information about ViewPAC Utility, including the current version and copyright information.

## Configuration Menu

---




The menu commands	Use to
Import Registry Key	<p>Backs up a sub-key of registry by using a registration entry (.reg) file.</p> <p>How to use:</p> <p>Step 1: Select the “Import Registry Key”, then the “Open” dialog box will appear</p> <p>Step 2: On the “Open” dialog box, select a specific .reg file to import</p> <p>Warning:</p> <ol style="list-style-type: none"> <li>1. The .reg file which should be saved by “Export Registry Key”.</li> <li>2. It will not save automatically after import a .reg file.</li> </ol>
Export Registry Key	<p>Makes a backup of a registry sub-key</p> <p>How to use:</p> <p>Step 1: Select the “Export Registry Key”, then the “Export Registry” box will appear</p> <p>Step 2: Select a specific root key</p> <p>Step 3: Input a specific path of sub-key</p> <p>Step 4: Push the “OK” button, then the “Save As” dialog box will appear prompting you to select a location where you want to save this exported file</p> <p>Warning:</p> <p>The export operation will export all the sub-keys of the specific key which you input.</p>
Store All Registry	Stores all registry setting to flash from .das file which

The menu commands	Use to
Setting	<p>is saved by “Dump All Registry Setting”.</p> <p>How to use:</p> <p>Step 1: Select the “Store All Registry Setting” , then the “Open” dialog box will appear</p> <p>Step 2: On the “Open” dialog box, select a specific .das file to store</p> <p>Warning:</p> <ol style="list-style-type: none"> <li>1. The .das file which should be saved by “Dump All Registry Setting”.</li> <li>2. It will save automatically after store .das file.</li> </ol>
Dump All Registry Settings	<p>Dump all registries setting to .das file.</p> <p>How to use:</p> <p>Select the “Dump All Registry Setting”, then the “Save As” dialog box will appear prompting you to select a location where you want to save this exported file.</p>



## 3.5.2. Property Tabs


The ViewPAC Utility includes the following property tabs, all property tabs will be explained later.

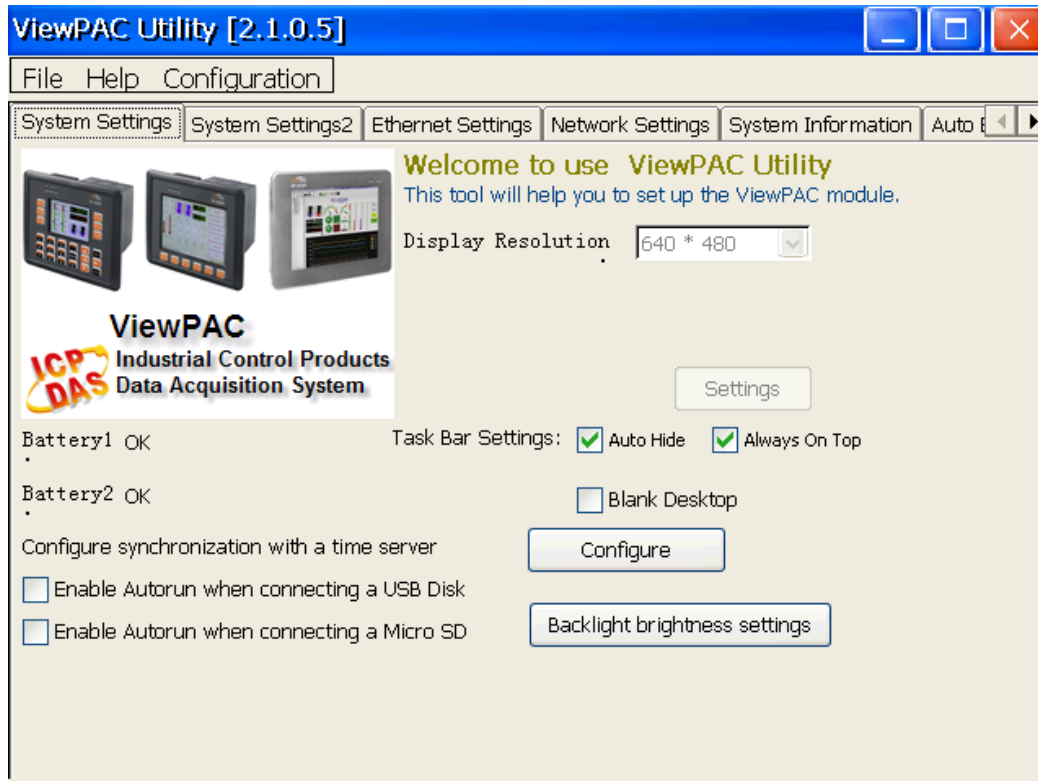

- ✓ **System Settings**
- ✓ **System Setting2**
- ✓ **Ethernet Settings**
- ✓ **Network Settings**
- ✓ **System Information**
- ✓ **Auto Execution**
- ✓ **Multi-serial port wizard**
- ✓ **System Memory Setting**
- ✓ **Backplane Compatibility**

## System Settings Tab

The System Settings tab provides functions to configure the task bar.

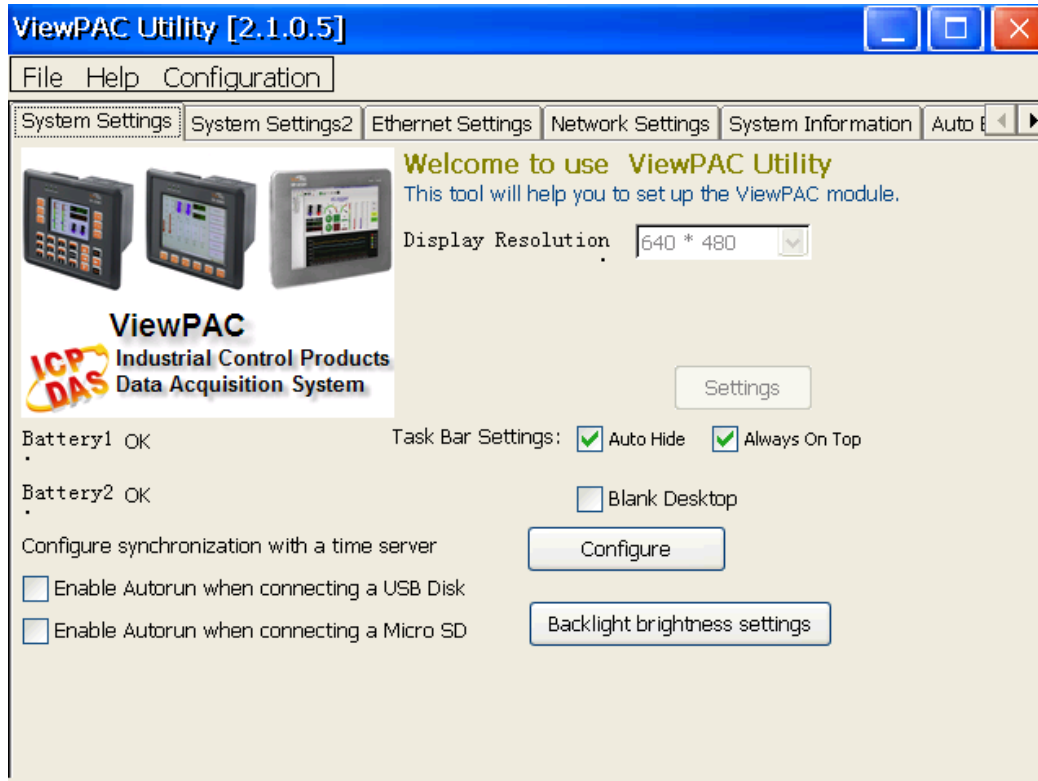


The tab use to	How to use
Lock or Auto-Hide the taskbar	Auto-Hide: Select the <b>Auto Hide</b> check box Lock: Select the <b>Always On Top</b> check box.
Check the status of the battery	See the <b>Battery1</b> and <b>Battery2</b> field that displays the battery status.

**Note:** The battery type is BR1632 (Part number is 2LB010 for ICP DAS)

## System Settings2 Tab


The System Settings2 tab provides functions to set the name of the MicroSD card and the USB hard disk.

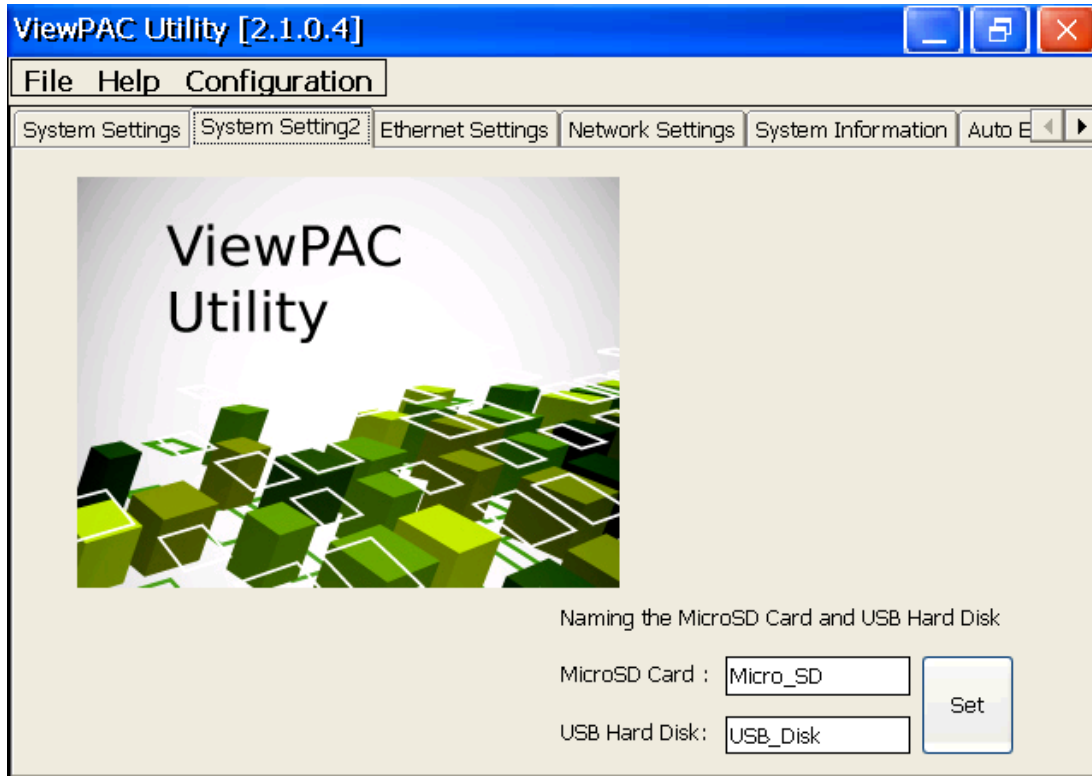

The tab use to	How to use
Set the name of the MicroSD card and the USB hard disk	Enter the name of the MicroSD card and the USB hard disk in the relevant fields, and then press the <b>Set</b> button

## Ethernet Settings Tab


The Ethernet Settings tab provides functions to configure either DHCP (Roaming) or manually configured (Static) network settings and to monitor the MAC address. Generally, DHCP is the default settings, but if you don't have a DHCP server, you must configure the network settings by using manual configuration.

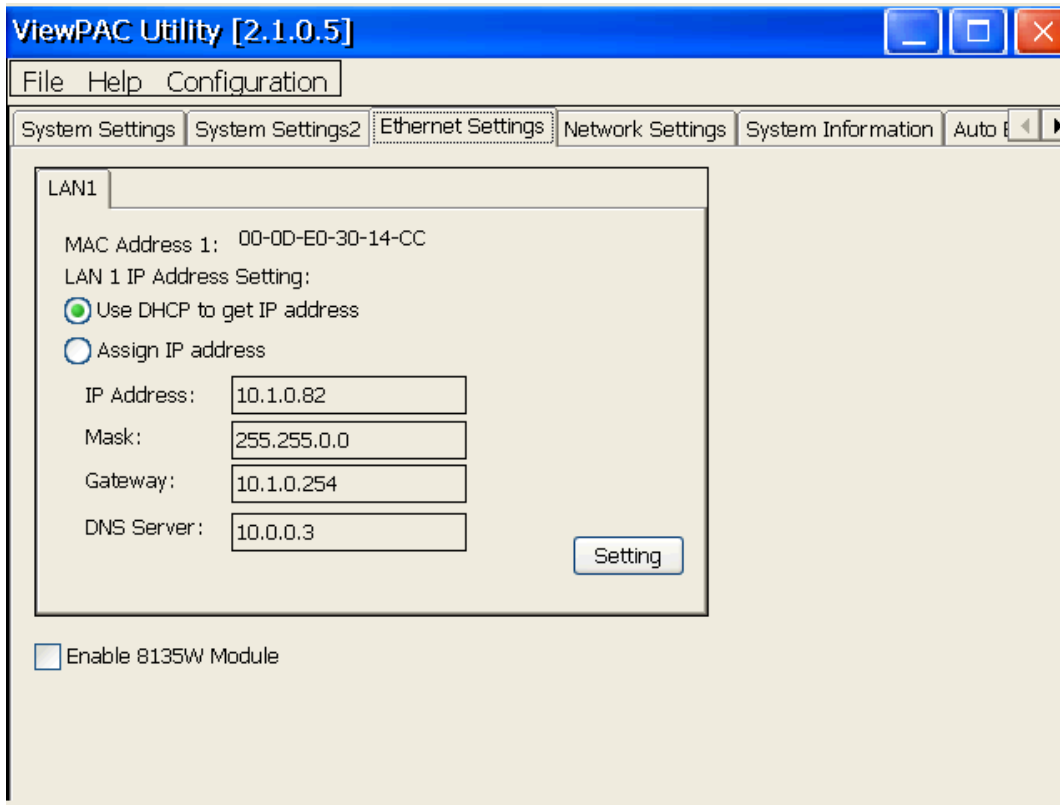

The tab use to	How to use
Configure the network settings	Obtaining an IP address automatically from DHCP: Select the <b>Use DHCP to get IP address</b> option, and then press the <b>Setting</b> button. Manually assign an IP address: Select the <b>Assign IP address</b> option, and then press the <b>Setting</b> button.
Monitor the MAC address	See the <b>MAC Address 1</b> fields that display the physical address of LAN1.
Set up the i-8135 Ethernet module driver	See the next page.

## 8135 tab

This tab provides functions to set up the i-8135 Ethernet module driver.

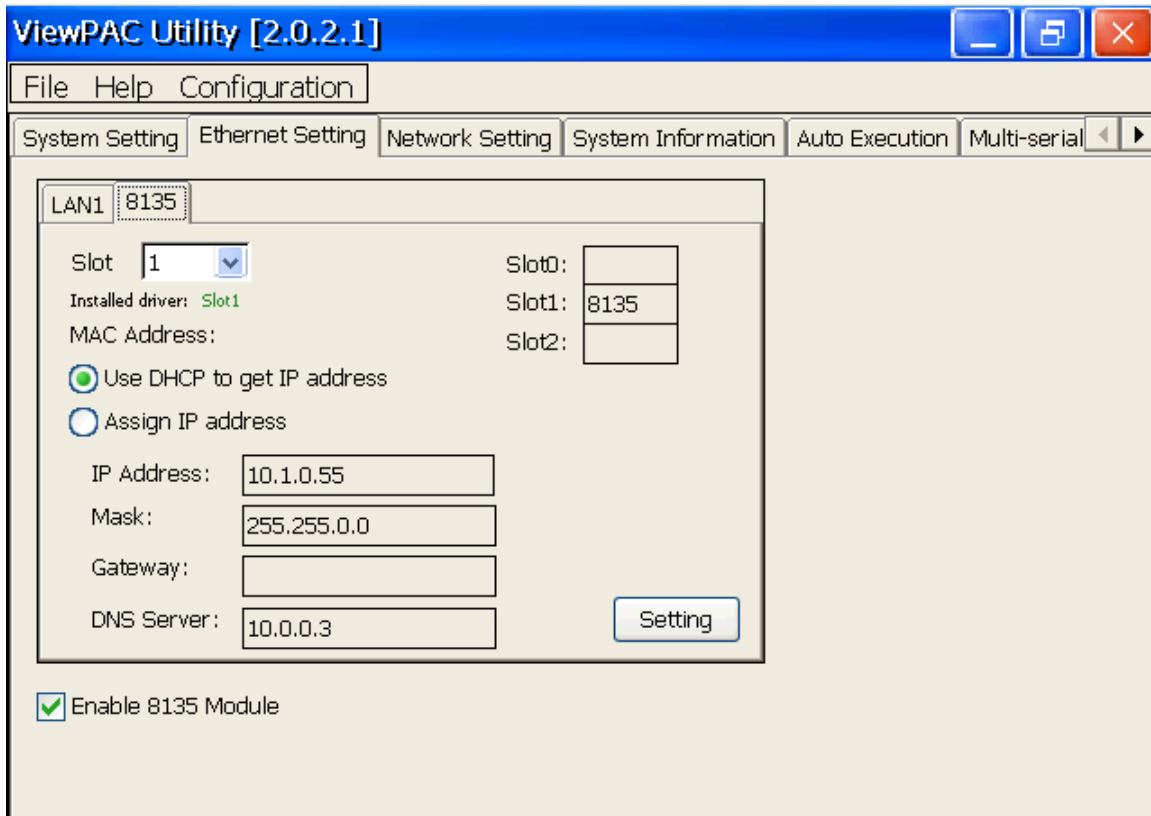


The tab use to	How to use
Set up the i-8135 network settings	Obtaining an IP address automatically from DHCP: Select the <b>Use DHCP to get IP address</b> option, and then press the <b>Setting</b> button. Manually assign an IP address: Select the <b>Assign IP address</b> option, and then press the <b>Setting</b> button.

## Network Settings Tab

The Network Settings tab includes three tabs, FTP Settings, HTTP directory path, Users and Passwords and File Server Settings.


The FTP settings tab provides functions to enable/disable the FTP access, enable/disable anonymous FTP access, and configure the FTP directory path.

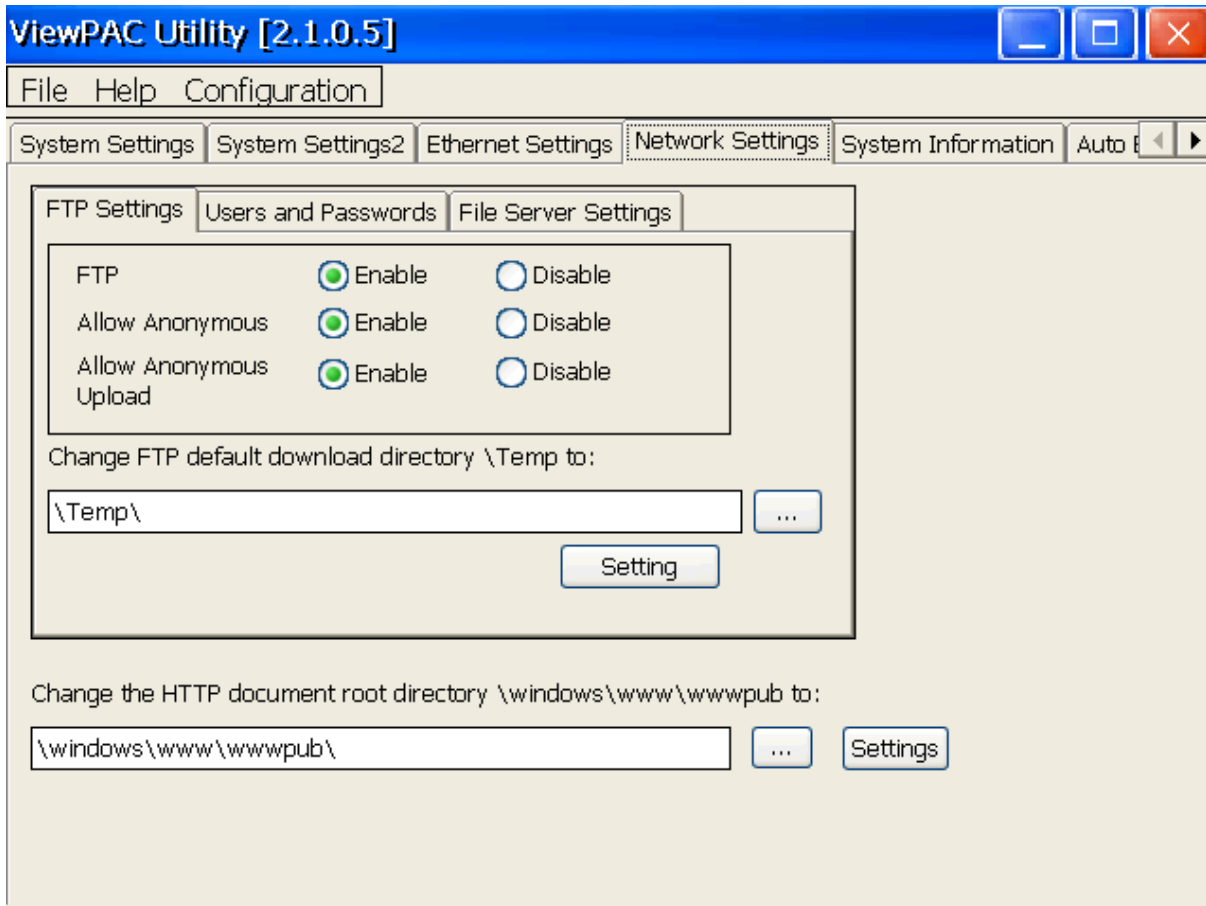

The tab use to	How to use
Change the HTTP directory path	Enter a new path in the <b>Change HTTP document root directory</b> <b>\windows\www\wwwsub to</b> field, and then press the <b>Setting</b> button.

## FTP Settings tab

This tab provides functions to enable/disable the FTP access, enable/disable anonymous FTP access, and configure the FTP directory path.

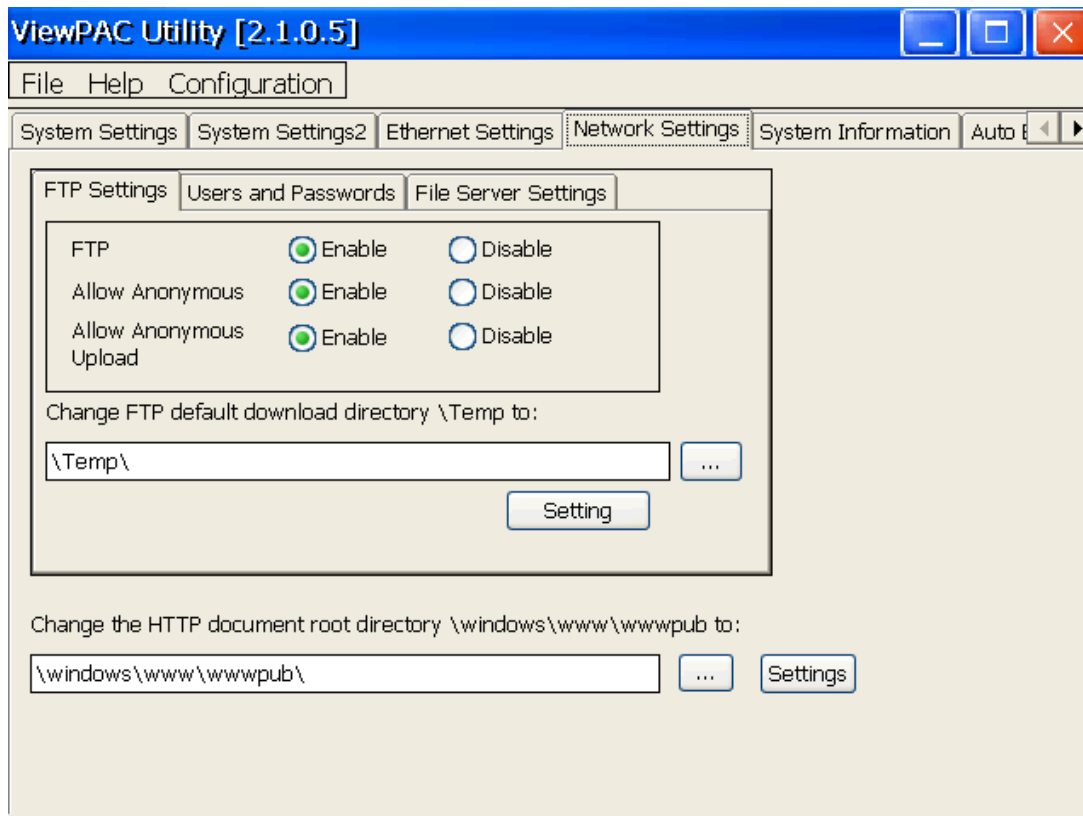


The tab use to	How to use
Enable or disable the FTP access	Enable: Select the Enable check box in the FTP field. Disable: Select the Disable check box in the FTP field.
Enable or disable anonymous FTP access	Enable: Select the Enable check box in the Allow Anonymous field. Disable: Select the Disable check box in the Allow Anonymous field.
Enable or disable anonymous FTP upload	Enable: Select the Enable check box in the Allow Anonymous Upload field. Disable: Select the Disable check box in the Allow Anonymous Upload field.
Change the FTP directory path	Enter a new path in the Change FTP default download directory field, and then press the Setting button.

## Users and Passwords tab

---

This tab provides functions to maintain the FTP accounts.

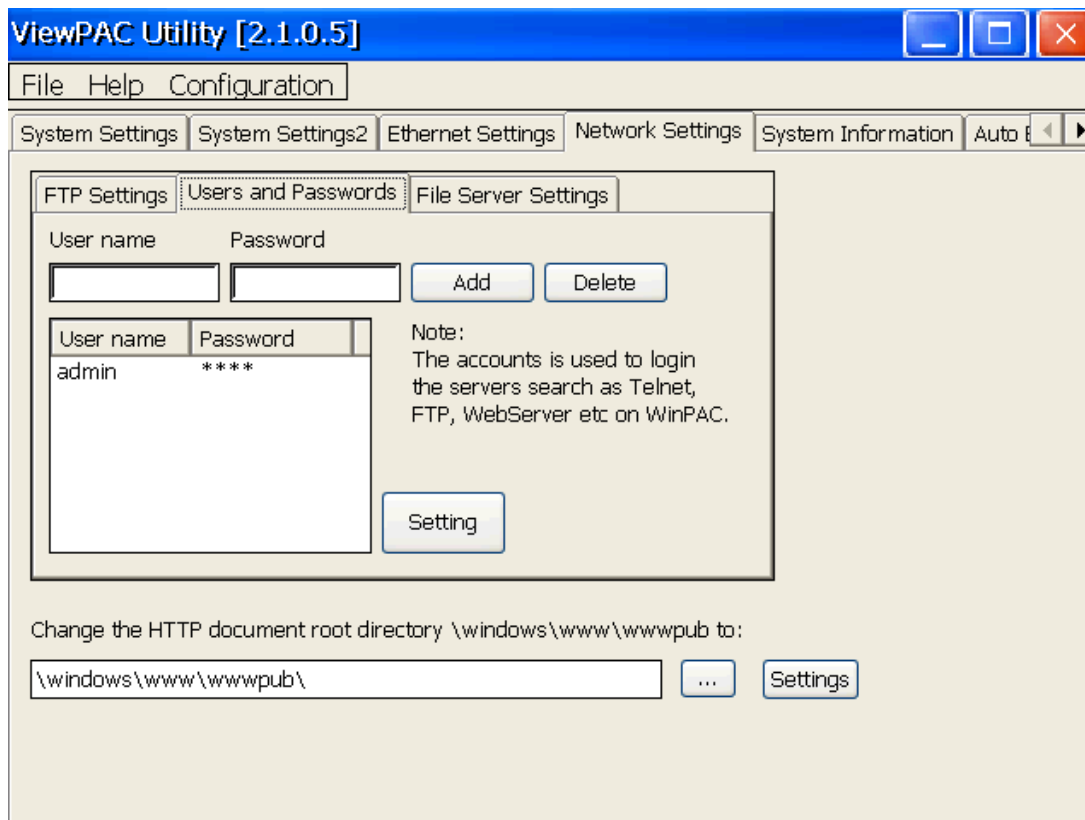

The tab use to	How to use
Maintain the FTP accounts	Refer to the Appendix C.1 How to add a user account to remote login the ViewPAC from PC.


Please refer the document “[w2-022\\_how\\_to\\_configure\\_the\\_File\(SMB\)\\_Server](#)” to use the [File Server Settings](#) tab.



## System Information Tab

---

The System Information tab provides functions to monitor necessary system information of the ViewPAC. The system information is the most important note of version control for upgrading system.

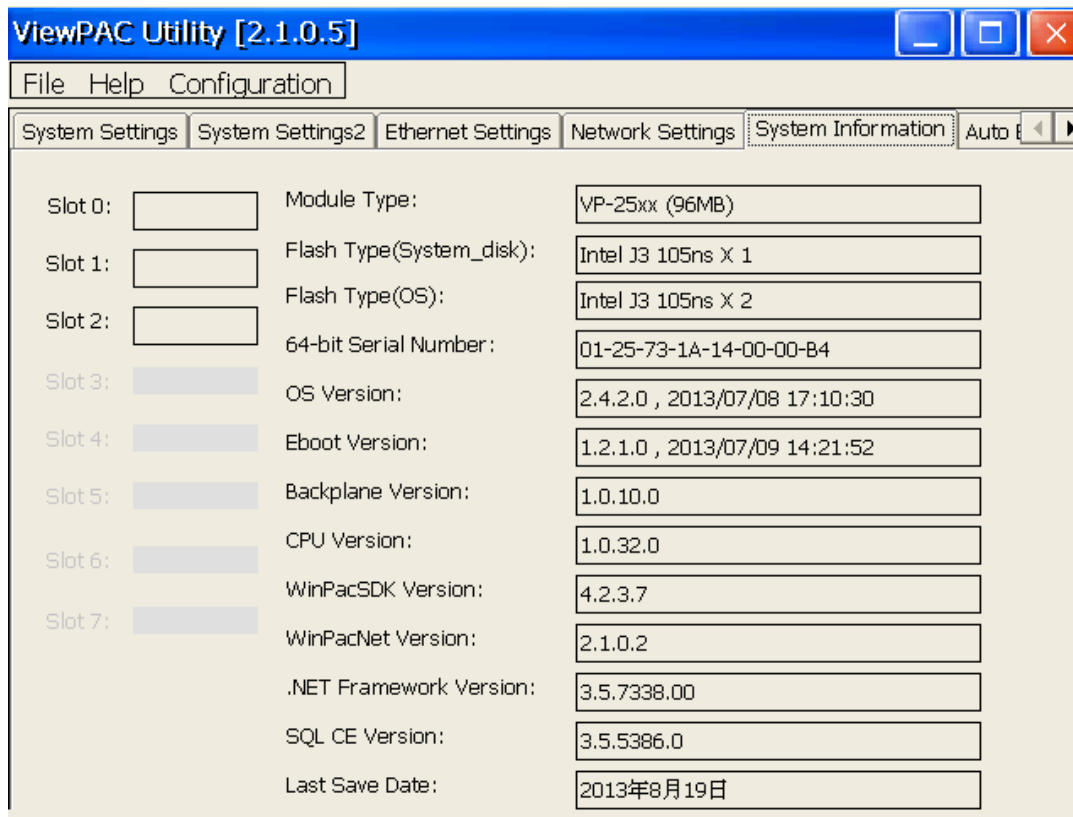

Slot	Module Type	Flash Type(System_disk)	Flash Type(OS)	64-bit Serial Number	OS Version	Eboot Version	Backplane Version	CPU Version	WinPacSDK Version	WinPacNet Version	.NET Framework Version	SQL CE Version	Last Save Date
Slot 0:	VP-25xx (96MB)	Intel J3 105ns X 1	Intel J3 105ns X 2	01-25-73-1A-14-00-00-B4	2.4.2.0 , 2013/07/08 17:10:30	1.2.1.0 , 2013/07/09 14:21:52	1.0.10.0	1.0.32.0	4.2.3.7	2.1.0.2	3.5.7338.00	3.5.5386.0	2013年8月19日
Slot 1:													
Slot 2:													
Slot 3:													
Slot 4:													
Slot 5:													
Slot 6:													
Slot 7:													

## Auto Execution Tab

---

The Auto Execute tab provides functions to configure programs running at ViewPAC startup, it allows users to configure ten execute files at most.


### Tips & Warnings

---



The allowed file types are .exe and .bat, and they are executed in order of program 1, program 2, etc.

---

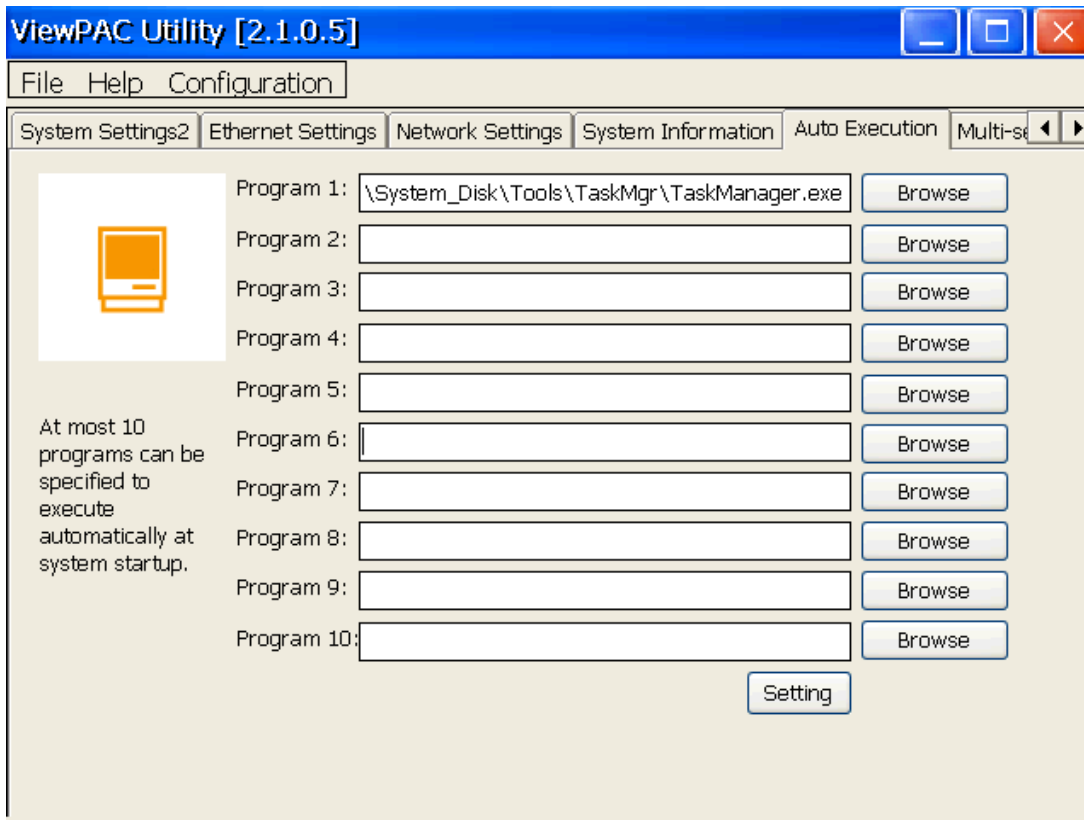

The tab use to	How to use
Configure programs running at startup	Press the <b>Browse</b> button to select the execute file which you want, and then press the <b>Setting</b> button.

## Multi-Serial Port Wizard Tab



The Multi-serial port provides functions for installation of the RS-232/RS-422/RS-485 communication module driver.




The table below shows the expansion RS-232/RS-422/RS-485 communication modules that are compatible with the ViewPAC.

Item	RS-232	RS-422/RS-485	Isolation	Connector
I-8112iW	2	-	2500 Vrms	DB-9 x 2
I-8114W	4	-	-	DB-37 x 1
I-8114iW	4	-	2500 Vrms	DB-37 x 1
I-8142iW	-	2	2500 Vrms	Terminator block x 1
I-8144iW	-	4	2500 Vrms	Terminator block x 1

The ViewPAC can be expanded to support up to 16 I/O modules.

For more detailed information about these support modules, please refer to

[http://www.icpdas.com/products/Remote\\_IO/i-8ke/selection\\_rs232\\_i8k.htm](http://www.icpdas.com/products/Remote_IO/i-8ke/selection_rs232_i8k.htm)

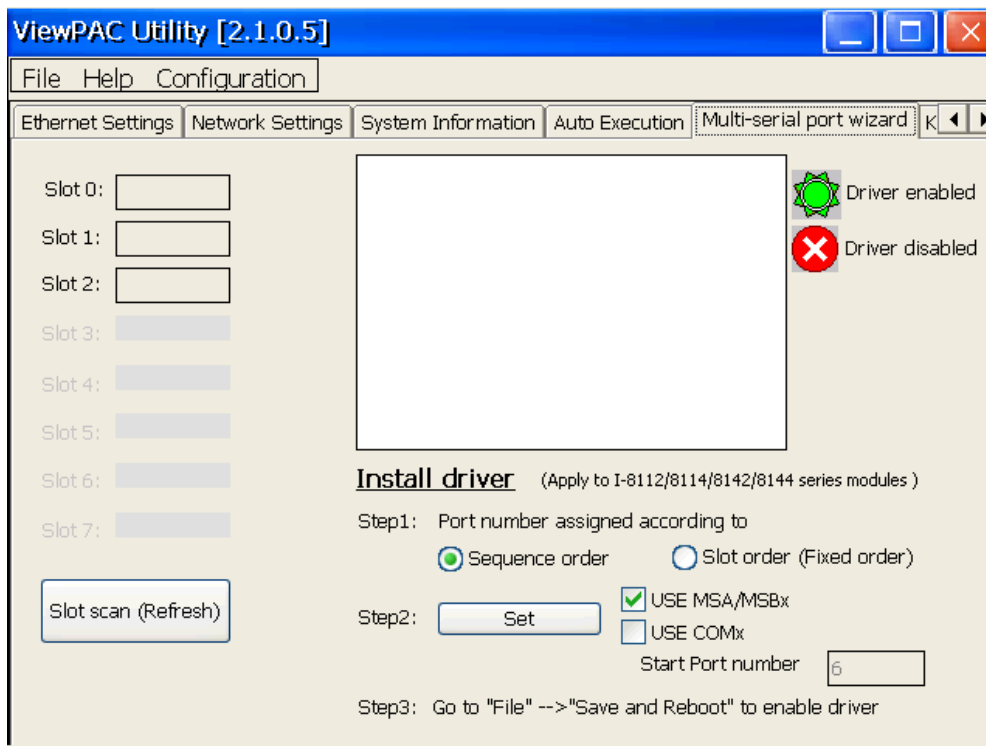


## Key Property Tab (for VP-23W1/VP-25W1 only)

The Key Property tab provides functions to specify the programmable key to launch any program that you wish.

### Tips & Warnings




The allowed file types are .exe and .bat.

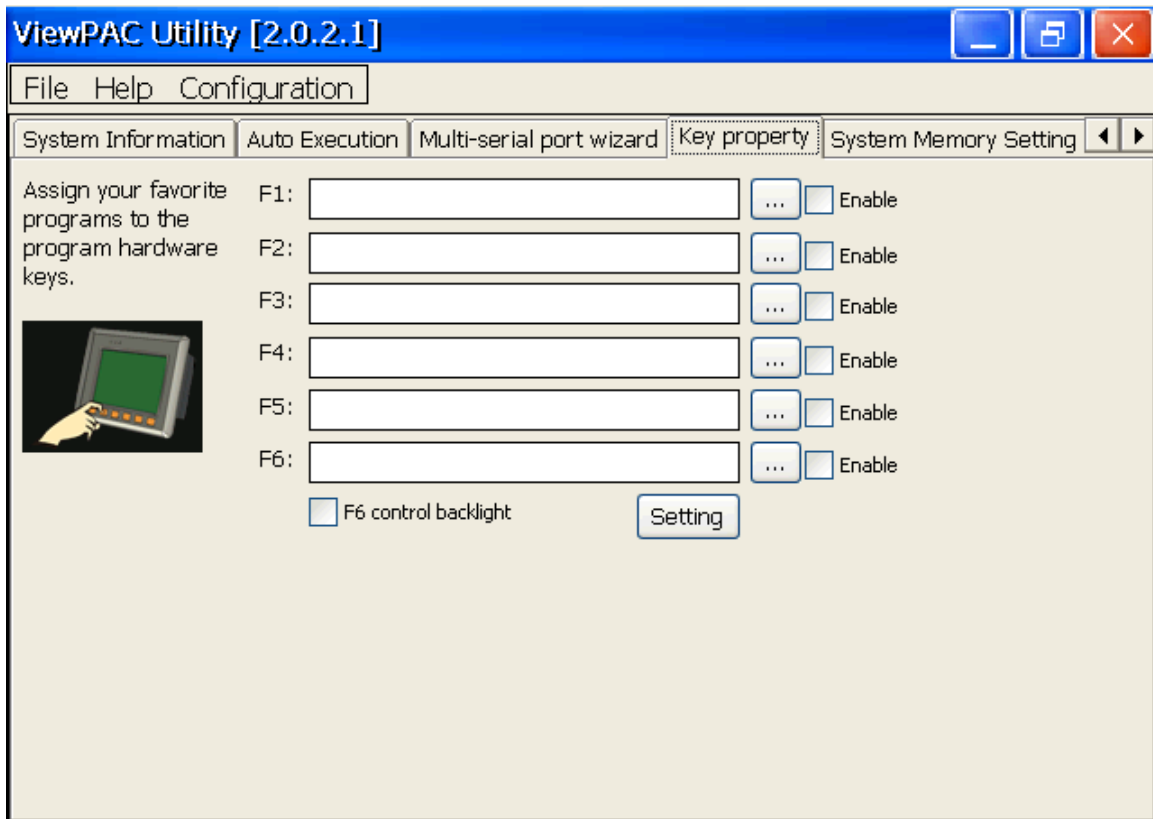

The tab use to	How to use
Specify the programmable key to launch the program	Press the ... button to select the execute file which you want, select the <b>Enable</b> check box, and then press the <b>Setting</b> button.
Specify the programmable key to control backlight	Select the <b>F6 control backlight</b> check box, and then press the <b>Setting</b> button.

## System Memory Tab

The SRAM Setting tab provides functions to adjust and monitor the unused RAM.

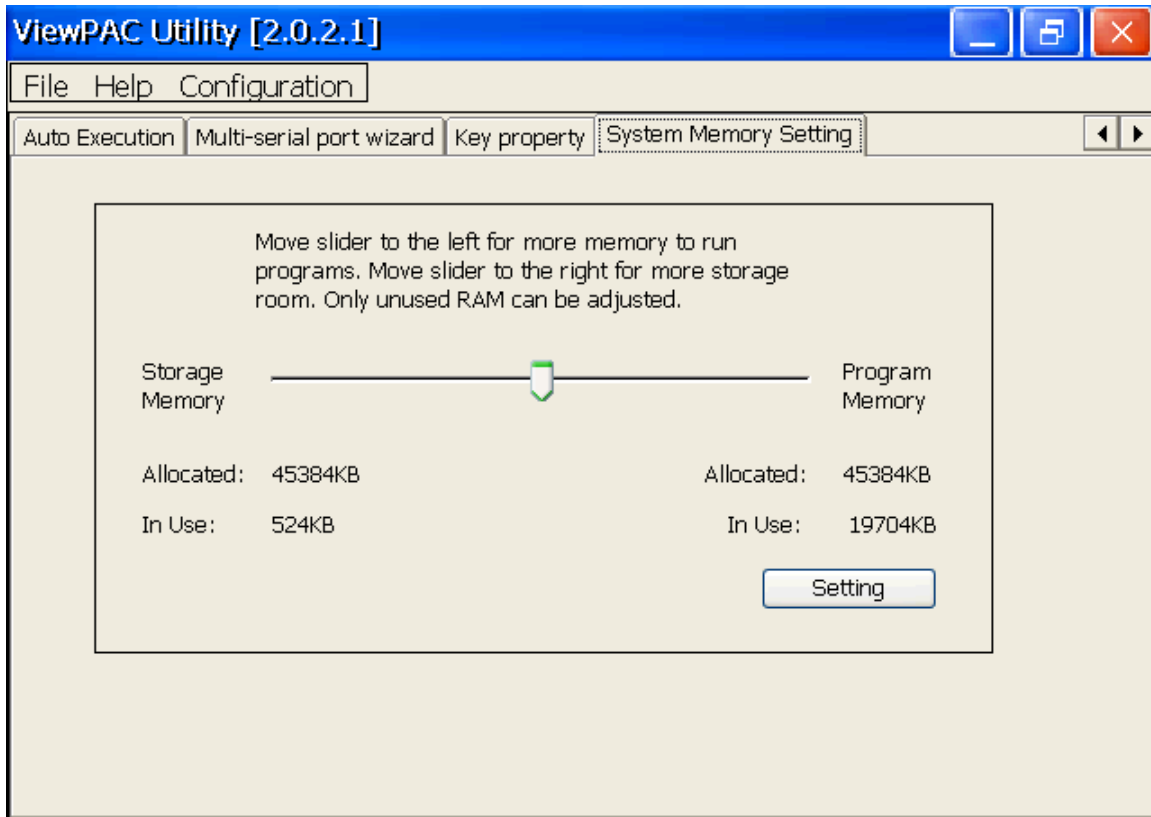

The tab use to	How to use
Adjust display	Move the slider left to release more memory running programs or move the slider right to release more storage room, and then press the Setting button

# 4. Your First ViewPAC Program

This chapter describes the components of the ViewPAC SDK, and provides step by step tutorial for developer that will teach you how to create your first ViewPAC program.

Before writing your first program, ensure that you have the necessary development tools and the corresponding ViewPAC SDKs are installed on your system.

## 4.1. Preparing the Development Tools

There are several programming tools available for application developers targeting Windows CE-based ViewPAC. One of the following tools must be installed on the Host PC.

- ✓ Microsoft eMbedded Visual C++
- ✓ Visual Basic.net
- ✓ Visual C#

## 4.2. Installing ViewPAC Platform SDKs

The ViewPAC Platform SDK is a Software Development Kit (SDK) that contains C header files, C libraries and documents.

**Below is a step by step procedure for installing the ViewPAC Platform SDKs.**

**Step 1: Insert the CD into your CD-ROM drive**

**Step 2: Execute the “PAC270\_SDK\_YYYYMMDD.msi” which is located in**

CD:\Napdos\wp-8x4x\_ce50\SDK\

The installation program for the latest version of the WinPAC Platform SDKs can be obtained from:

[http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/sdk/](http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/sdk/)

File name: pac270\_sdk\_yyyymmdd.msi

yyymmdd: Platform SDK released date

### Tips & Warnings

---



The released date of the installation program SDK installation package that provides the PACSDK library must be later than or equal to 2012/10/15, such as PAC270\_SDK\_20121015.msi

---

**Step 3: Follow the prompts until the installation is complete**

## 4.3. Understanding the ViewPAC APIs

The ViewPAC SDKs includes several application programming interfaces (APIs) that allows you perform various supporting tasks when developing ViewPAC.

### ► Requirements

The ViewPAC SDK supports NET Compact Framework 2.0/3.5.

### ► Installation Path

After installing the ViewPAC SDKs, a number of functions can be installed on the Host PC, and this installation puts the header files, libraries into the following public places so they are easily changed by update the ViewPAC SDKs.

#### **Header files:**

C:\Program Files\Windows CE Tools\wce500\PAC270\Icpdas\Include\ARMV4\


#### **Libraries:**

C:\Program Files\Windows CE Tools\wce500\PAC270\Icpdas\Lib\ARMV4\



## 4.3.1. ViewPAC SDK Overview

### 4.3.1.1. WinPAC Standard API

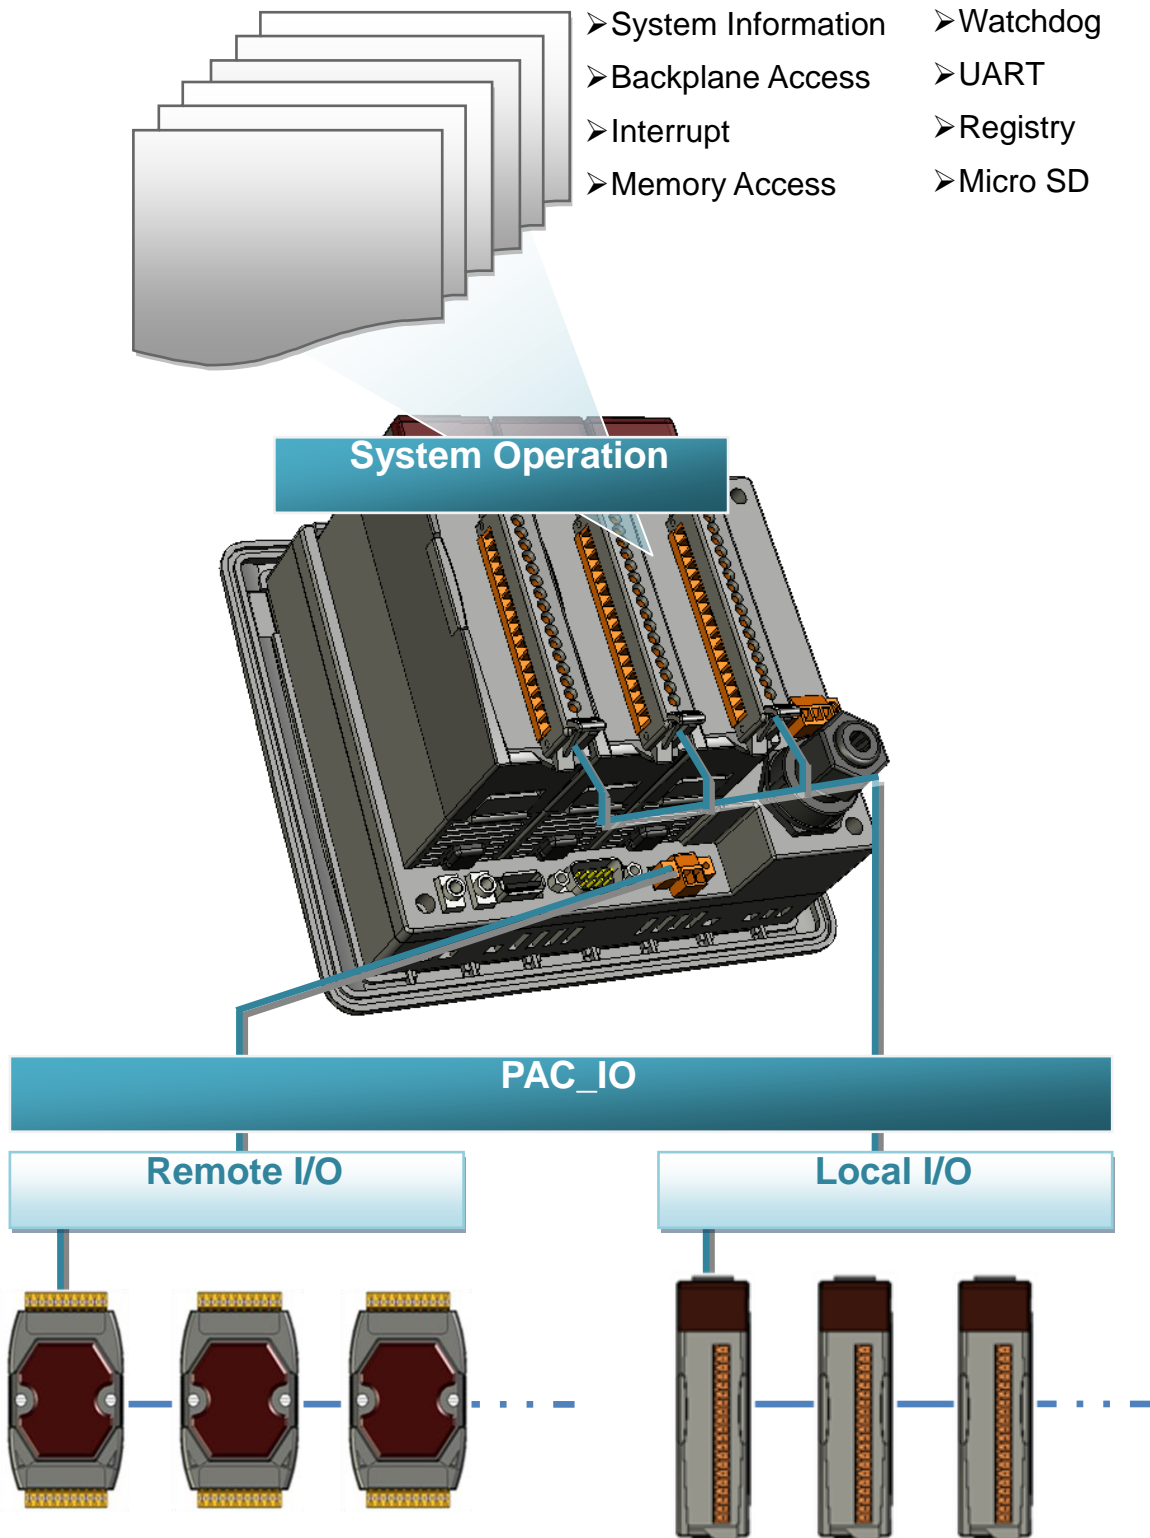

- **SystemInformation Functions**

Provides reference information for the system status.

- **Backplane Access API**

Provides reference information for the backplane access APIs, including Hot Plug and backplane information.

- **Interrupt API**

Provides reference information for the Interrupt APIs

- **Memory Access API**

Provides reference information for the memory R/W APIs, including EEPROM and SRAM.

- **Watchdog Functions**

Provides reference information for the watchdog APIs, including hardware watchdog and OS watchdog.

- **UART API**

Provides reference information for the UART APIs.

- **Registry API**

Provides reference information for the registry.

- **microSD Management API**

Provides reference information for the microSD Manager.

- **PAC\_IO API**


Provides reference information for IO APIs, including local and remote.

In additions, no matter 8K or 87K modules use the same API.

- **Error Handling API**

Provides reference information for error handling.

### 4.3.1.2. ViewPAC Particular API

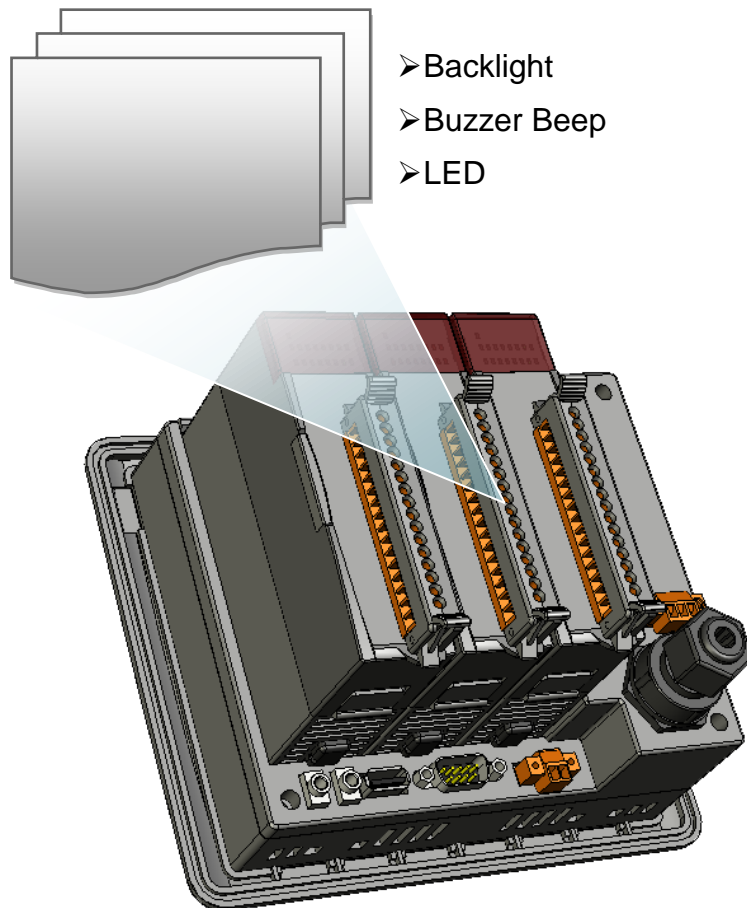

- **Backlight Functions**

Provides reference information for the backlight.

- **Buzzer Beep Functions**

Provides reference information for the buzzer.

- **LED Functions**

Provides reference information for the LED


## 4.3.2. ViewPAC SDK Reference

For full usage information regarding the description, prototype and the arguments of the functions, please refer to the “WinPAC Standard API Manual” and “ViewPAC Particular API Manual” located at:


CD:\Napdos\vp-2000\_ce50\Document\SDK\_Document\

[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/document/sdk\\_document/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/document/sdk_document/)

### ✓ WinPAC Standard API Manual

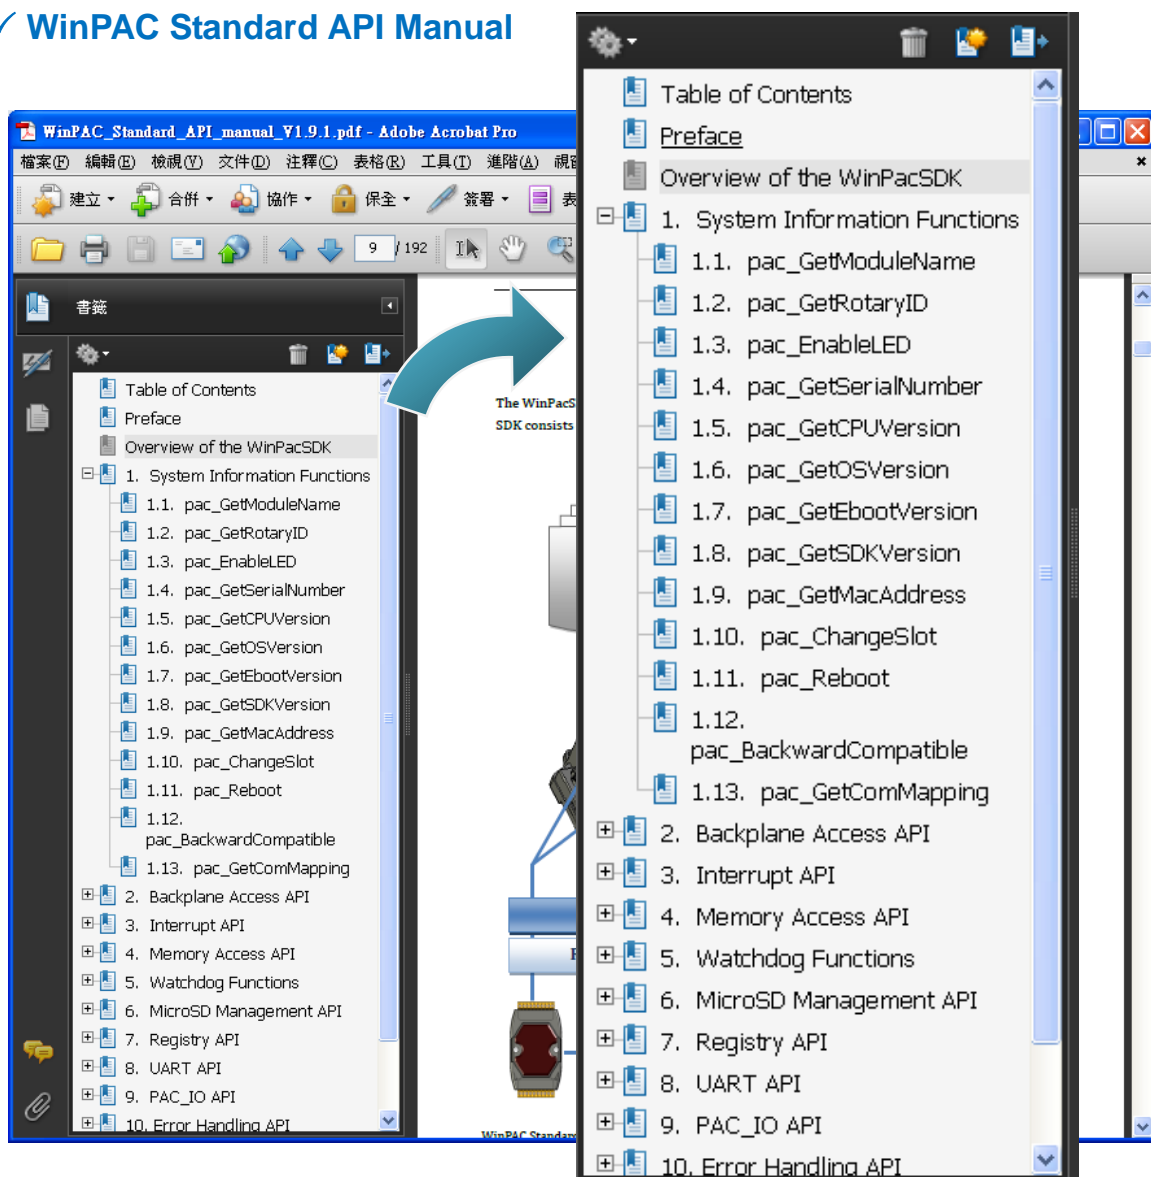

## ✓ ViewPAC Particular API Manual

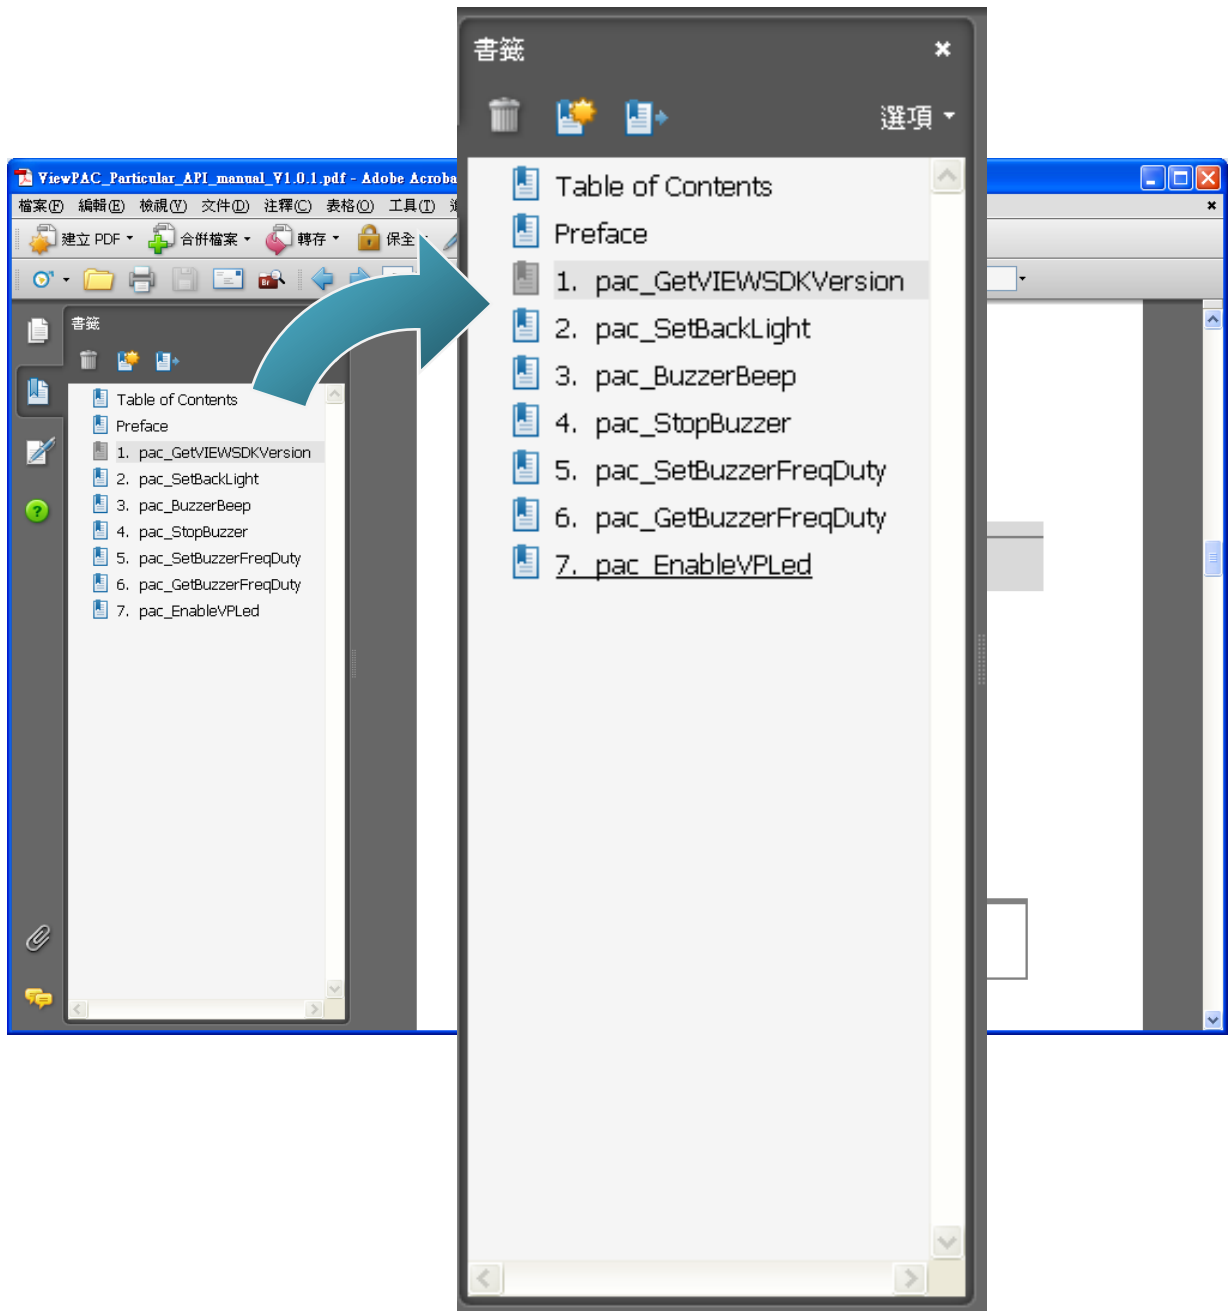

## 4.4. Your First Program in C#

To create a demo program with C# development tool includes the following main steps:


1. Create a new project
2. Add project reference for an application
3. Design and Build an application program
4. Execute the application on the ViewPAC

All main steps will be described in the following subsection.

## 4.4.1. Create a new project


Step 1: Start the Visual Studio 2005/2008

Step 2: On the “File” menu, select the “New” command, and then click the “Project” command

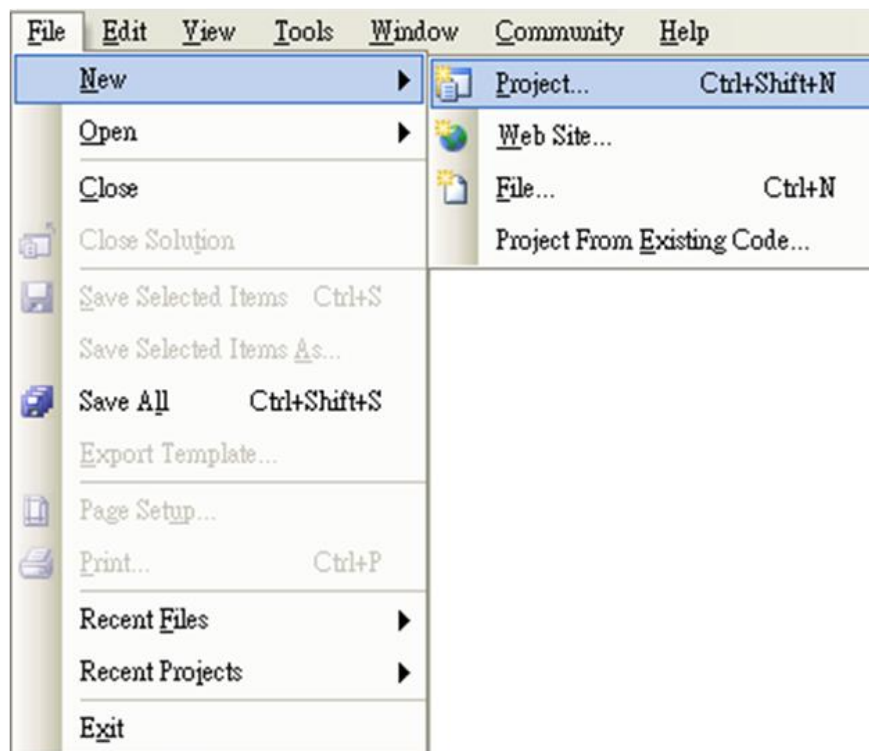




Step 3: In the “New Project” dialog box do the following in this order

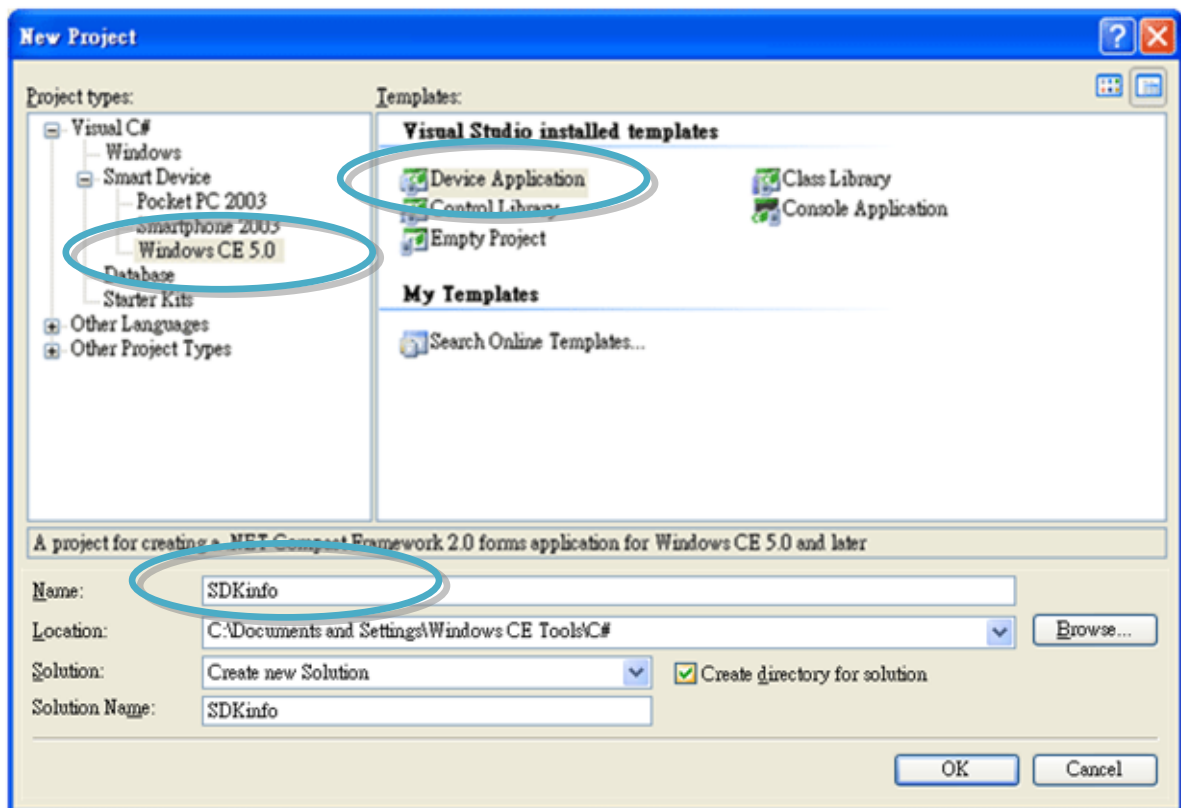

Step 4: Click OK to start creating an “SDKInfo” project

## 4.4.2. Add project reference for an application

**Step 1:** On the “Solution Explorer” window, right-click the “References” and then click the “Add Reference...” command

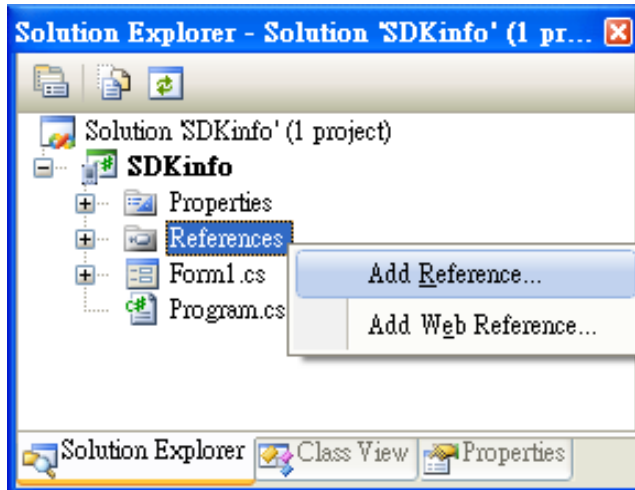

**Step 2:** In the “Add Reference” dialog box, select the “Browse” tab, and then specify the directory of the “ViewPacNet.dll” and “PACNET.dll” file in the “File name” field

The “PACNET.dll” file can be obtained from:


CD:\Napdos\wp-8x4x\_ce50\SDK\WinPacNet\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/sdk/winpacnet/](http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/sdk/winpacnet/)

The “ViewPACnet.dll” file can be obtained from:

CD:\Napdos\vp-2000\_ce50\SDK\ViewPACNet\


[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/sdk/ViewPACnet/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/sdk/ViewPACnet/)

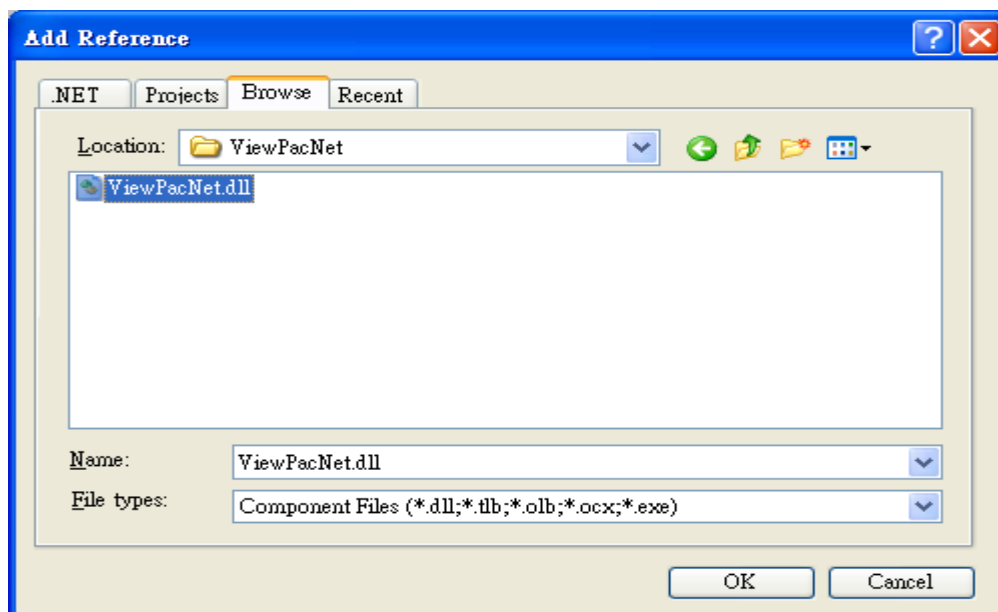


### 4.4.3. Design and Build an application program

Step 1: Add a  Button “button” object in the “Form1” dialog box


Step 2: Right-click the “button” object and click the “Properties” command

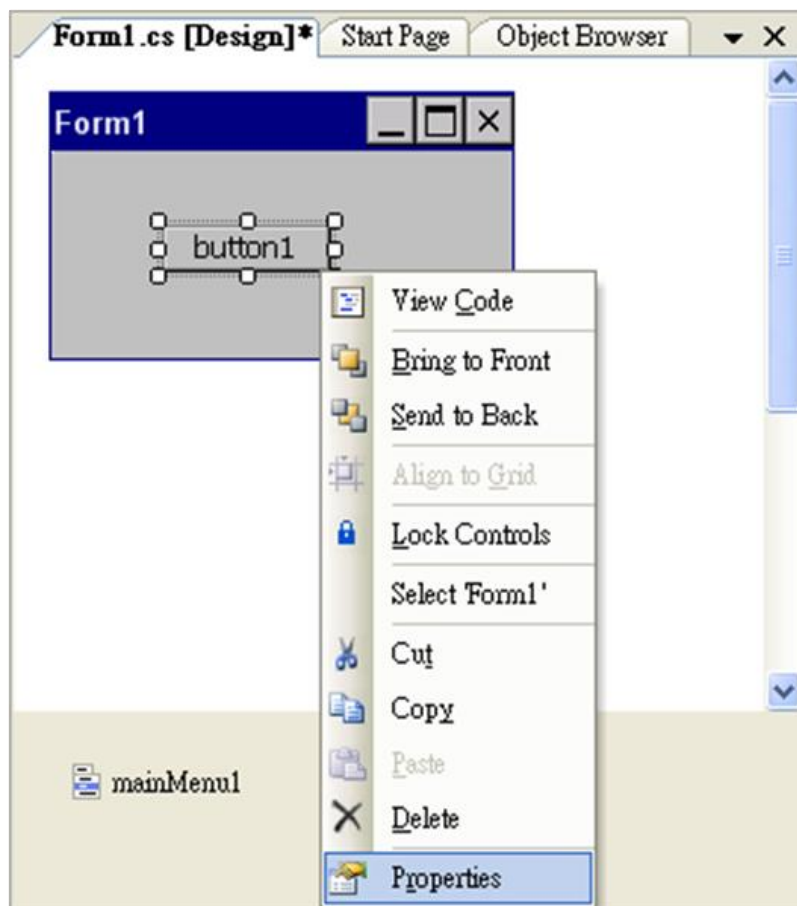

**Step 3: On the “Properties” window, type “Check the SDK version” in the “Text” edit box**

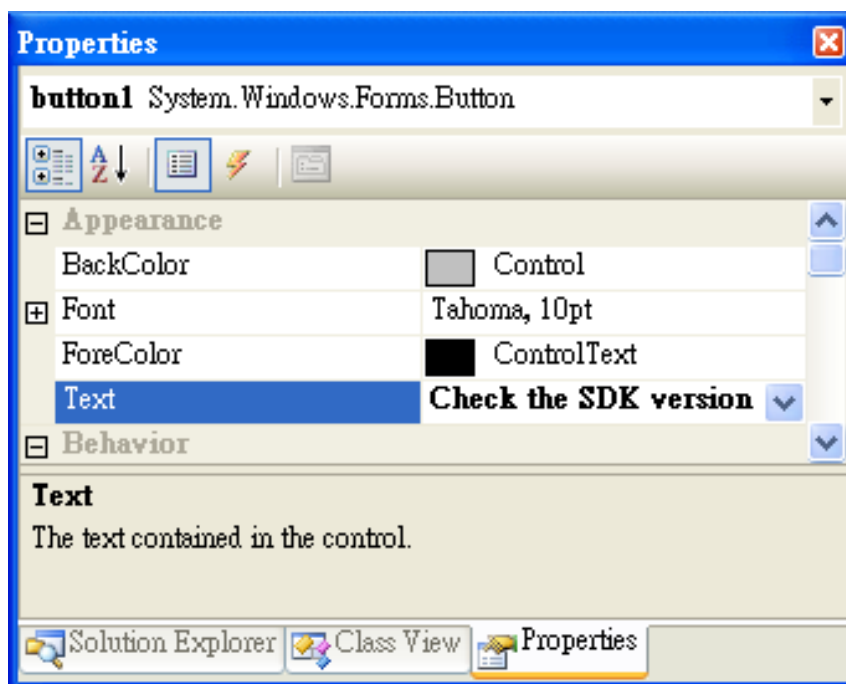

**Step 4: Right-click the “Form1” dialog box and click the “View Code” command to open the editor window**

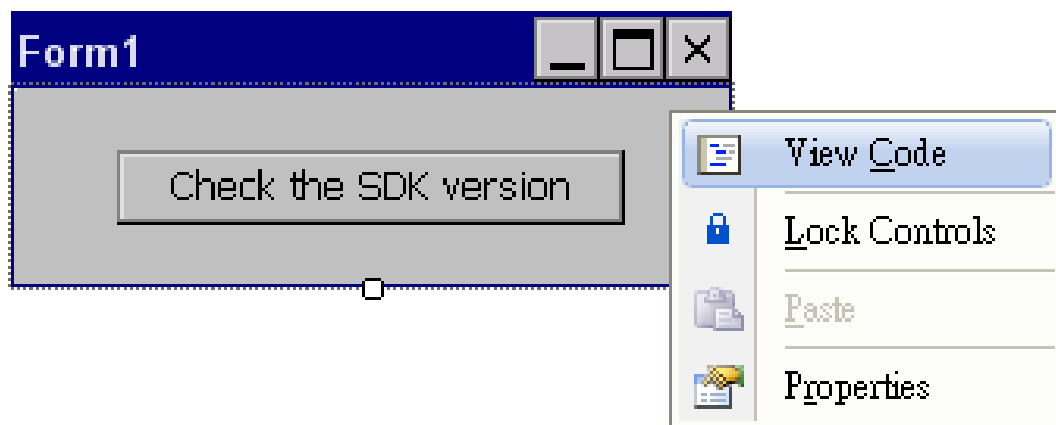

**Step 5: Insert the “using ViewPACNet;” into the header area after “using System.Windows.Forms;”**

```
using System;
using System.Linq;
using System.Collections.Generic;
using System.ComponentModel;
using System.Data;
using System.Drawing;
using System.Text;
using System.Windows.Forms;
using ViewPACNet;

namespace SDKInfo
{
    public partial class Form1 : Form
    {
        public Form1()
        {
            InitializeComponent();
        }
    }
}
```

**Step 6: In the “Form1” dialog box, double-click the “button” object to open the editor window**




**Step 7: Insert the following code in the Editor Window**

```
MessageBox.Show(pac_GetVIEWSDKVersion());
```


```
namespace SDKinfo
{
    public partial class Form1 : Form
    {
        public Form1()
        {
            InitializeComponent();
        }

        private void button1_Click(object sender, EventArgs e)
        {
            MessageBox.Show(ViewPAC.pac_GetVIEWSDKVersion());
        }
    }
}
```



#### 4.4.4. Execute the application on the ViewPAC

Step 1: On the “Build” menu, click the “Build Solution” command

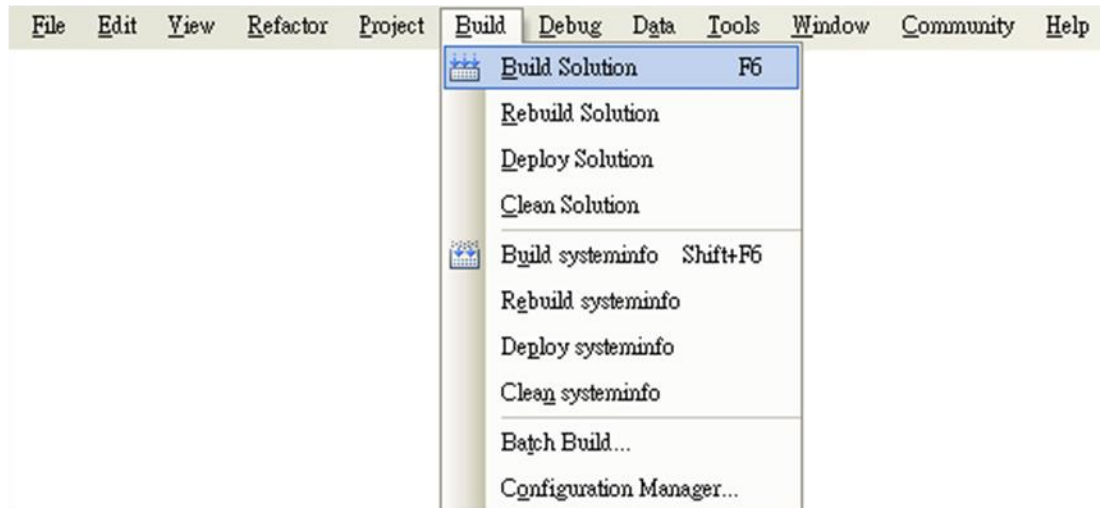

Step 2: Open the web browser and type the IP address to connect the FTP server of ViewPAC


Step 3: Upload the “SDKinfo.exe” application and the corresponding “ViewPacNet.dll” file to the ViewPAC via the ViewPAC FTP server

## Tips & Warnings

---



For applications programming in C# and VB.net with .net framework, when executing these application on the ViewPAC controller, the corresponding “ViewPACnet.dll” file must be in the same directory as the .exe file

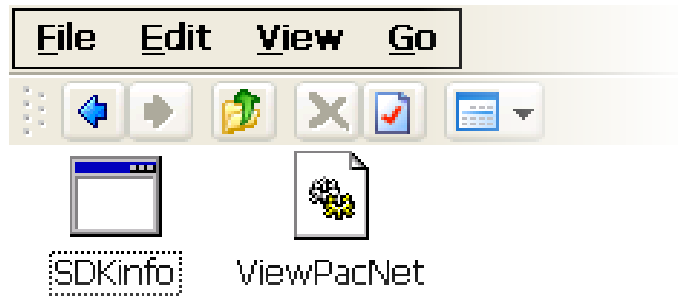

---

**Step 4: On the ViewPAC, execute the uploaded file**





## 4.5. Your First Program in VB.net

To create a demo program with C# development tool includes the following main steps:


1. Create a new project
2. Add project reference for an application
3. Design and Build an application program
4. Execute the application on the ViewPAC

All main steps will be described in the following subsection.


## 4.5.1. Create a new project

Step 1: Start the Visual Studio 2005/2008

Step 2: On the “File” menu, select the “New” command, and then click the “Project” command

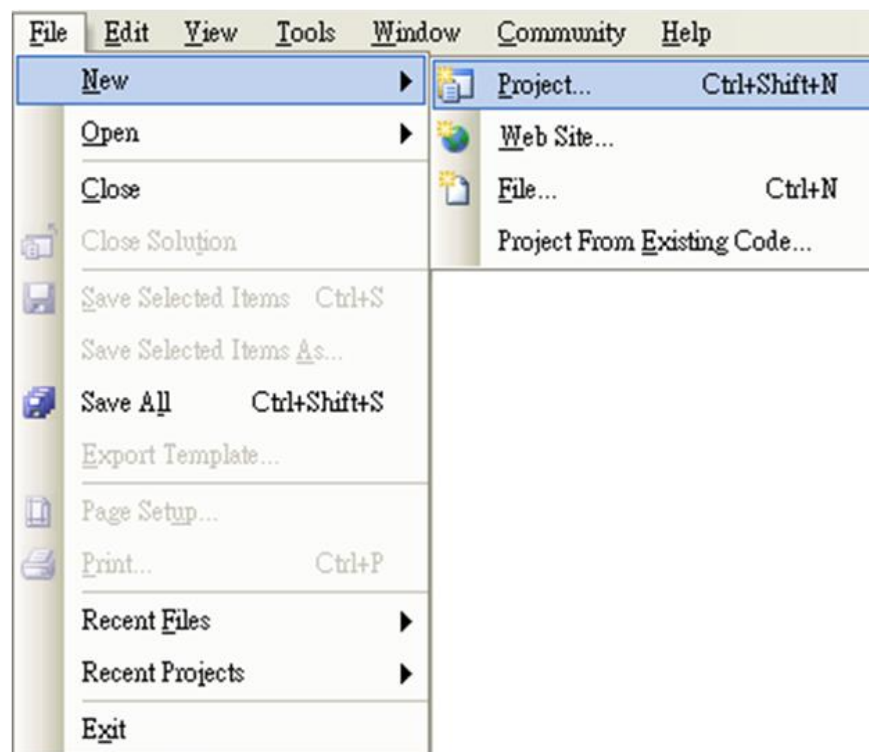


Step 3: In the “New Project” dialog box do the following in this order

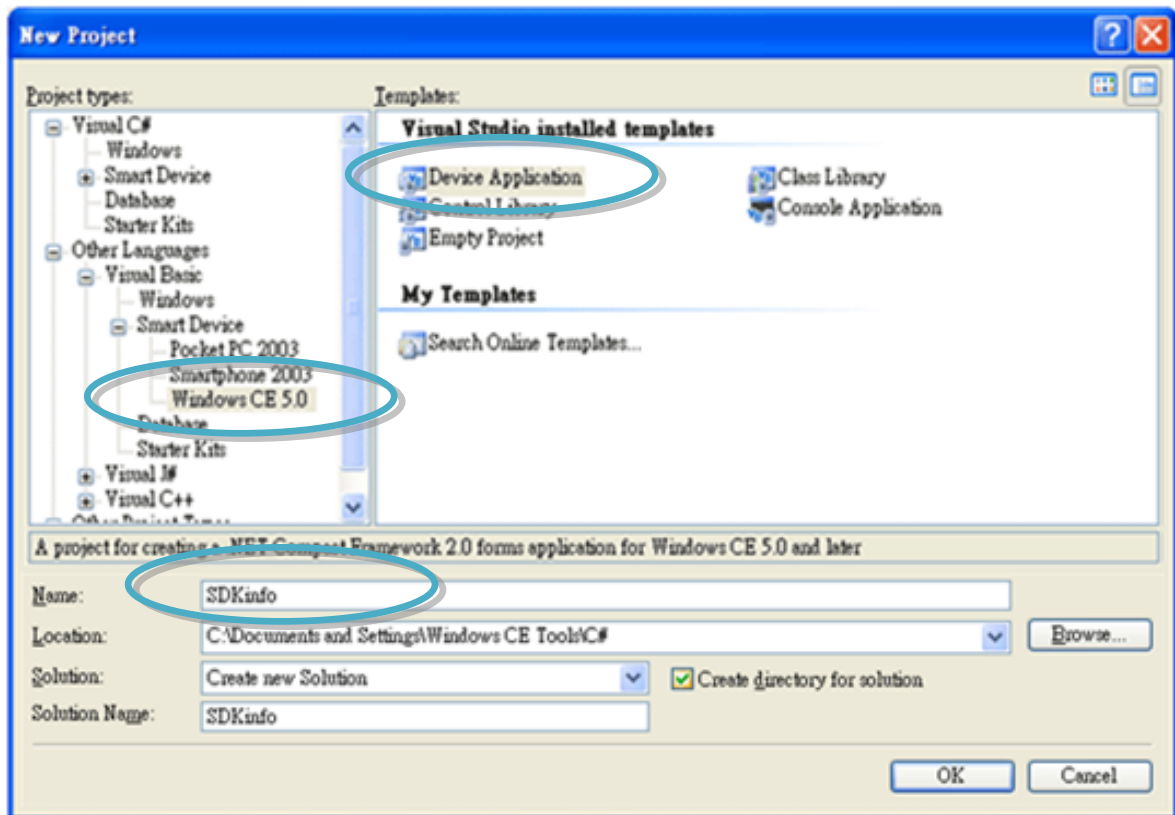

Step 4: Click OK to start creating an “SDKInfo” project

## 4.5.2. Add project reference for an application

**Step 1:** On the “Class View” window, right-click the “Reference” and then click the “Add Reference...” command

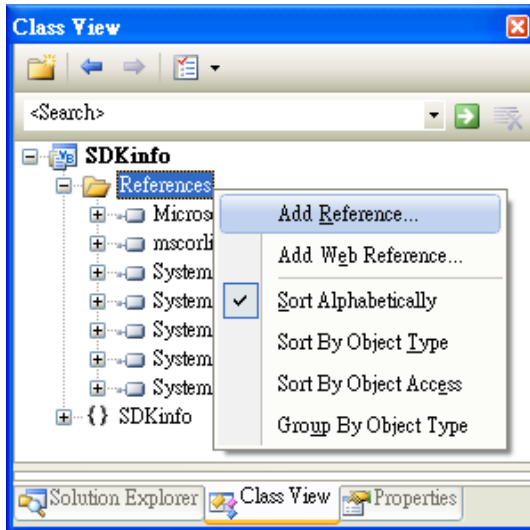

**Step 2:** In the “Add Reference” dialog box, select the “Browse” tab, and then specify the directory of the “ViewPACNet.dll” and “PACNET.dll” file in the “File name” field

The “PACNET.dll” file can be obtained from:


CD:\Napdos\wp-8x4x\_ce50\SDK\WinPacNet\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/sdk/winpacnet/](http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/sdk/winpacnet/)

The “ViewPacNet.dll” file can be obtained from:

CD:\Napdos\vp-2000\_ce50\SDK\ViewPACNet\


[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/sdk/ViewPACnet/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/sdk/ViewPACnet/)

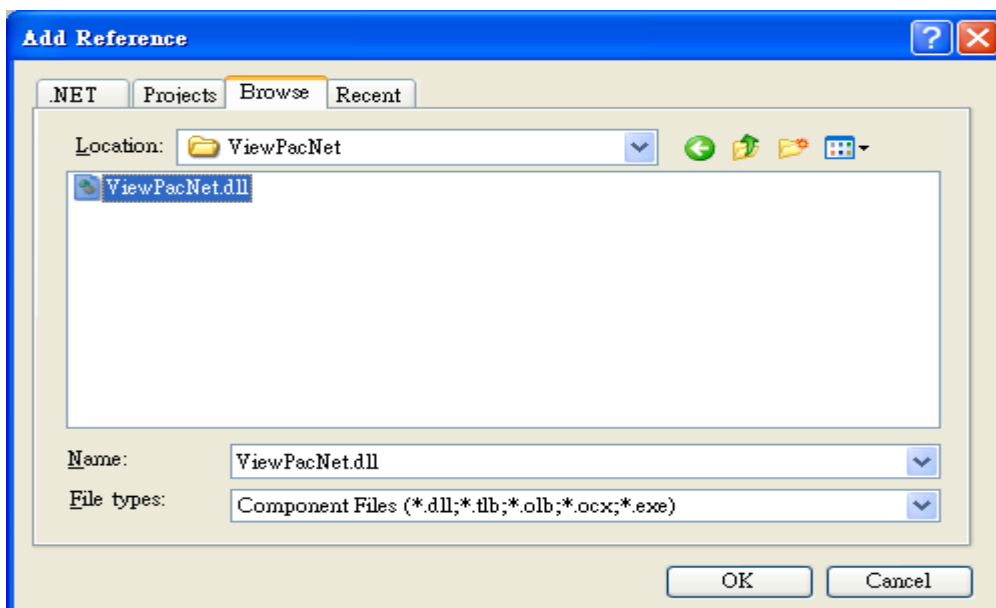


### 4.5.3. Design and Build an application program

Step 1: Add a  Button “button” object in the “Form1” dialog box

Step 2: Right-click the “button” object and click the “Properties” command

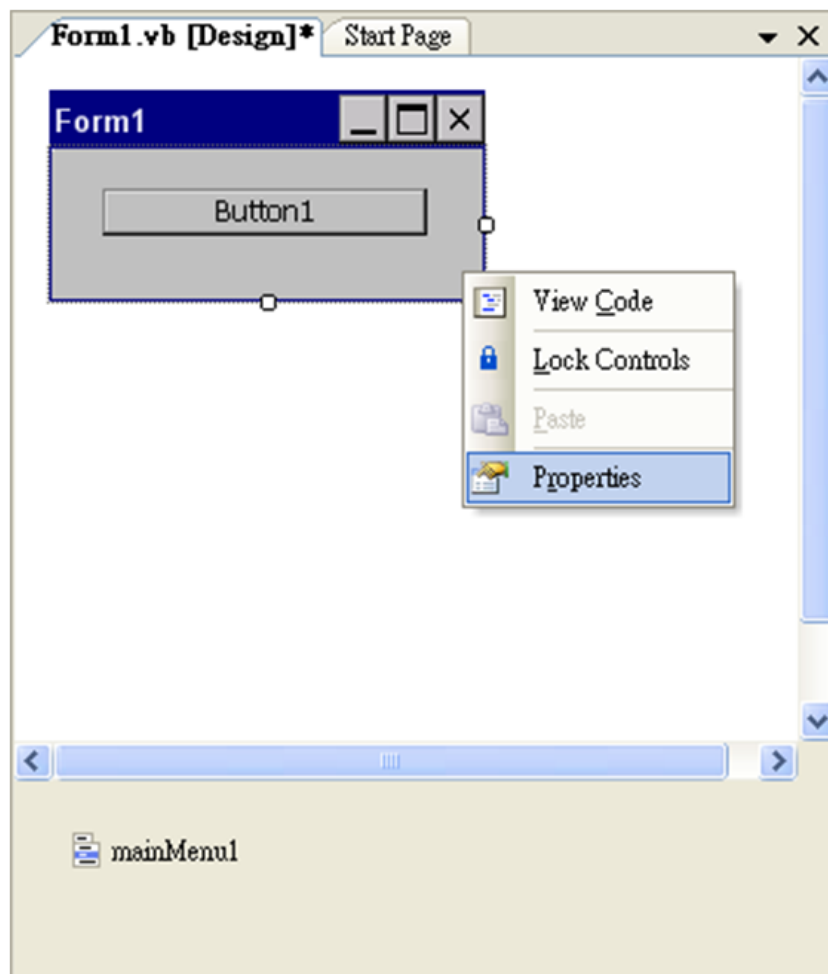

**Step 3: On the “Properties” window, type “Check the SDK version” in the “Text” edit box**

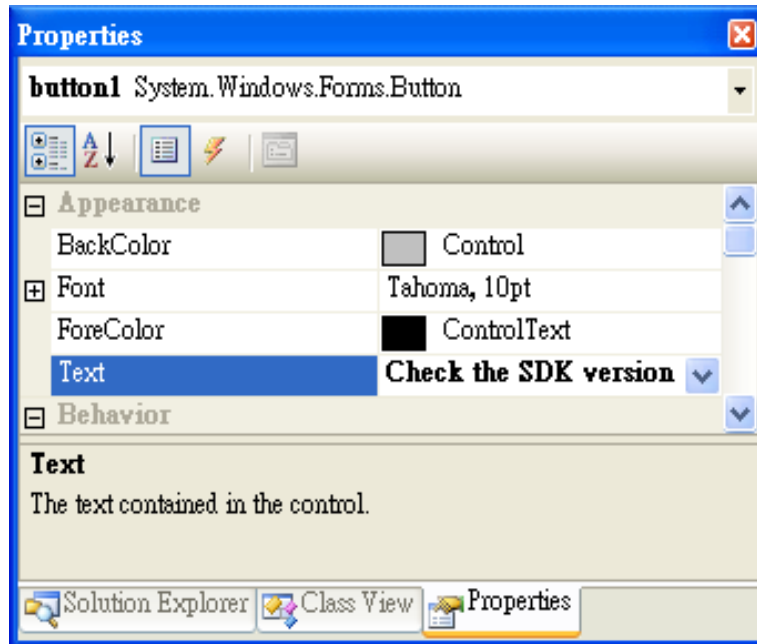


**Step 4: In the “Form1” dialog box, double-click the “button” object to open the editor window**



**Step 5: Insert the following code in the Editor Window**

1. Imports ViewPacNet
2. MessageBox(ViewPACNet.pac\_GetOSVersion())

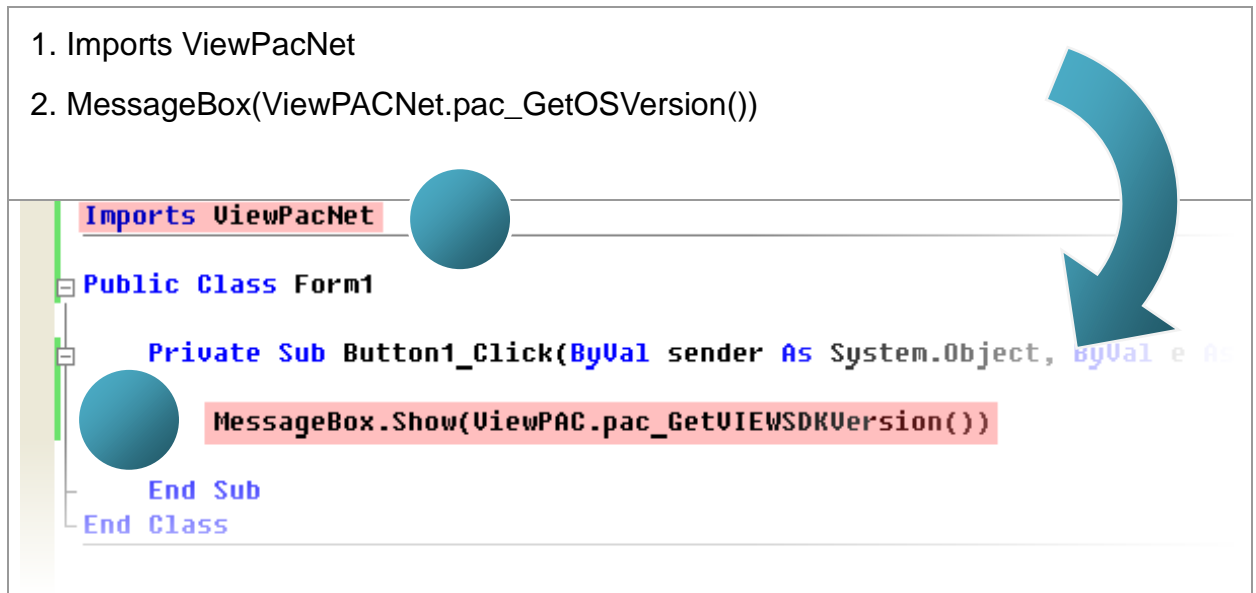


```
Imports ViewPacNet

Public Class Form1

    Private Sub Button1_Click(ByVal sender As System.Object, ByVal e As EventArgs)
        MessageBox.Show(ViewPAC.pac_GetUIEWSDKVersion())
    End Sub
End Class
```

## 4.5.4. Execute the application on the ViewPAC

Step 1: On the “Build” menu, click the “Build Solution” command

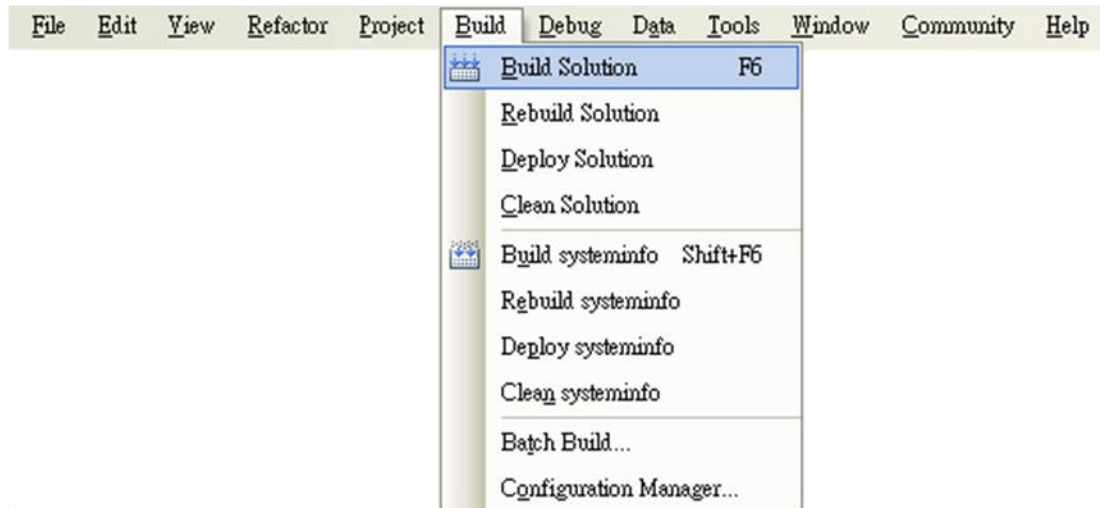

Step 2: Open the web browser and type the IP address to connect the FTP server of ViewPAC

Step 3: Upload the “SDKinfo.exe” application and the corresponding “ViewPacNet.dll” file to the ViewPAC via the ViewPAC FTP server




## Tips & Warnings

---



For applications programming in C# and VB.net with .net framework, when executing these application on the ViewPAC controller, the corresponding “ViewPACnet.dll” file must be in the same directory as the .exe file

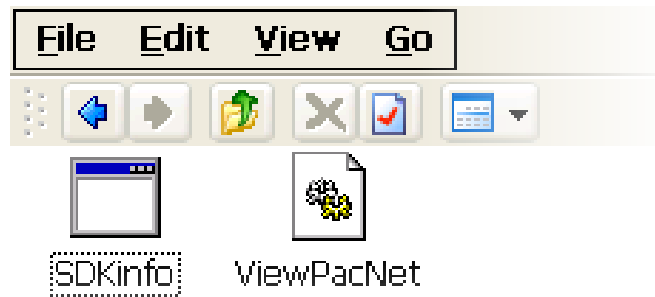

---

**Step 4: On the ViewPAC, execute the uploaded file**



## 4.6. Your First Program in eMbedded Visual C++

To create a demo program with eMbedded Visual C++ development tool includes the following main steps:


1. Create a new Forms-Based project
2. Configure compiler options
3. Design and Build an application program
4. Execute the application on the ViewPAC

All main steps will be described in the following subsection.


## 4.6.1. Create a new Forms-Based project

Step 1: Start the Microsoft Embedded Visual C++

Step 2: From the “File” menu, click the “New” command

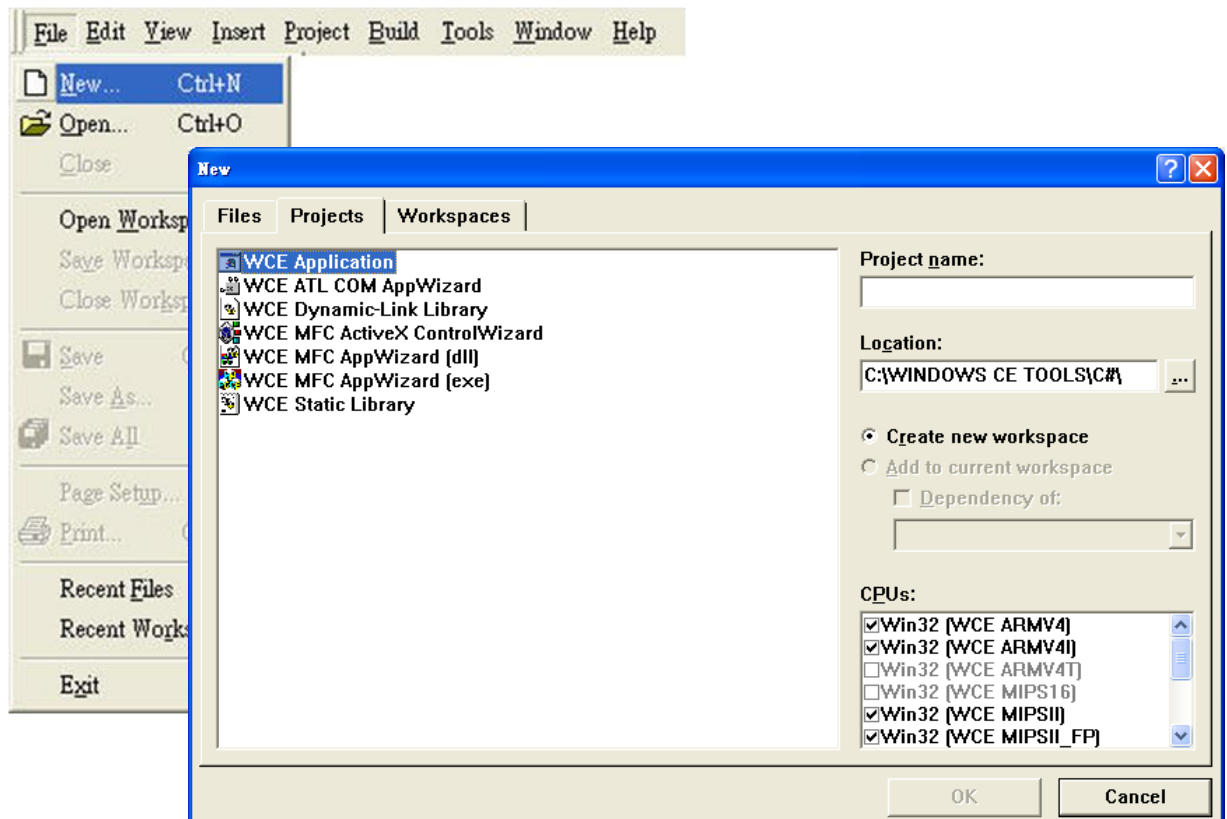

**Step 3: In the “New” dialog, select the “Projects” tab and do the following in this order**

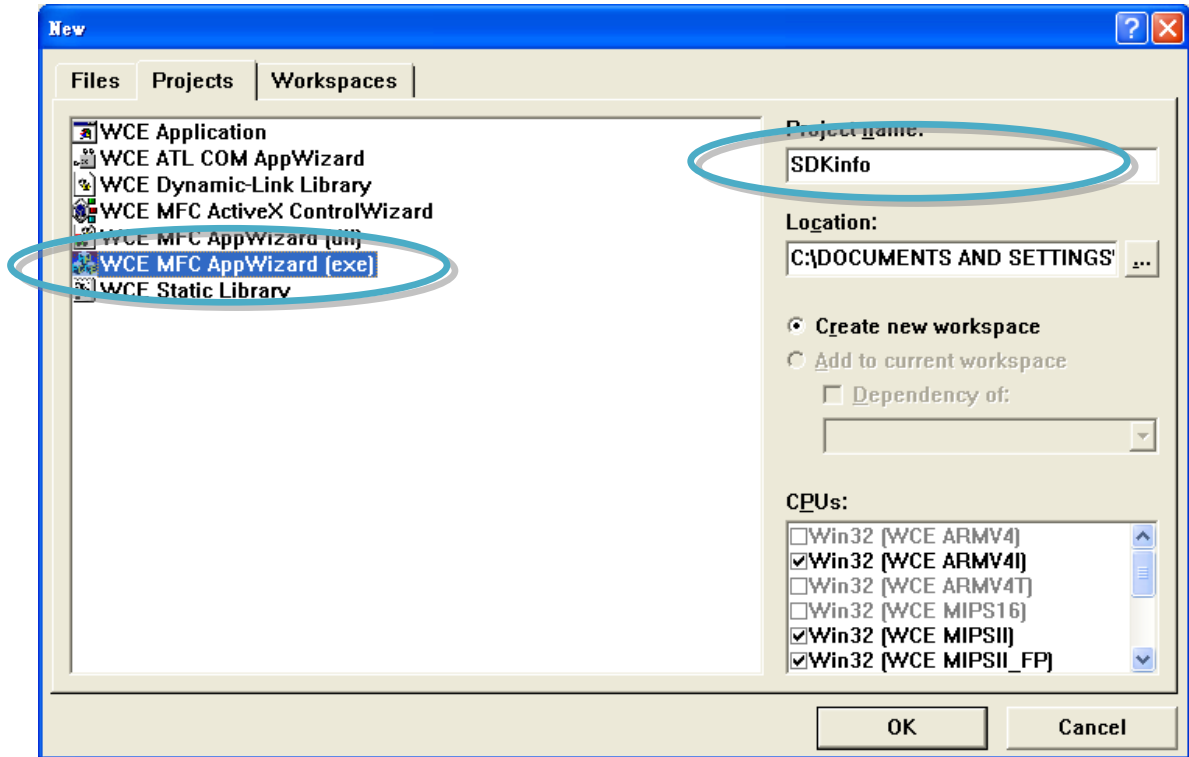


## Tips & Warnings

---




The selected CPU type must have “Win32 [WCE ARMV4I]”

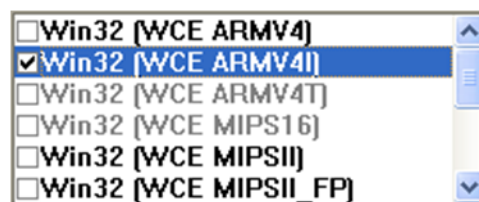


**Step 4: Click the “OK” button to start the wizard**


**Step 5: On the first page of the wizard, select “Dialog based” option and then click the “Next” button to the next step**

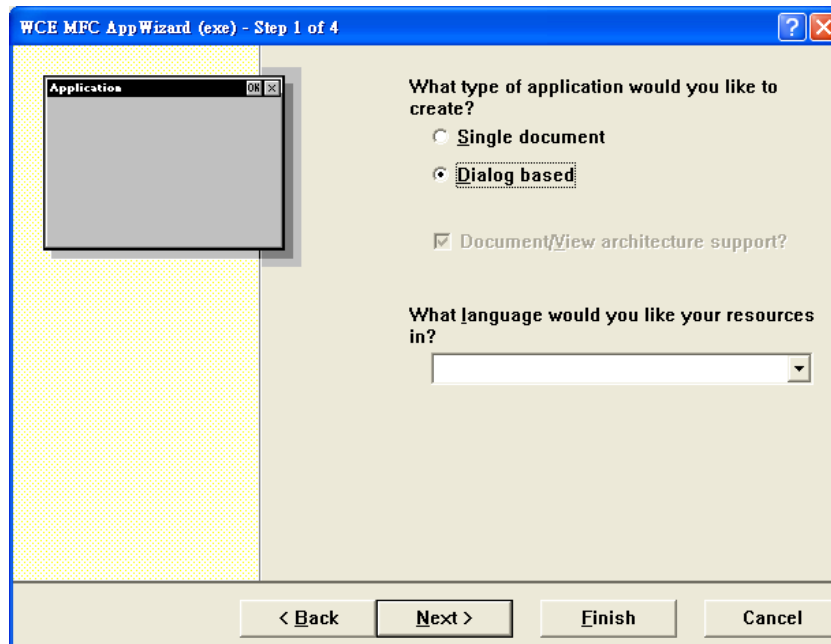


**Step 6: On the next page of the wizard, leave all the options as they are, and then click the “Next” button to the next step**

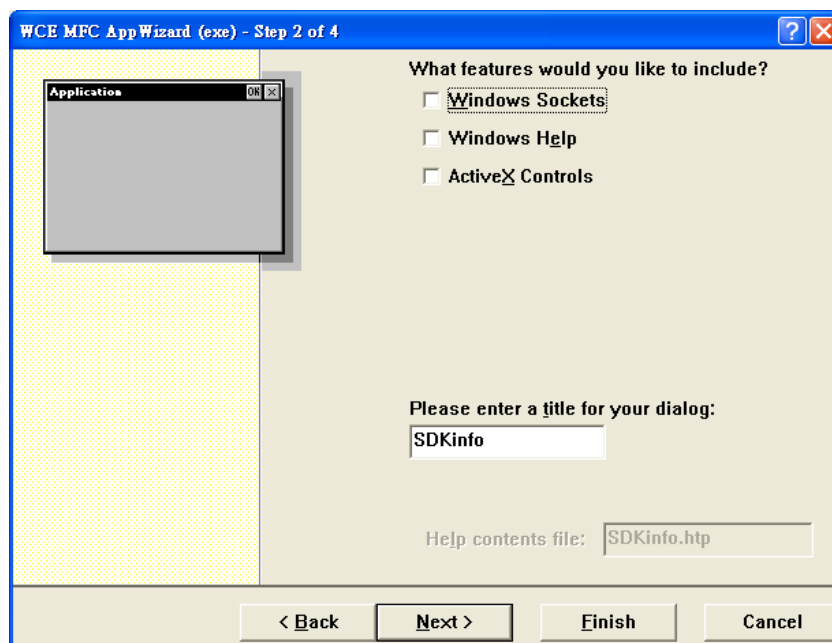


**Step 7: On the next page of the wizard, leave all the options as they are, and then click the “Next” button to the next step**

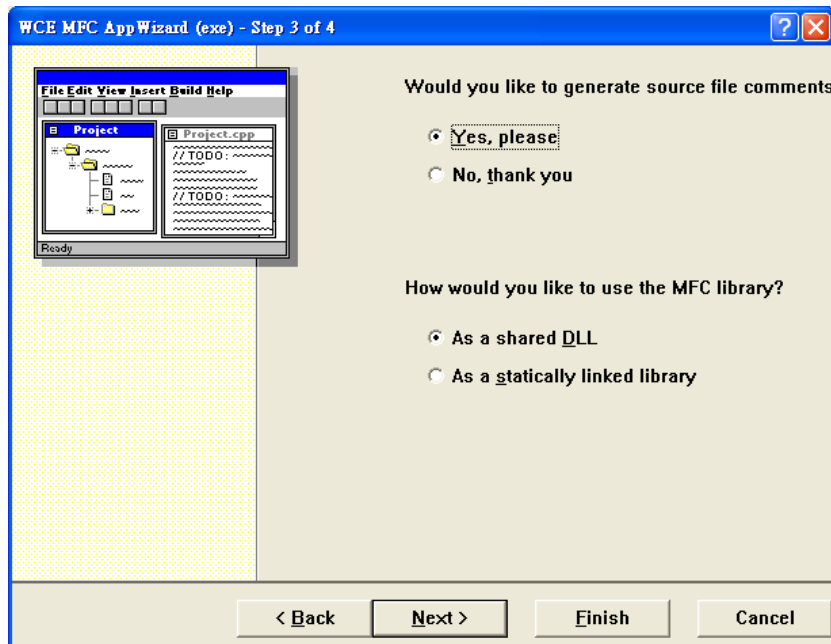

**Step 8: On the next page of the wizard, leave all the options as they are, and then click the “Finish” button to complete the wizard**

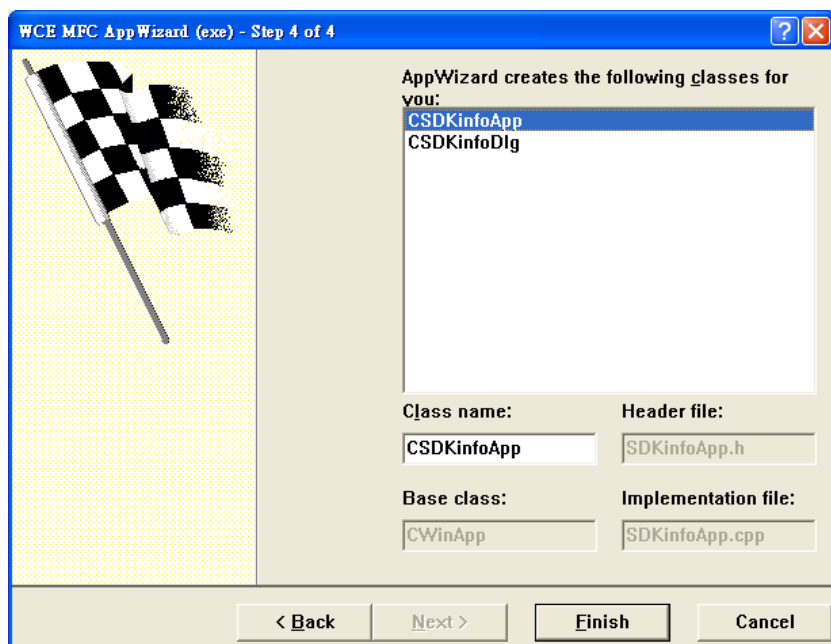


Step 9: The final summary appears, click the “OK” button to exit the wizard

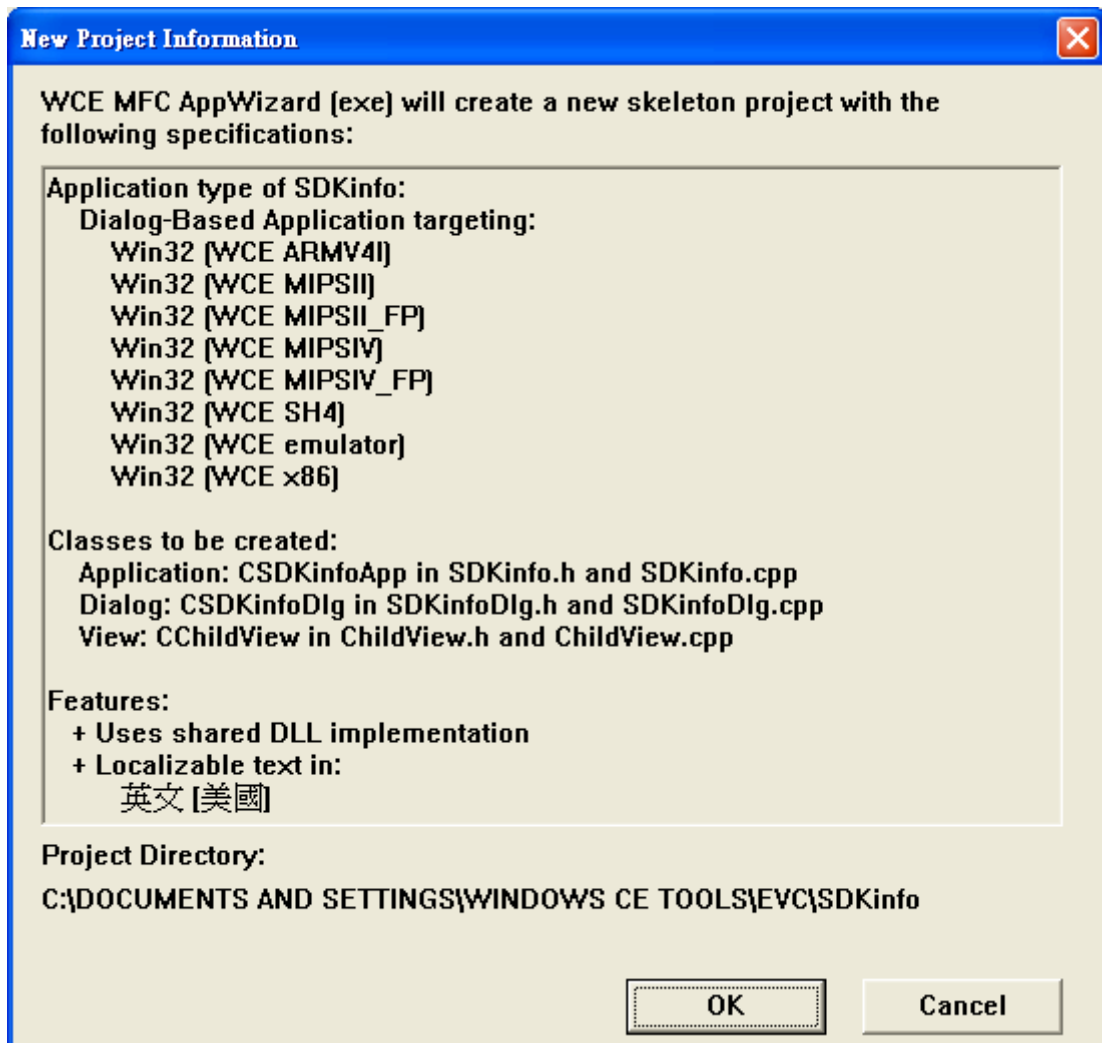

## 4.6.2. Configure compiler options


On the WCE configuration toolbar, select the “Win32 [WCE ARMV4] Release”

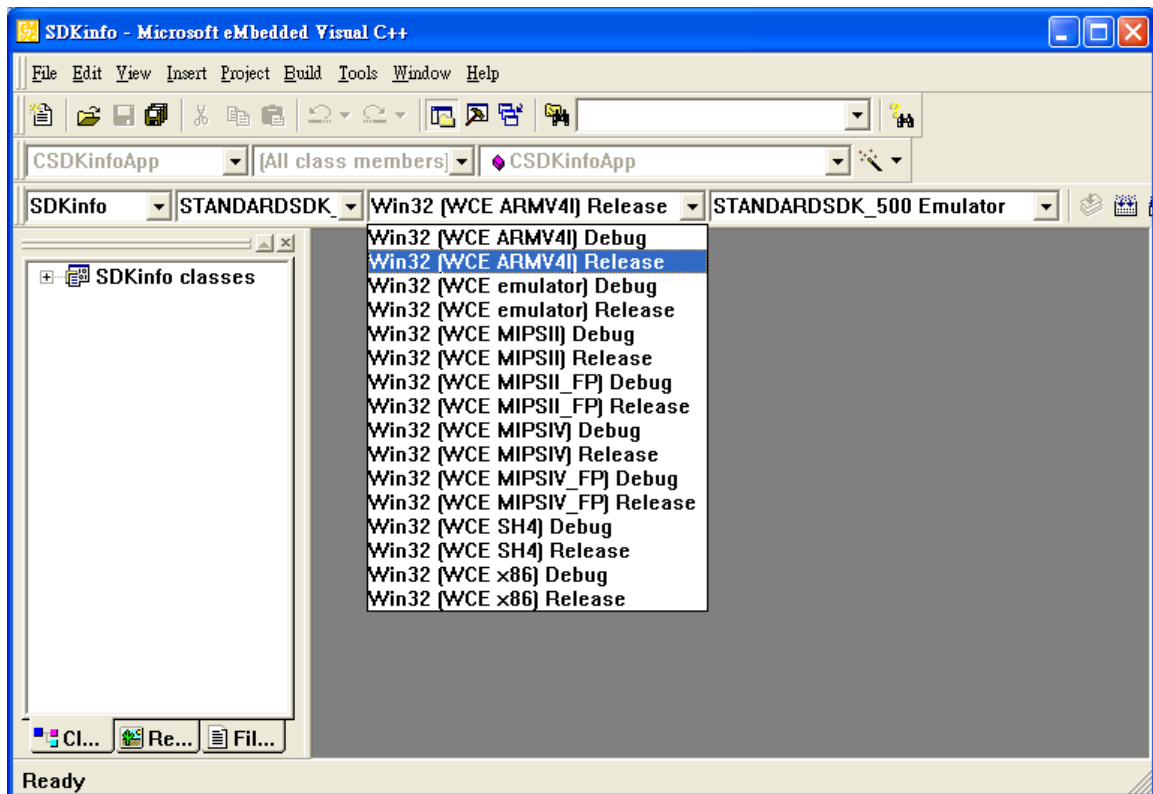




### 4.6.3. Specify the path for project reference

Step 1: Click the “Options...” command from the “Tools” menu

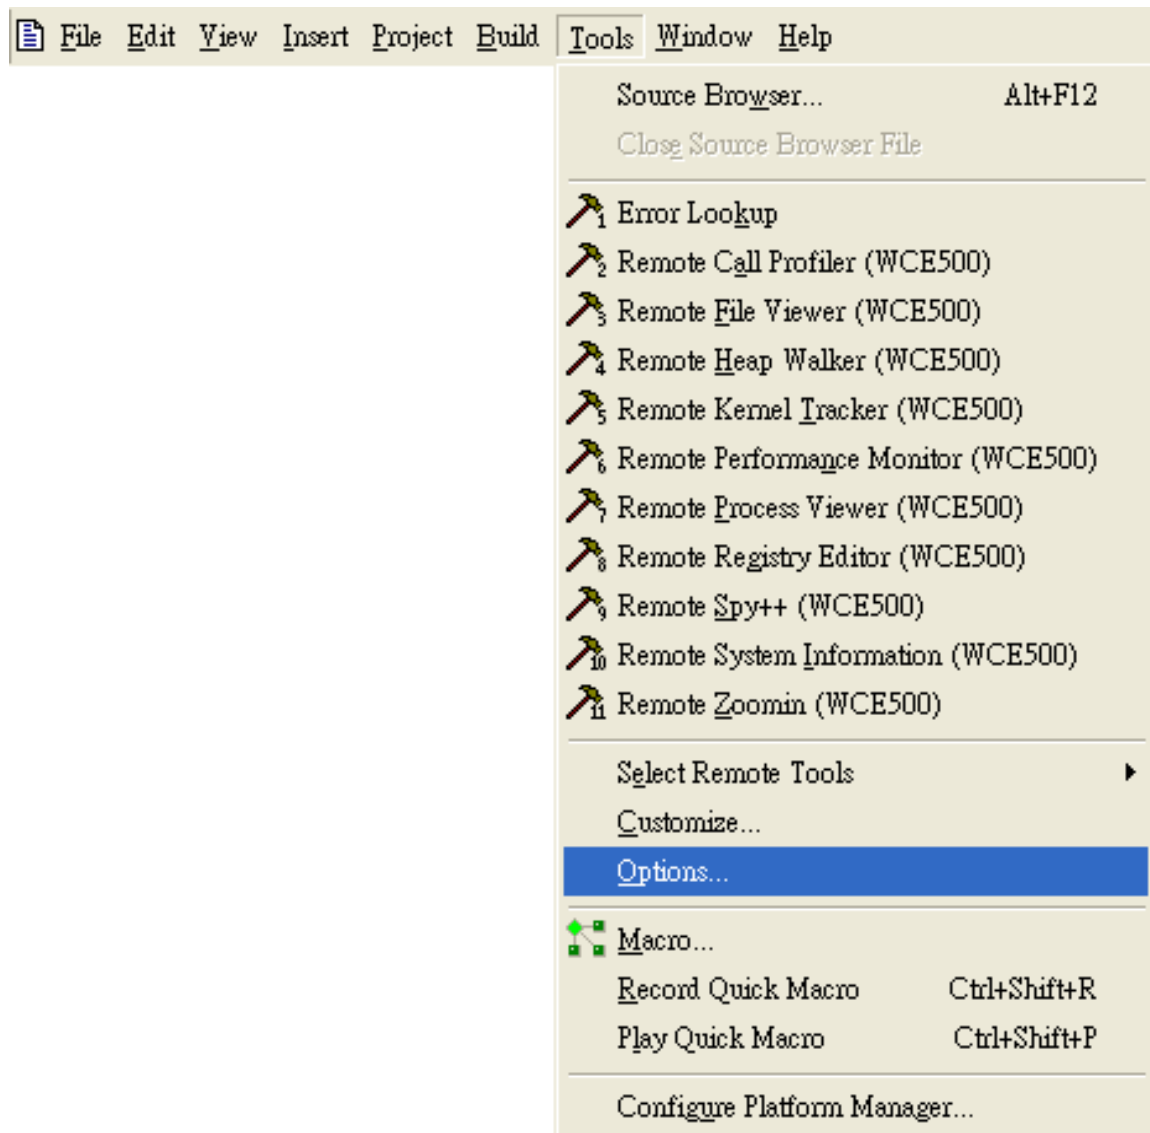

Step 2: In the “Option” dialog, select the “Directories” tab and do the following in this order to specify the header file include path

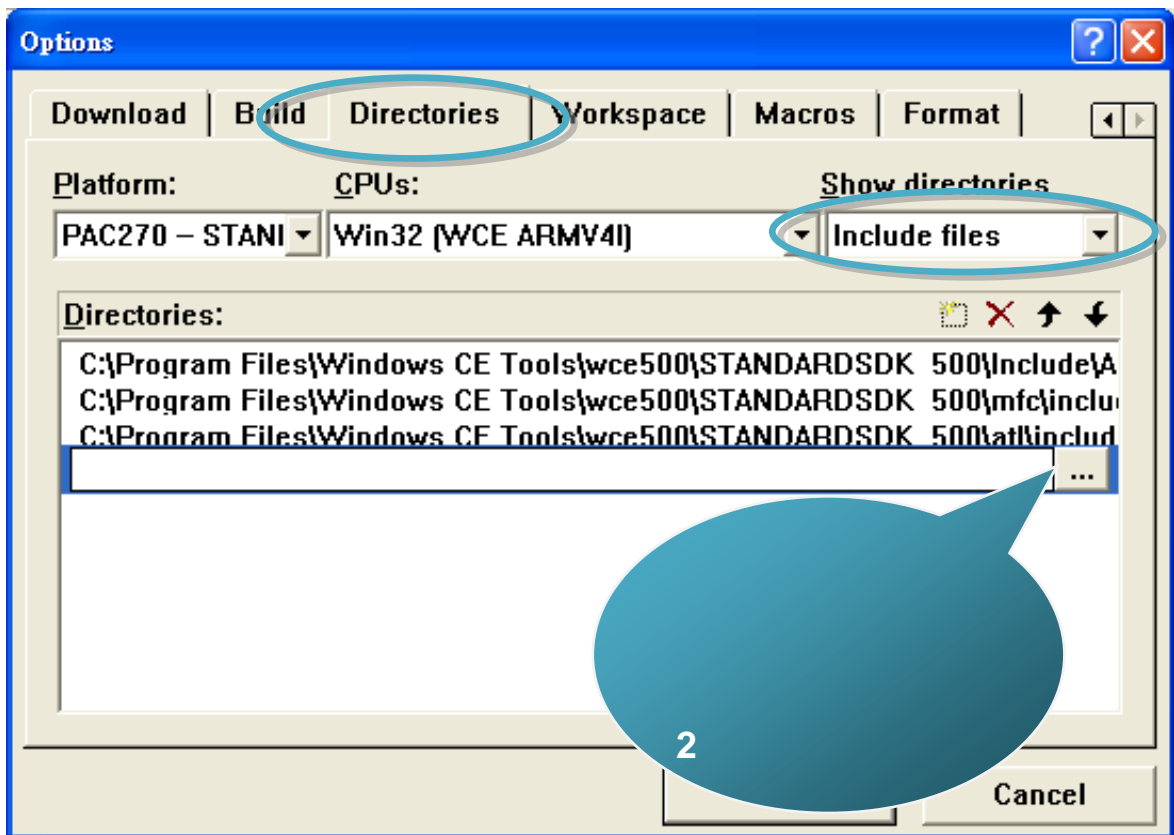


The “Viewpacsdk.h” file can be obtained from:

CD:\Napdos\vp-2000\_ce50\SDK\ViewpacSDK\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/sdk/viewpacsdk/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/sdk/viewpacsdk/)

Step 3: In the “Option” dialog, select the “Directories” tab and do the following in this order to specify the library file path

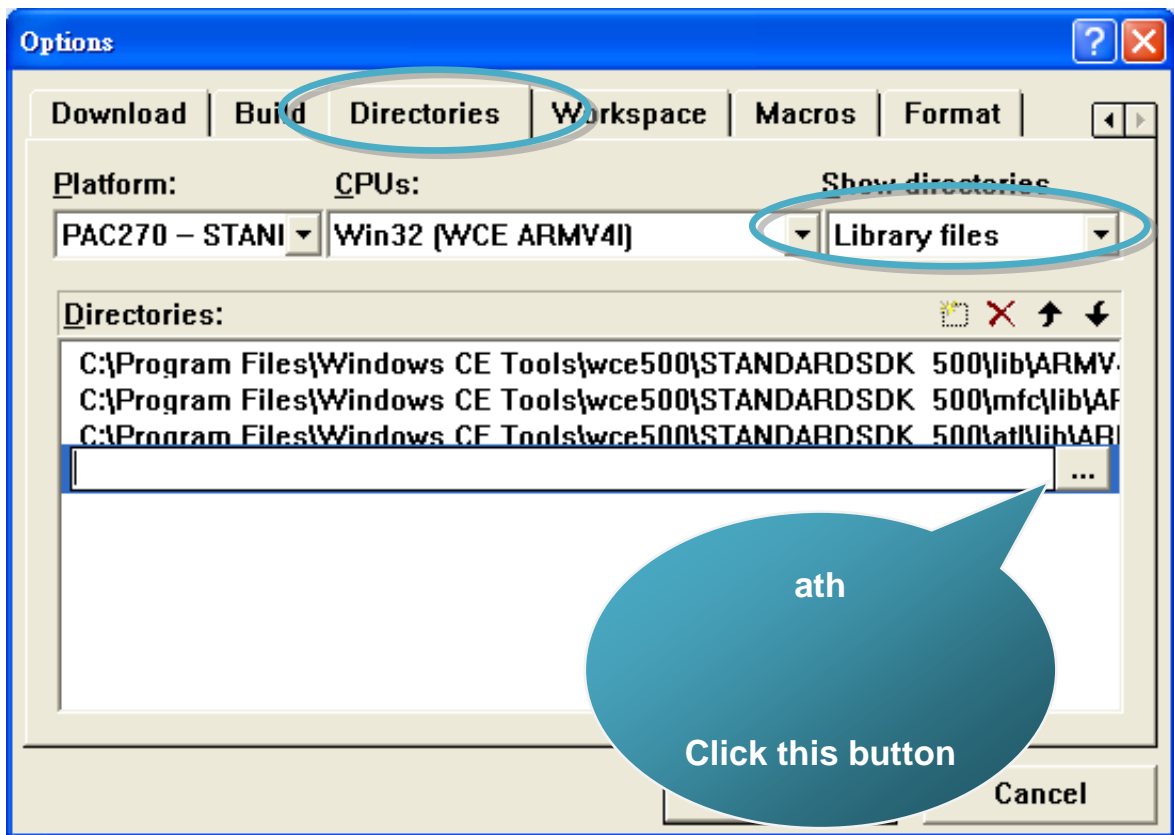


The “ViewPACSDK.lib” file can be obtained from:


CD:\Napdos\vp-2000\_ce50\SDK\ViewpacSDK\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/sdk/viewpacsdk/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/sdk/viewpacsdk/)

Step 4: Click the “Settings...” command from the “Project” menu

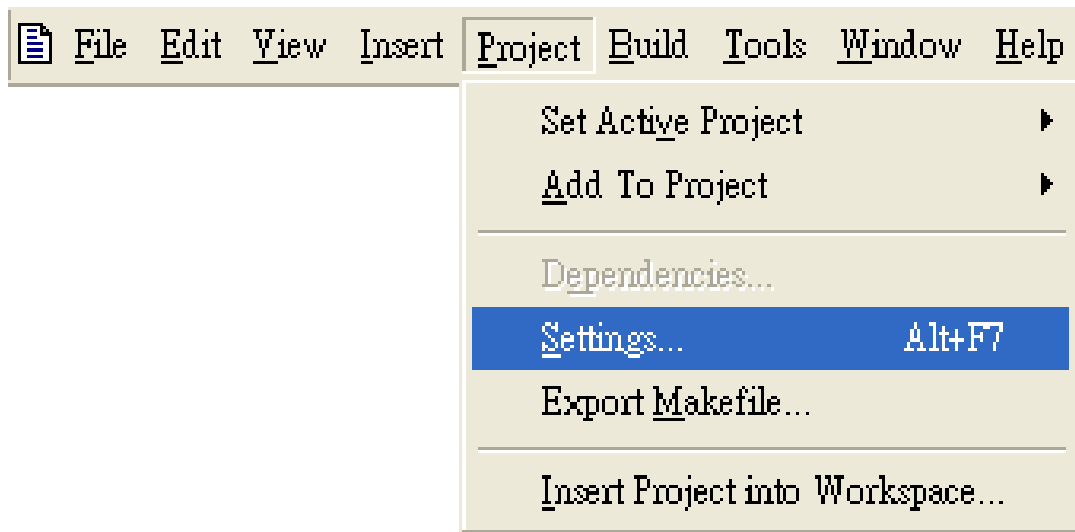

Step 5: In the “Project Settings” dialog box do the following in this order

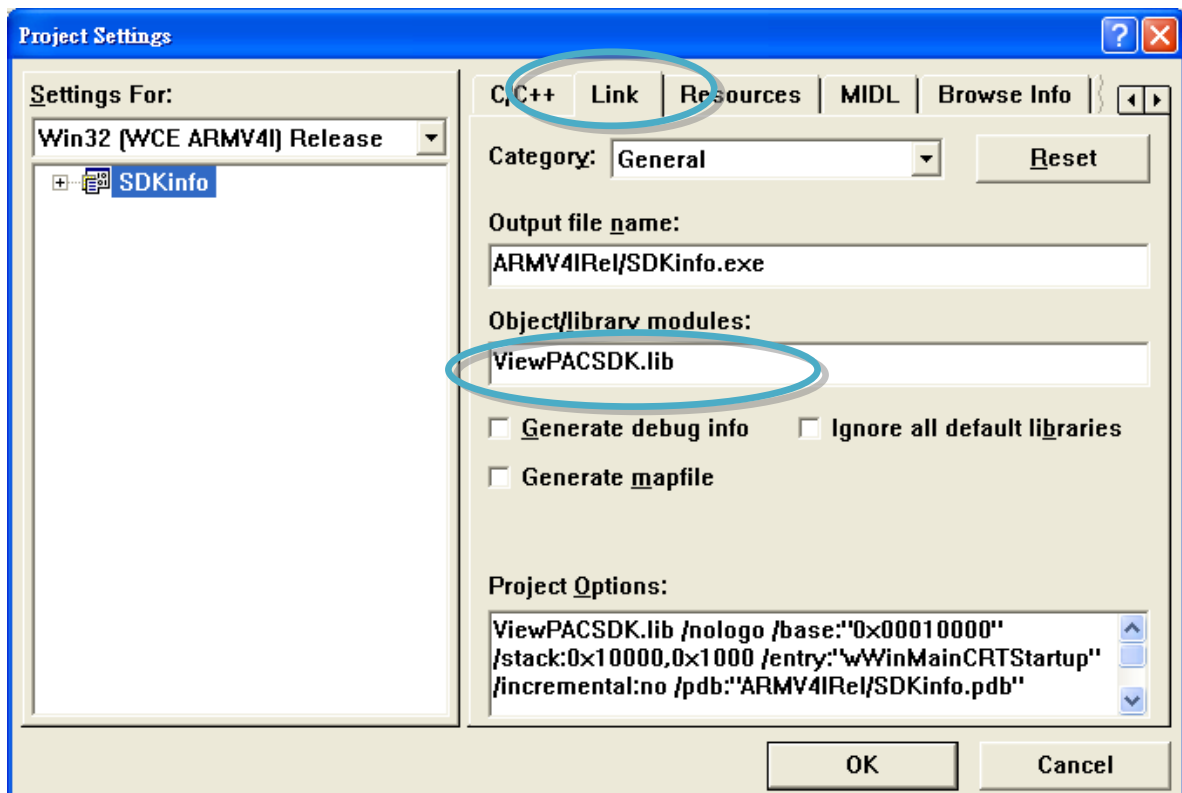


## 4.6.4. Design and Build an application program


Step 1: On the “Workspace” window, select the “ResourceView” tab and expand the “dialog” folder, and then double-click the “IDD\_DEMO\_DIALOG” to open the dialog box




Step 2: Add the “button” object in the “SDKInfo” dialog box

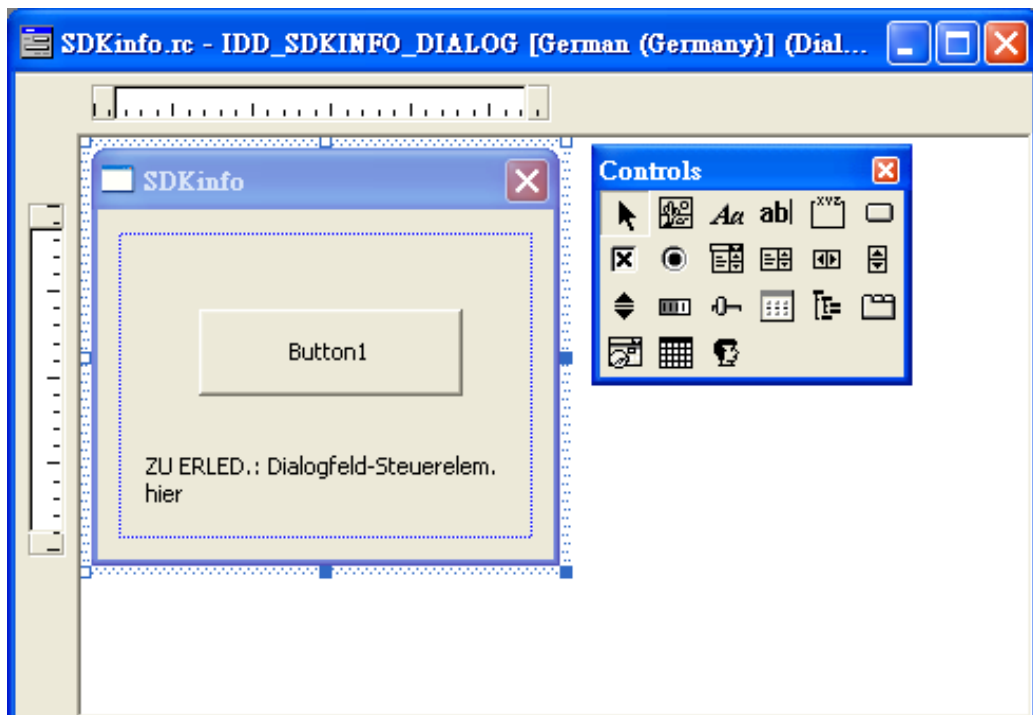

Step 3: In the “SDKinfo” dialog box, right-click the button object and then click the “Properties” command

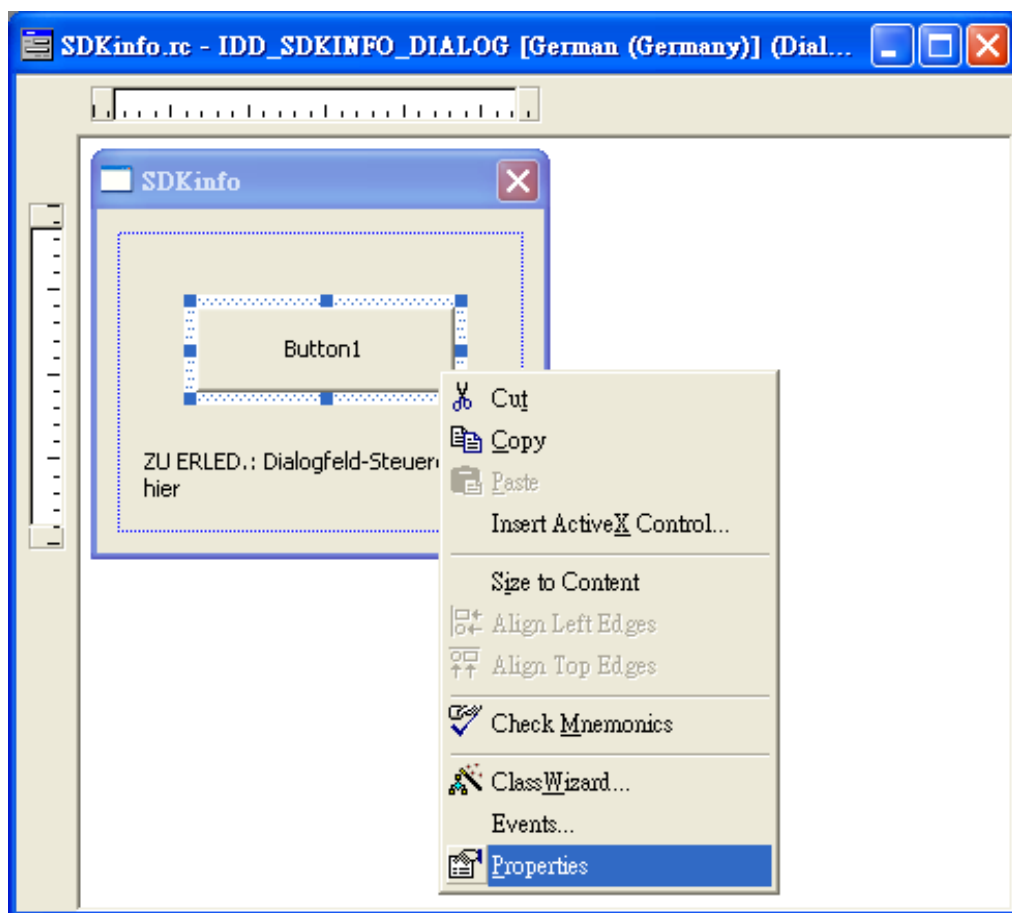


Step 4: Type the “Check the SDK version” in the “Caption” edit box and then  click the “close” button

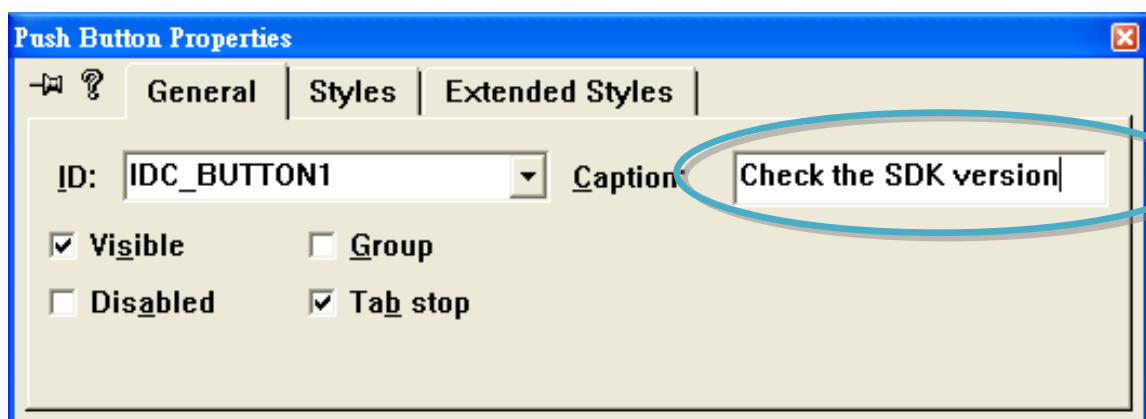

Step 5: In the “SDKinfo” dialog box, double-Click the button object




Step 6: Type the “OnBtnCheckSDK” in the “Member function name” edit box and then click the “OK” button

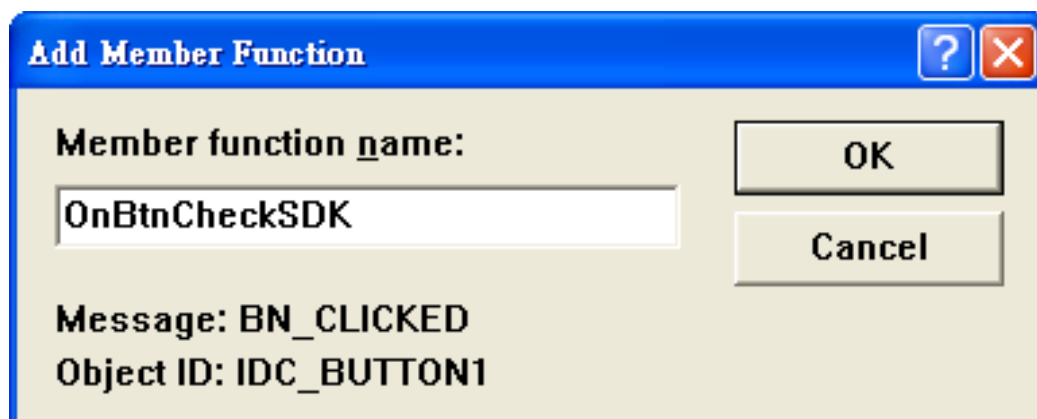

**Step 7: Insert the following code into the Editor Window**

```
char SDK[32];
TCHAR buf[32];
pac_GetVIEWSDKVersion(SDK);
pac_AnsiToWideString(SDK, buf);
MessageBox(buf, NULL, MB_OK);
return TRUE; // return TRUE unless you set the return value otherwise
}

void CSDKinfoDlg::OnBtnCheckSDK()
{
    // TODO: Add your control notification handler code here
    char SDK[32];
    TCHAR buf[32];
    pac_GetVIEWSDKVersion(SDK);
    pac_AnsiToWideString(SDK, buf);
    MessageBox(buf, NULL, MB_OK);
}
```





Step 8: Insert the “#include “Viewpacsdk.h” and #include “PACSDK.h” into the header area

```
// SDKInfoDlg.cpp : implementation file
//


#include "stdafx.h"
#include "SDKInfo.h"
#include "SDKInfoDlg.h"

#include "Viewpacsdk.h"
#include "PACSDK.h"

#ifdef _DEBUG
#define new DEBUG_NEW
#undef THIS_FILE
static char THIS_FILE[] = __FILE__;
#endif
```

## 4.6.5. Execute the application program on ViewPAC

Step 1: On the “Build” menu, click the “Build systeminfo.exe” command

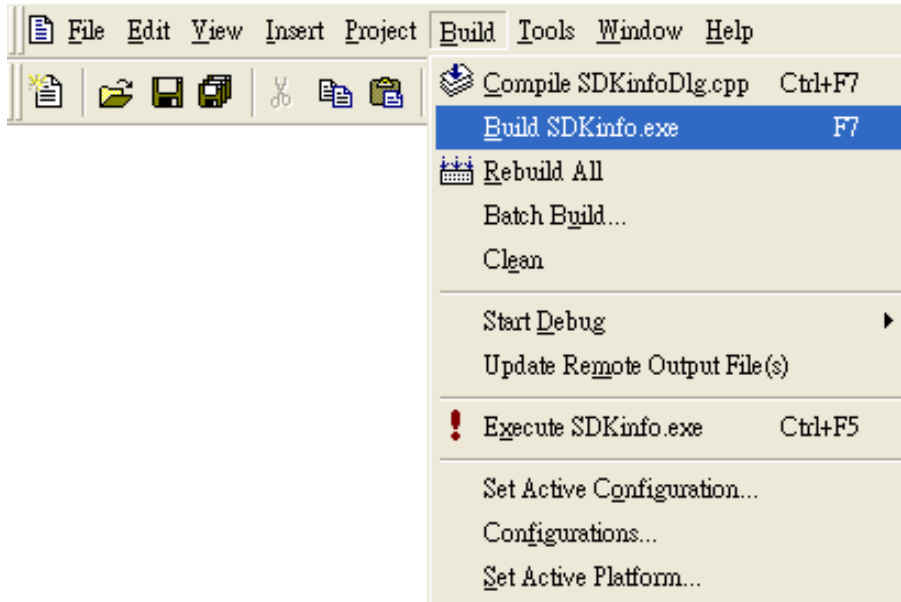

Step 2: Open the web browser and type the IP address to connect the FTP server of ViewPAC

Step 3: Upload the “SDKinfo.exe” application to the ViewPAC via the ViewPAC FTP server



Step 4: On the ViewPAC, execute the uploaded file



# 5. APIs and Demo References


This chapter introduces demo programs that have been designed for the ViewPAC. You can examine the demo source code, which includes numerous comments, to familiarize yourself with the ViewPAC API. This will allow developing your own applications quickly by modifying these demo programs. The following details the contents of the ViewPAC demo programs.

## 5.1. Demo programs with C#

The table below describes the ViewPAC demos that have been designed to demonstrate the standard operation features of the ViewPAC.

### 5.1.1. C# Demo program for WinPAC Standard API

The table below describes the ViewPAC demos that have been designed to demonstrate the standard operation features of the ViewPAC.

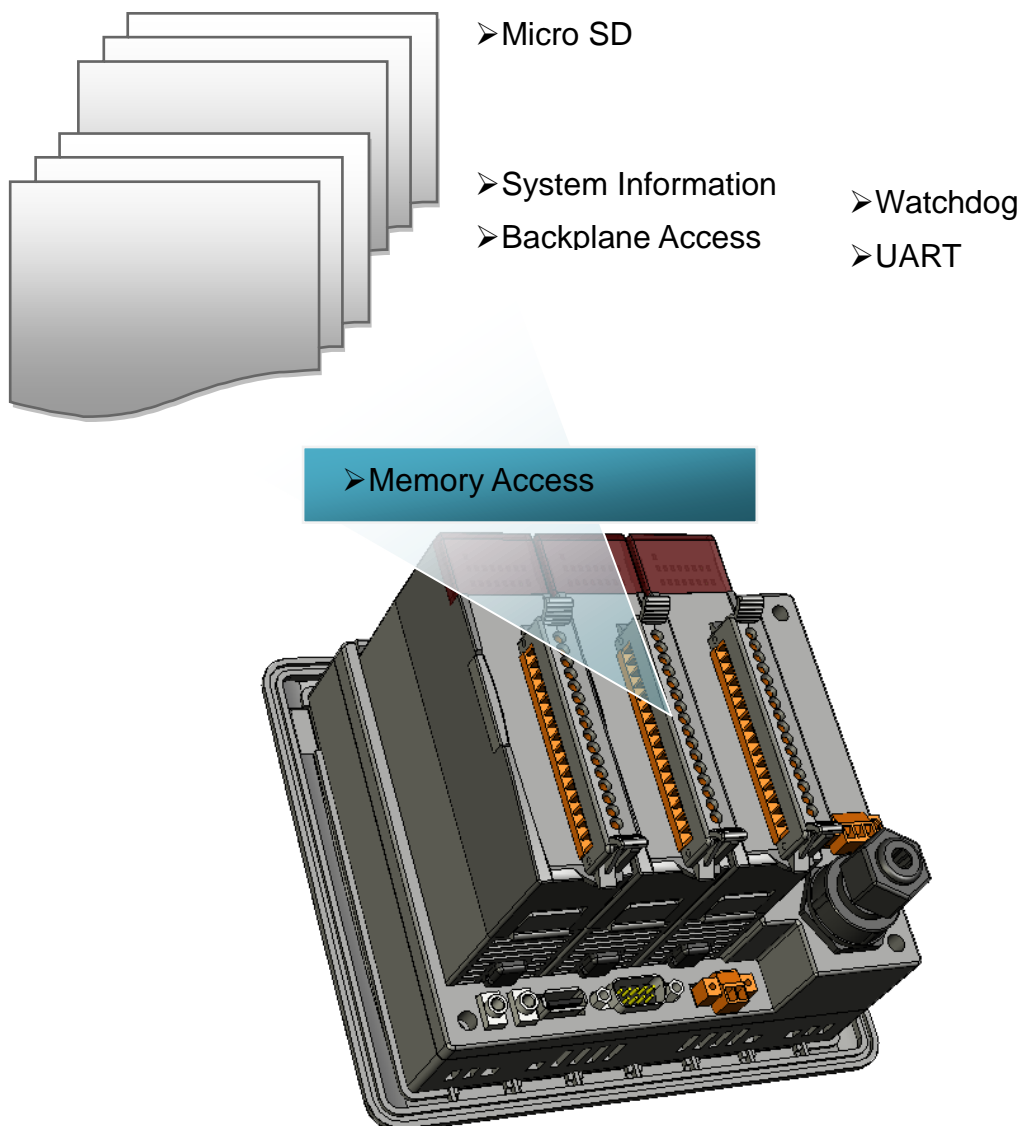

Folder	Demo	Explanation
system	systeminfo	Retrieves information about the OS version, CPU version, SDK version, etc.
backplane	backplaneinfo	Retrieves information about the DIP switch, backplane ID and slot count.
memoryaccess	memory	Shows how to read/write date values from/to EEPROM
	battery_backup_sram	Shows how to read or write to the battery backup
watchdog	watchdog	Displays how the watchdog operate
microsd	microsd_management	Shows how to enables/disables Micro SD
registry	registry	Shows how to read/write date values from/to registry
UART	diag	Shows how to read the name of local I/O modules via UART


For C# application, these demo programs can be obtained from:

CD:\Napdos\wp-8x4x\_ce50\Demo\WinPAC\C#.NET\Standard\

[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/winpac/c%23/standard/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/winpac/c%23/standard/)

## 5.1.2. C# Demo program for PAC IO API

The table below describes the ViewPAC demos that have been designed to demonstrate the expansion I/O module features of the ViewPAC.

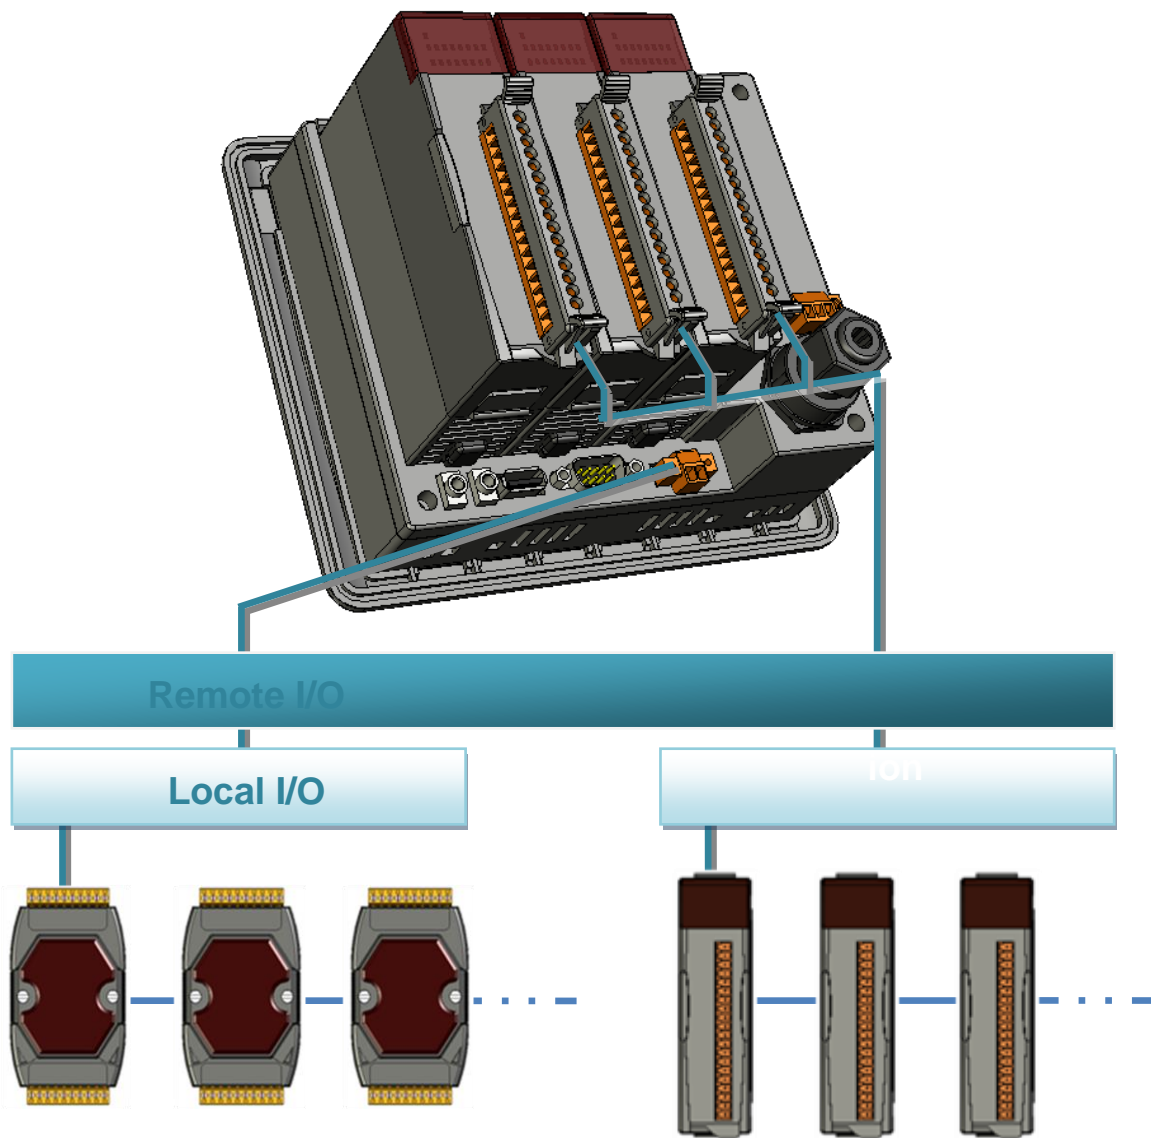

Folder	Demo	Explanation
Local	find_io	Shows how to retrieve the module names and types which plugged in the ViewPAC.
	8k_di	Shows how to read the DI values of DI module. This demo program is used by 8K series DI modules.
	8k_do	Shows how to write the DO values to DO module. This demo program is used by 8K series DO modules.
	8k_dio	Shows how to read the DI and the DO values of the DIO module. This demo program is used by 8K series DIO modules.
	87k_basic	Shows how to send/receive a command/response application. This demo program is used by 87K series modules.
	87K_demo	Shows how use UART API and the IO modules located as slots. This demo program is used by 87K series modules.
	87k_ai	Shows how to read the AI values of AI module. This demo program is used by 87K series AI modules.
	87k_ao	Shows how to write the AO values to AO module. This demo program is used by 87K series AO modules.
	87k_di	Shows how to read the DI values of DI module. This demo program is used by 87K series DI modules.
	87k_do	Shows how to write the DO values to DO module. This demo program is used by 87K series DO modules.
	87k_dio	Shows how to read the DI and the DO values of the DIO module. This demo program is used by 87K series DIO modules.

Folder	Demo	Explanation
Remote	7k87k_basic	Shows how to send/receive a command/response application. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_ai	Shows how to read the AI values of AI module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_ao	Shows how to write the AO values to AO module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_di	Shows how to read the DI values of DI module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_do	Shows how to write the DO values to DO module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_dio	Shows how to read the DI and the DO values of the DIO module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.

For C# application, these demo programs can be obtained from:


CD:\Napdos\wp-8x4x\_ce50\Demo\WinPAC\C#.NET\IO\

[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/winpac/c%23/io/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/winpac/c%23/io/)



### 5.1.3. C# Demo program for ViewPAC Particular API

The table below describes the ViewPAC demos that have been designed to demonstrate the particular features of the ViewPAC.

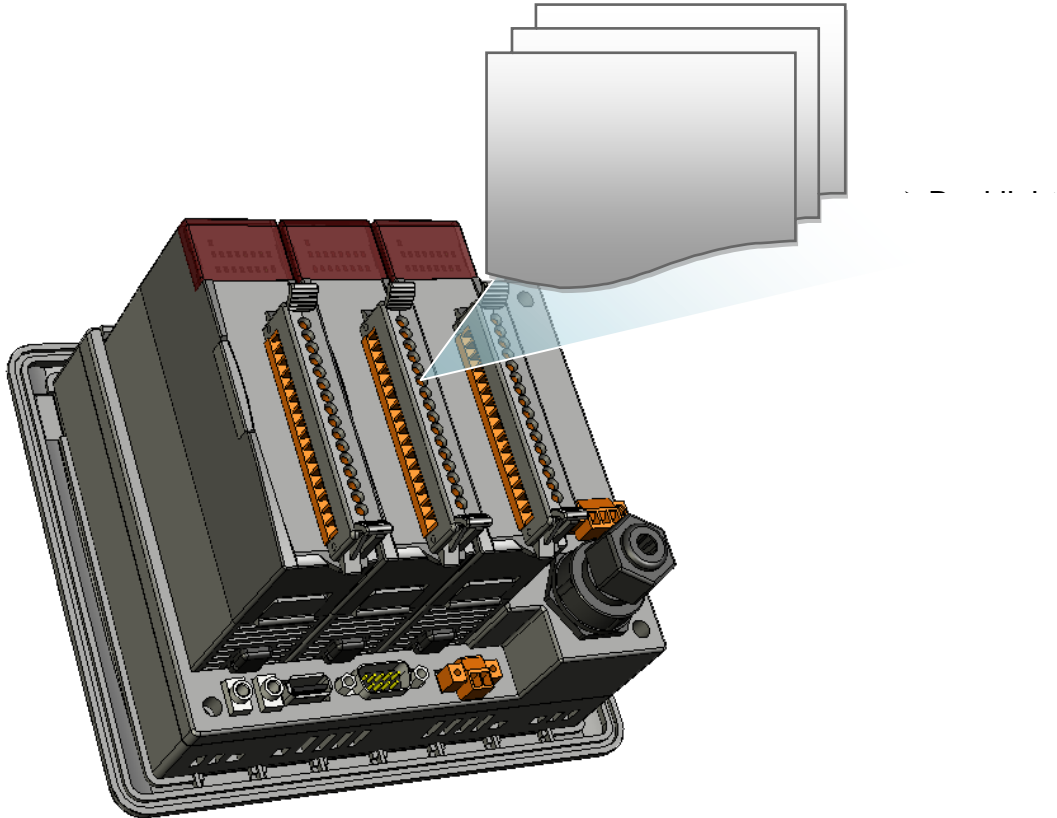

Folder	Demo	Explanation
Buzzer Beep	Buzzer Beep	Shows how to make a simple buzzer beep.
Keypad	Keypad	Shows how the KeyPad operates.
LCDBackLight	LCDBackLight	Shows how to control the LCD backlight.
Led	Led	Shows how to control the LEDs.
PlaySound	PlaySound	Shows how to control the microphone-in and earphone-out.

For C# application, these demo programs can be obtained from:

CD:\Napdos\vp-2000\_ce50\Demo\ViewPAC\DotNET\C#.NET\


[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/demo/viewpac/dotnet/c%23.net/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/demo/viewpac/dotnet/c%23.net/)

## 5.2. Demo Programs with eMbedded Visual C++

Examples are good way to understand the ViewPAC SDK. The table below describes ViewPAC demos and covers most of the common usages of each ViewPAC API for using eMbedded Visual C++.

## 5.2.1. eVC Demo program for WinPAC Standard API

The table below describes the ViewPAC demos that have been designed to demonstrate the standard operation features of the ViewPAC.

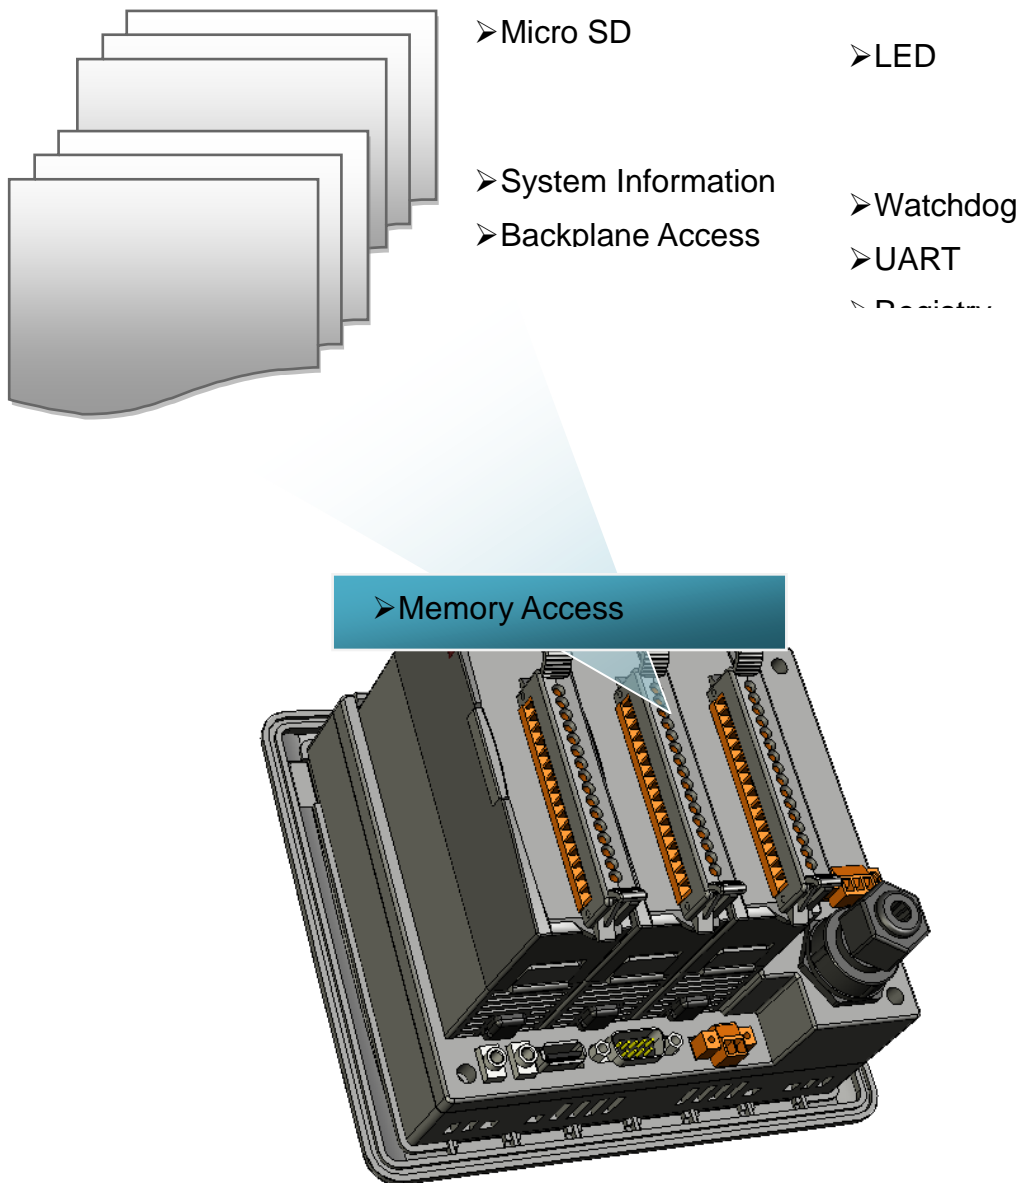

Folder	Demo	Explanation
system	systeminfo	Retrieves information about the OS version, CPU version, SDK version, etc.
backplane	backplaneinfo	Retrieves information about the DIP switch, backplane ID and slot count.
memoryaccess	memory	Shows how to read/write date values from/to EEPROM
	battery_backup_sram	Shows how to read or write to the battery backup
watchdog	watchdog	Displays how the watchdog operate
microsd	microsd_management	Shows how to enables/disables Micro SD
registry	registry	Shows how to read/write date values from/to registry
UART	diag	Shows how to read the name of local I/O modules via UART


For eVC application, these demo programs can be obtained from:

CD:\Napdos\wp-8x4x\_ce50\Demo\WinPAC\eVC\Standard\

[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/winpac/evc/standard/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/winpac/evc/standard/)

## 5.2.2. eVC Demo program for PAC IO API

The table below describes the ViewPAC demos that have been designed to demonstrate the expansion I/O module features of the ViewPAC.

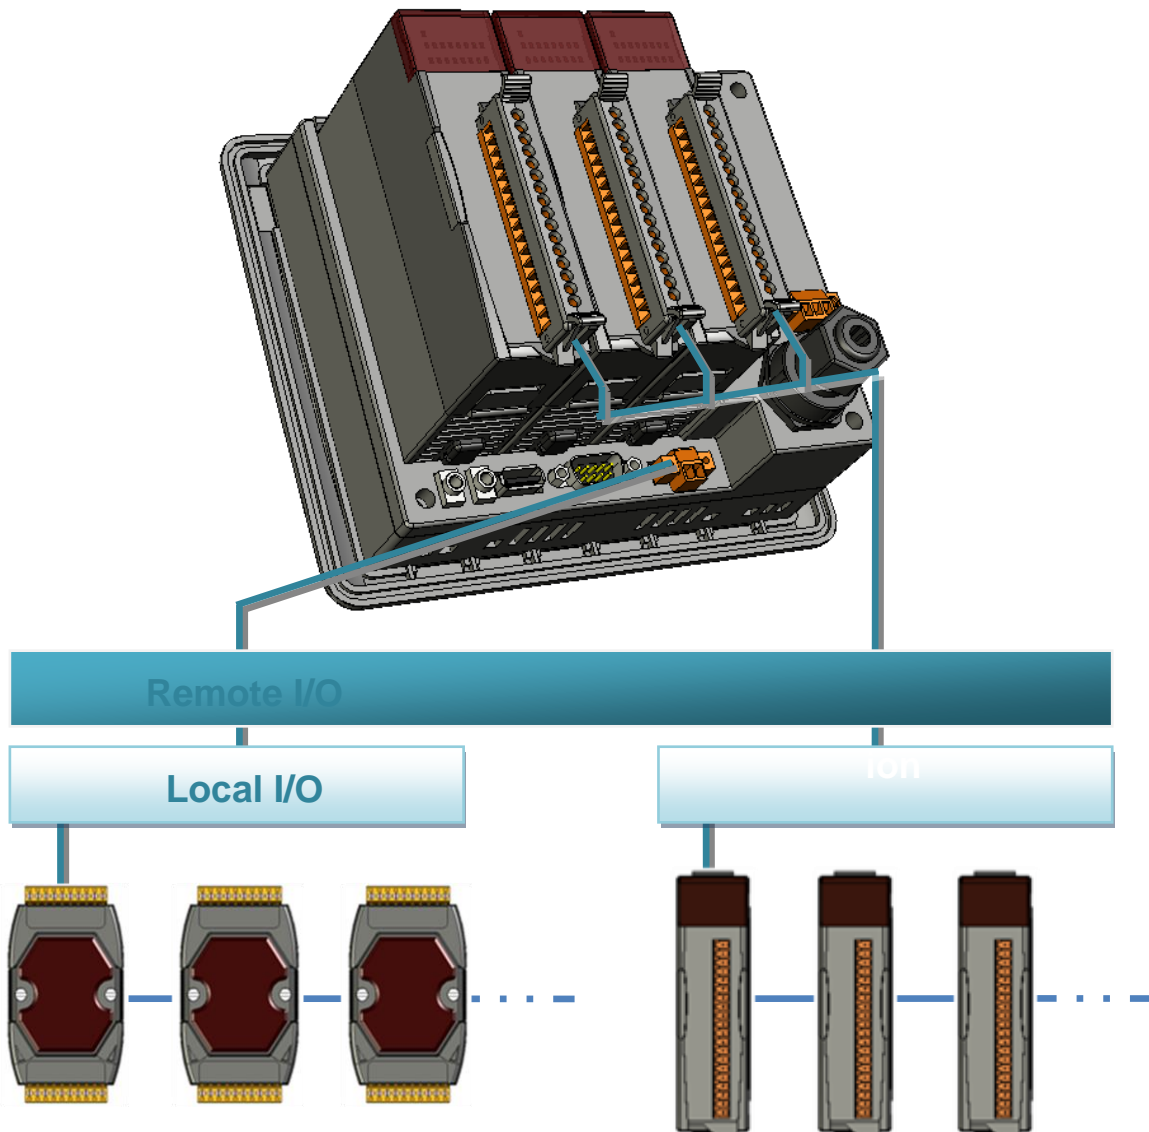

Folder	Demo	Explanation
Local	find_io	Shows how to retrieve the module names and types which plugged in the ViewPAC.
	8k_di	Shows how to read the DI values of DI module. This demo program is used by 8K series DI modules.
	8k_do	Shows how to write the DO values to DO module. This demo program is used by 8K series DO modules.
	8k_dio	Shows how to read the DI and the DO values of the DIO module. This demo program is used by 8K series DIO modules.
	87k_basic	Shows how to send/receive a command/response application. This demo program is used by 87K series modules.
	87K_demo	Shows how use UART API and the IO modules located as slots. This demo program is used by 87K series modules.
	87k_ai	Shows how to read the AI values of AI module. This demo program is used by 87K series AI modules.
	87k_ao	Shows how to write the AO values to AO module. This demo program is used by 87K series AO modules.
	87k_di	Shows how to read the DI values of DI module. This demo program is used by 87K series DI modules.
	87k_do	Shows how to write the DO values to DO module. This demo program is used by 87K series DO modules.
	87k_dio	Shows how to read the DI and the DO values of the DIO module. This demo program is used by 87K series DIO modules.

Folder	Demo	Explanation
Remote	7k87k_basic	Shows how to send/receive a command/response application. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_ai	Shows how to read the AI values of AI module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_ao	Shows how to write the AO values to AO module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_di	Shows how to read the DI values of DI module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_do	Shows how to write the DO values to DO module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.
	7k87k_dio	Shows how to read the DI and the DO values of the DIO module. This demo program is used by 7K or 87K series AI modules which connected through a COM port.

For eVC application, these demo programs can be obtained from:


CD:\Napdos\wp-8x4x\_ce50\Demo\WinPAC\eVC\IO\

[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/winpac/evc/io/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/winpac/evc/io/)



### 5.2.3. eVC Demo program for ViewPAC Particular API

The table below describes the ViewPAC demos that have been designed to demonstrate the particular features of the ViewPAC.

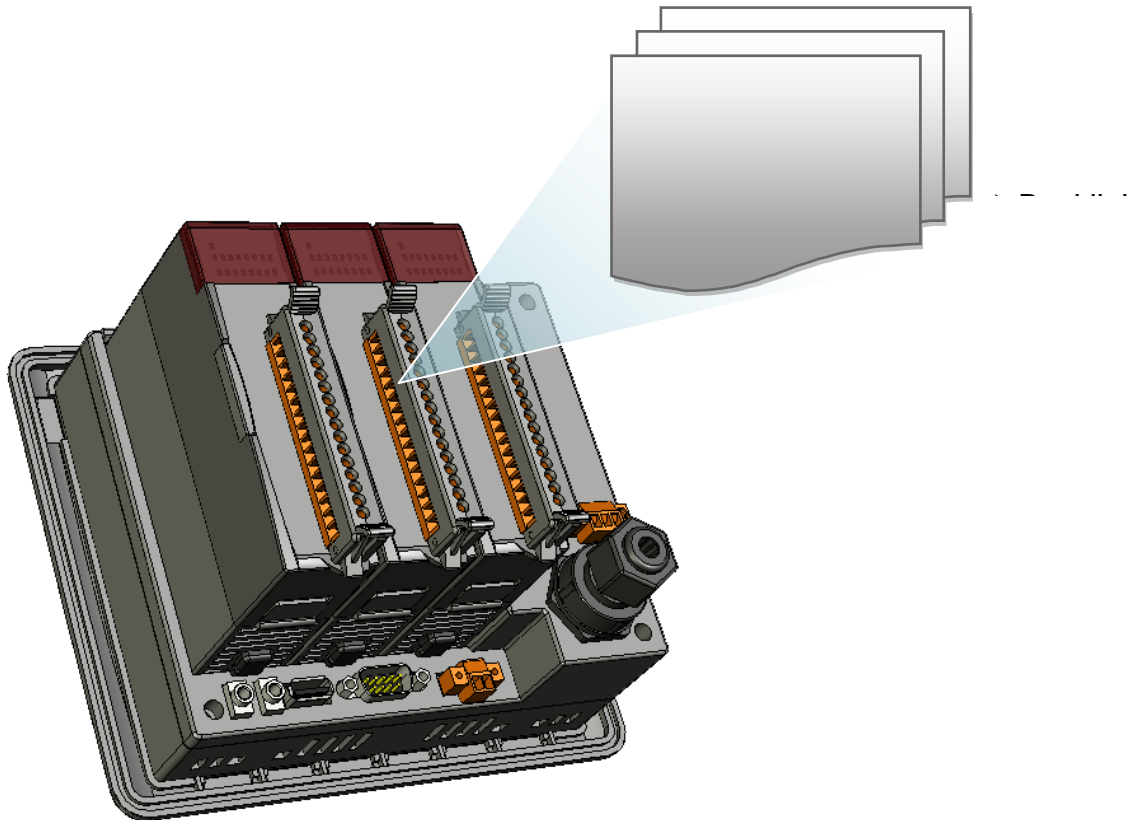

Folder	Demo	Explanation
BuzzerBeep	BuzzerBeep	Shows how to make a simple buzzer beep.
KeyPad	KeyPad	Shows how the KeyPad operates.
LCDBackLight	LCDBackLight	Shows how to control the LCD backlight.
Led	Led	Shows how to control the LEDs.
PlaySound	PlaySound	Shows how to control the microphone-in and earphone-out.

For eVC application, these demo programs can be obtained from:


CD:\Napdos\vp-2000\_ce50\Demo\ViewPAC\eVC\

[ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/demo/viewpac/evc/](ftp://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/demo/viewpac/evc/)

# 6. I/O Modules and SDK Selection

This chapter describes how to select a suitable I/O expansion module and the corresponding SDK library to be used for developing programs on ViewPAC series devices.

## Selecting an SDK Library for I/O Expansion

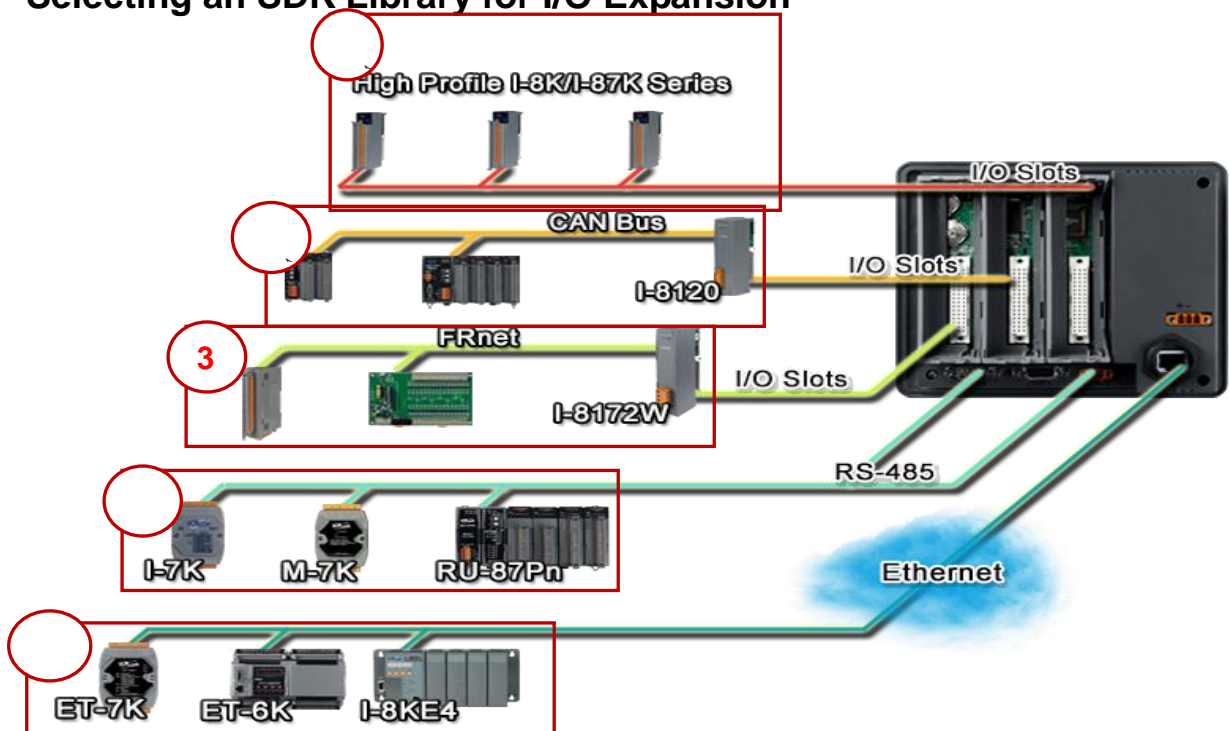

### 1. Local I/O (I-8K Series & I-87K Series)

There are two types of I/O modules that can be inserted into local bus of a ViewPAC device, Parallel and Serial. Parallel modules (I-8K Series) are high-speed modules and only support an MCU (Main Control Unit). Serial modules (I-87K Series) can support either an MCU or an I/O expansion unit. The following table shows the appropriate SDK library to be used for I/O modules.

SDK	Modules			
		I-87K series	I-87K series with PWM functions	I-8K series

Native SDK	PACSDK.dll	PACSDK_PWM.dll	PACSDK.dll	Specified SDK
.NET CF SDK	PACNET.dll	PACNET.dll	PACNET.dll	Specified SDK

The detail of the SDK library to be used for a specific I/O Module is listed in the table below:

Module	Native SDK	.NET CF SDK
I-8017HW	pac_i8017HW.dll	pac_i8017HWNet.dll
I-8014W	pac_i8014W.dll	pac_i8014WNet.dll
I-8024W	pac_i8024W.dll	pac8024WNet.dll
I-8026W	pac_i8026W.dll	pac_i8026WNet.dll
I-8048W	pac_i8048W.dll	pac_i8048WNet.dll
I-8050W	pac_i8050W.dll	pac_i8050WNet.dll
I-8084W	pac_i8084W.dll	pac_i8084WNet.dll
I-8088W	pac_i8088W.dll	pac_i8088WNet.dll
I-8093W	pac_i8093W.dll	pac8093WNet.dll
I-87088W	PACSDK_PWM.dll	PACNET.dll
Other I-8K & I-87K modules	PACSDK.dll	PACNET.dll

## 2. RS485 (I-7K Series & M-7K series)

I-7000, M-7000, RU-87Pn and high profile I-87K series modules connect to ViewPAC series devices via a twisted-pair, multi-drop, 2-wire RS-485 network.

SDK	Modules			
	I-7K series	I-7K series with	M-7K series	RU-87Pn +

		PWM functions		I-87K
Native SDK	PACSDK.dll	PACSDK_PWM.dll	Modbus Demo	Refer to the I-8K Series & the I-87K Series
.NET CF SDK	PACNET.dll	PACNET.dll	Modbus Demo	Refer to the I-8K Series & the I-87K Series

The detail of the SDK library to be used for a specific I/O Module is listed in the table below:

Module	Native SDK	.NET CF SDK
M7000 series	Modbus Demo	Modbus Demo
I-7088W	PACSDK_PWM.dll	PACNET.dll
Other I-7K modules	PACSDK.dll	PACNET.dll

### 3. Ethernet

The Ethernet I/O devices available include ET-6000, ET-7000, I-8KE4/8 and I-8KE4/8-MTCP, and support either the DCON or the Modbus/TCP communication protocol.

Module	Native SDK	.NET CF SDK
ET-6K/ET-7K series	Modbus Demo	Modbus Demo

### 4. FRnet

FRnet is an innovative industrial field bus technology that uses twisted pair cable as the transmission medium. The status of all I/O devices is updated on a fixed cycle, no matter how many FRnet I/O modules are connected to the FRnet network.

Module	Native SDK	.NET CF SDK
--------	------------	-------------

I-8172W	pac_i8172W.dll	pac8172WNet.dll
---------	----------------	-----------------

## 5. CAN Bus

The Controller Area Network (CAN) is a serial communication way, which efficiently supports distributed real-time control with a very high level of security. It provides the error-processing mechanisms and concepts of message priority. These features can improve the network reliability and transmission efficiency.

Module	Native SDK	.NET CF SDK
I-8120W	I8120.dll	I8120net_pac.dll

## Selection Guide for an I/O Module Demo Program

### I-7K series:

[http://ftp.icpdas.com.tw/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/winpac/applicable\\_demo\\_for\\_7k\\_module.pdf](http://ftp.icpdas.com.tw/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/winpac/applicable_demo_for_7k_module.pdf)

### I-87K series:

[http://ftp.icpdas.com.tw/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/winpac/applicable\\_demo\\_for\\_87k\\_module.pdf](http://ftp.icpdas.com.tw/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/winpac/applicable_demo_for_87k_module.pdf)

### I-87K series:

[http://ftp.icpdas.com.tw/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/winpac/applicable\\_demo\\_for\\_8k\\_module.pdf](http://ftp.icpdas.com.tw/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/winpac/applicable_demo_for_8k_module.pdf)

### Modbus demo:

[http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/demo/nmodbus/](http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/demo/nmodbus/)

### CAN Bus demo:


[ftp://ftp.icpdas.com/pub/cd/fieldbus\\_cd/can/slotmodule/i\\_8120w/demos/](ftp://ftp.icpdas.com/pub/cd/fieldbus_cd/can/slotmodule/i_8120w/demos/)

# 7. ViewPAC Updates

This chapter provides instructions on how to upgrade ViewPAC OS and SDK.

ICP DAS will continue to add additional features to ViewPAC SDK and OS in the future, so we advise you to periodically check the ICP DAS web site for the latest updates.

ViewPAC updates services can be divided into the following two main categories:

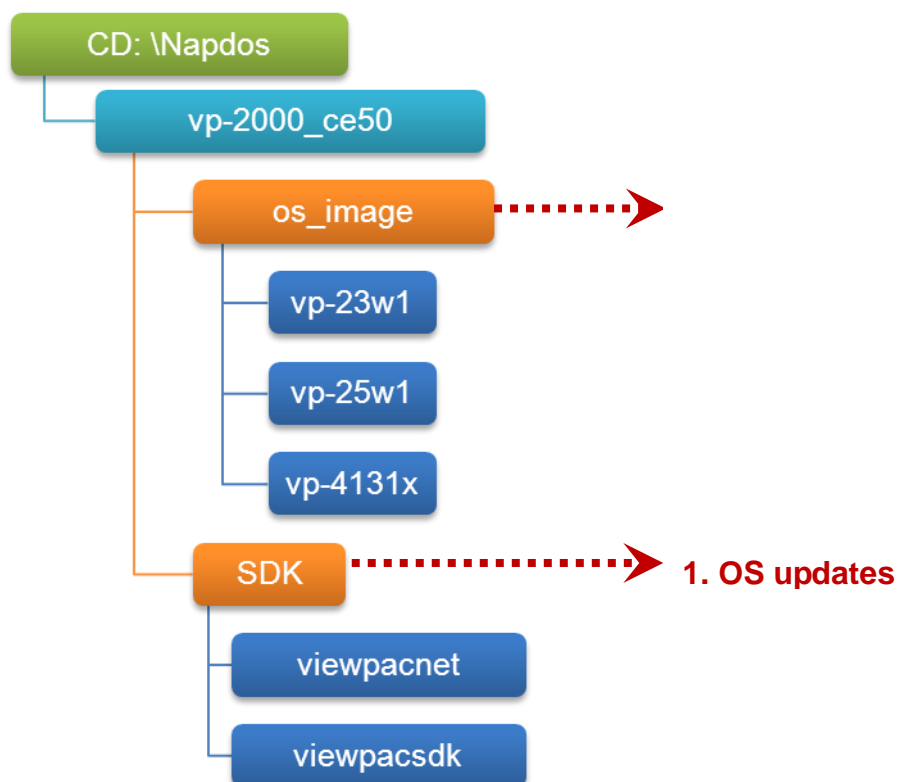

## 7.1. OS updates

The updates files of OS image are located on:

**VP-23W1:**


CD:\Napdos\vp-2000\_ce50\OS\_image\vp-23w1\

**VP-25W1:**

CD:\Napdos\vp-2000\_ce50\OS\_image\vp-25w1\

**VP-413x:**

CD:\Napdos\vp-2000\_ce50\OS\_image\vp-413x\

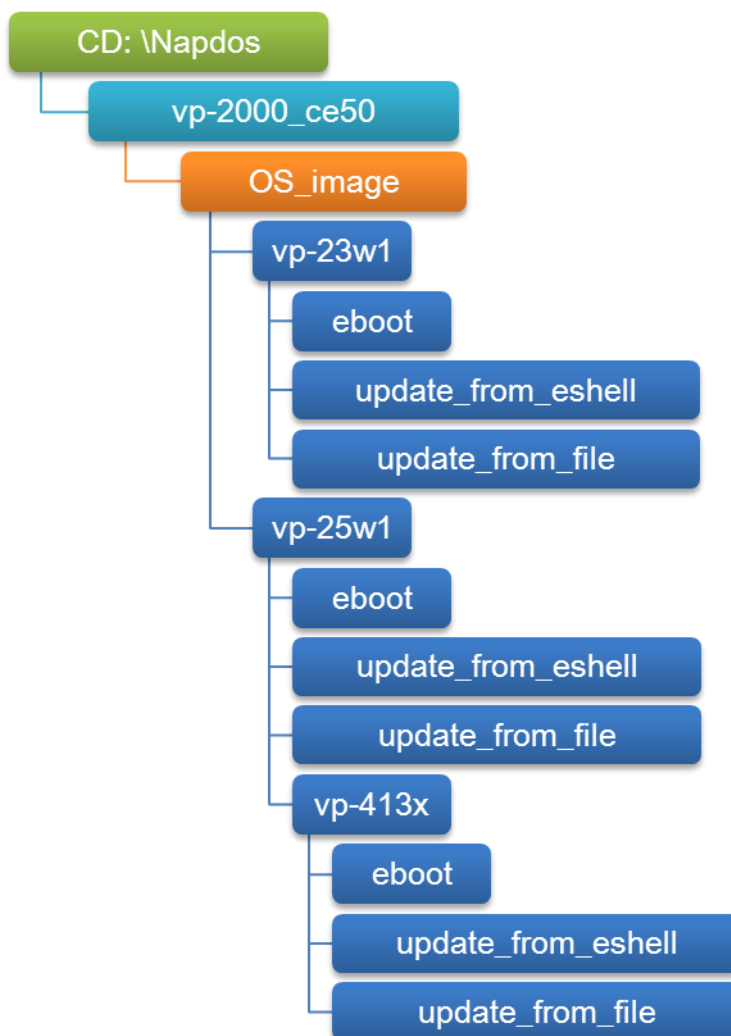




There are two different ways of ViewPAC OS image updates:

**i. ViewPAC OS updates from file**


(We recommend that you use this method for quick and easy to update ViewPAC OS image)

**ii. ViewPAC OS updates from eshell**

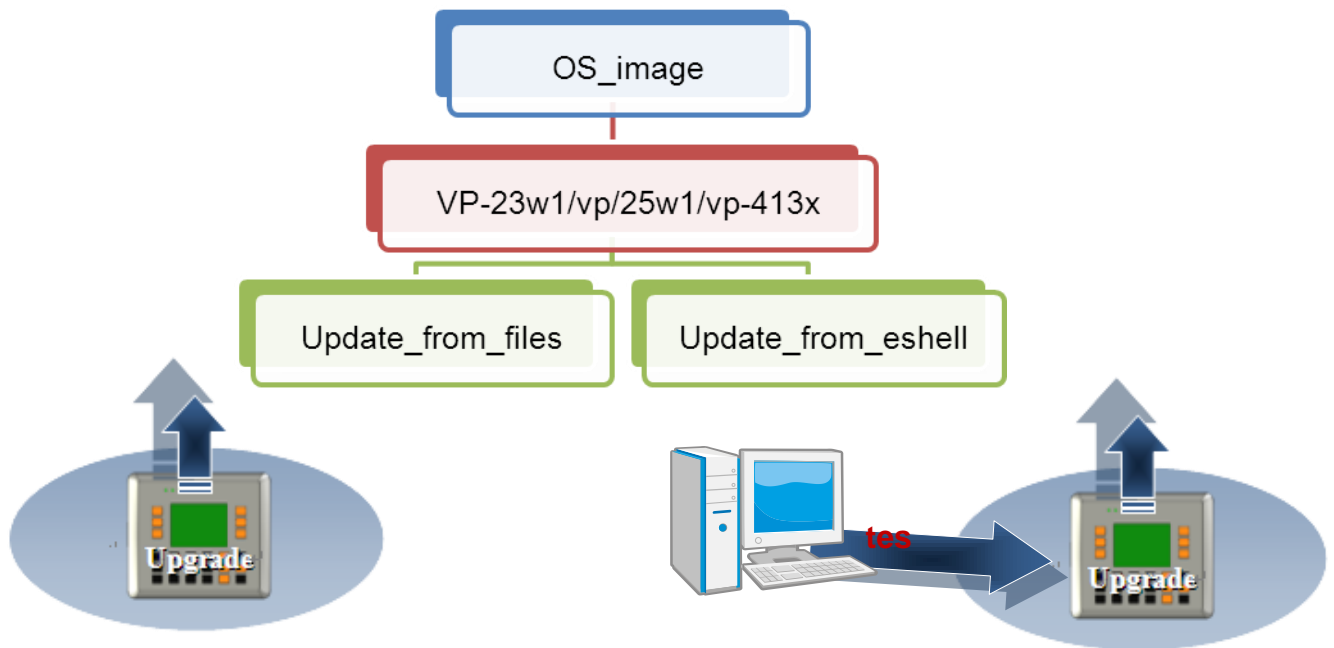

The ViewPAC OS supports multi-language:

- i. en- English**
- ii. sc- Simplified Chinese**
- iii. tc- Traditional Chinese**

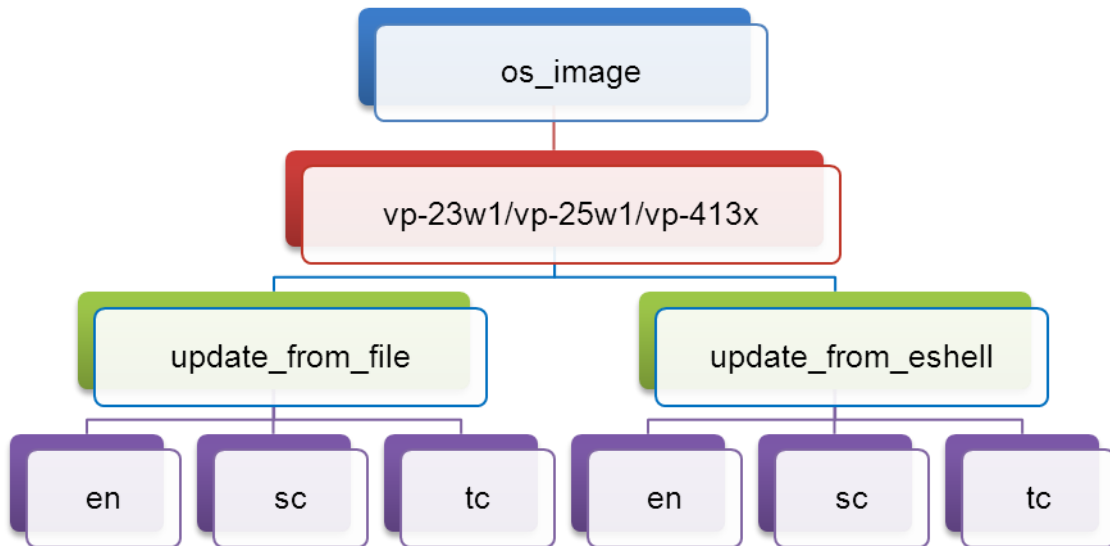


## 7.1.1. Updating the Boot Loader and the ViewPAC OS image from files

There are two different ways of ViewPAC OS image update:

**i. ViewPAC OS updates from files** (Please refer to this section)


We recommend that you use this method for quick and easy to update the ViewPAC OS image

**ii. ViewPAC OS updates from eshell tool** (Please refer to section “6.1.2. Updating the ViewPAC OS image from eshell”)

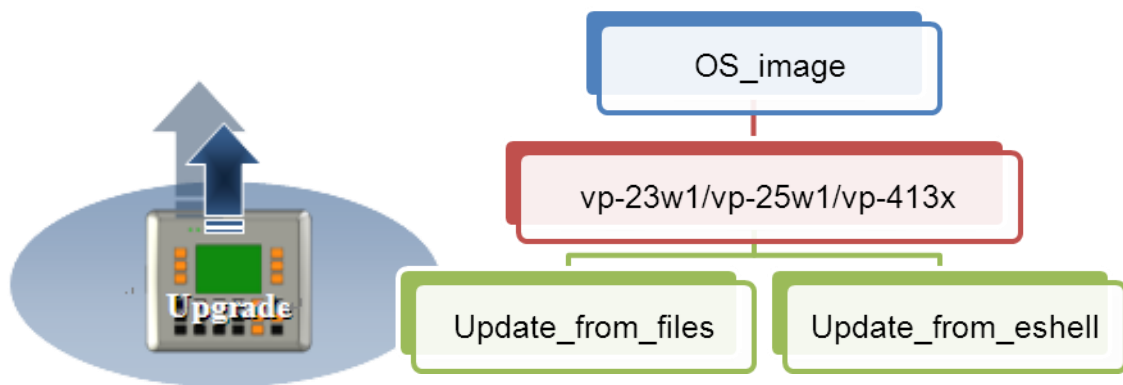

**Step 1: Get the latest version of the execute file and the corresponding “autoinit.bat” file and run it on the ViewPAC side**

Each folder contains an execute file and a corresponding “autoinit.bat” file.

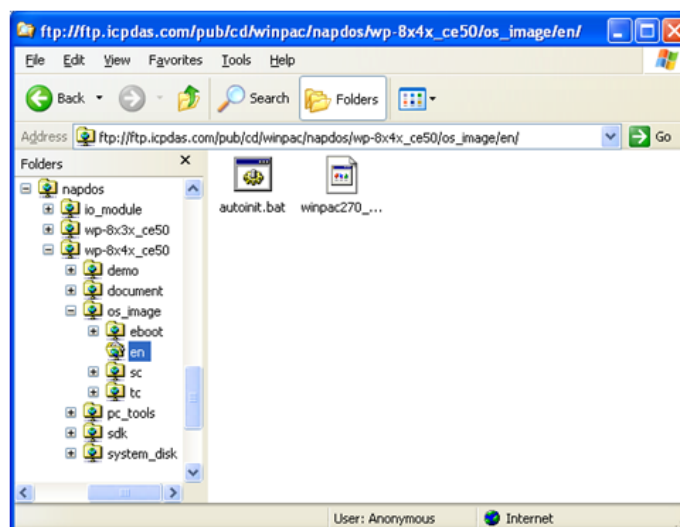


**Step 2: Get the latest version of the installation package and download it to ViewPAC, then execute it**

**For VP-23W1:**

The latest version of the installation package can be obtained from:

CD:\Napdos\vp-2000\_ce50\os\_image\vp-23w1\update\_from\_file\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/os\\_image/vp-23w1/update\\_from\\_file/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/os_image/vp-23w1/update_from_file/)

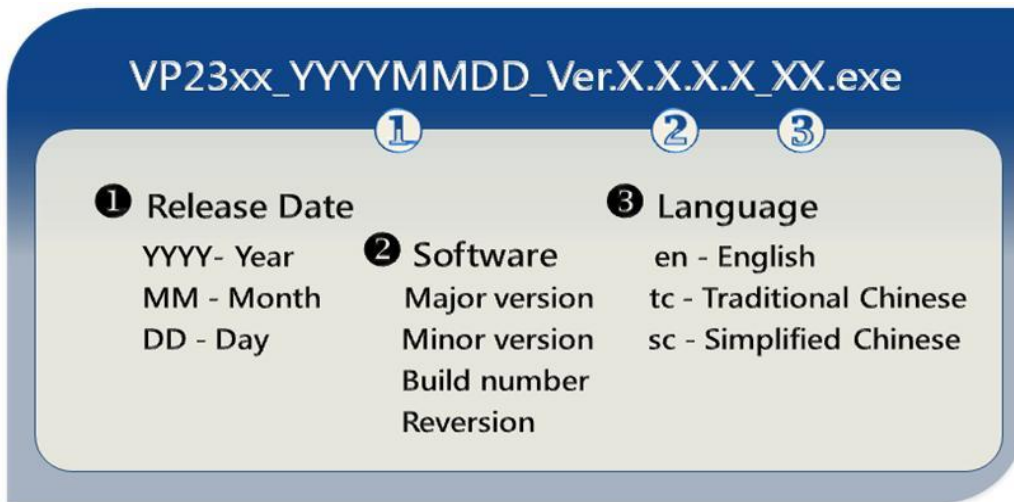

**VP23xx\_YYYYMMDD\_Ver.X.X.X.X\_XX.exe**

1	2	3
<b>1 Release Date</b> YYYY - Year MM - Month DD - Day	<b>2 Software</b> Major version Minor version Build number Reversion	<b>3 Language</b> en - English tc - Traditional Chinese sc - Simplified Chinese

**For VP-25W1:**

The latest version of the installation package can be obtained from:

CD:\Napdos\vp-2000\_ce50\os\_image\vp-25w1\update\_from\_file\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/os\\_image/vp-25w1/update\\_from\\_file/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/os_image/vp-25w1/update_from_file/)



**VP25xx\_YYYYMMDD\_Ver.X.X.X.X\_XX.exe**


1	2	3
<b>1 Release Date</b> YYYY - Year MM - Month DD - Day	<b>2 Software</b> Major version Minor version Build number Reversion	<b>3 Language</b> en - English tc - Traditional Chinese sc - Simplified Chinese

## For VP-41xx:

The latest version of the installation package can be obtained from:

CD:\Napdos\vp-2000\_ce50\os\_image\vp-413x\update\_from\_file\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/os\\_image/vp-413x/update\\_from\\_file/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/os_image/vp-413x/update_from_file/)

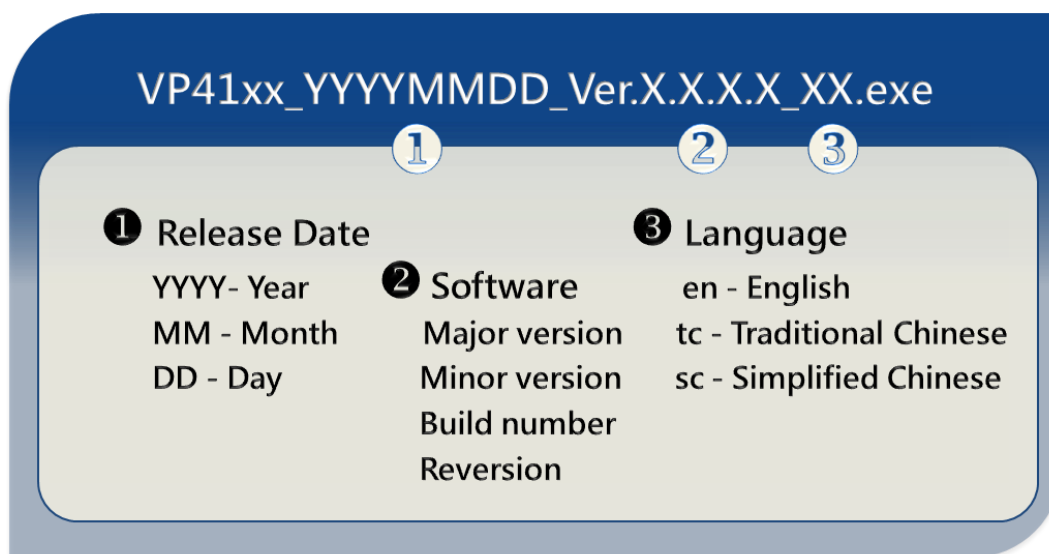

There are several ways to download the installation package to ViewPAC:


- ▶ On the ViewPAC, you can download the installation package via an Ethernet connection.
- ▶ On the host PC, you can download the installation package to ViewPAC via a USB storage device, the removable Micro SD card or FTP server.

The latest version of the ViewPAC OS image file can be obtained from:

CD:\Napdos\vp-2000\_ce50\OS\_image\

[http://www.icpdas.com/products/PAC/ViewPAC/download/ViewPAC\\_8000/download\\_os\\_images.htm](http://www.icpdas.com/products/PAC/ViewPAC/download/ViewPAC_8000/download_os_images.htm)


**Step 3: After execute the installation package, the “Warning !” dialog will display, then click the “OK” button to start the update instructions**

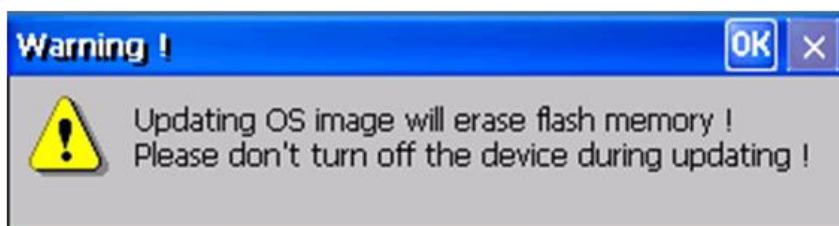


**Step 4: On the main dialog, click the “Update Now” button**



**Step 5: On the “Warning !” dialog, click the “Yes” button**

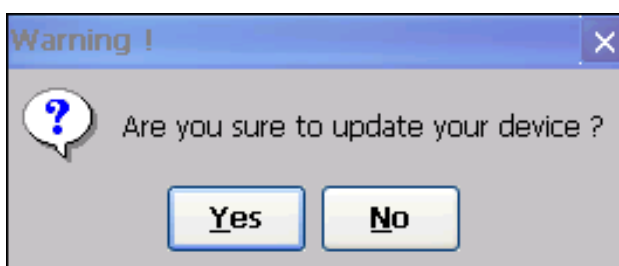

**Step 6: On the main dialog, click the “Update Now” button to start**

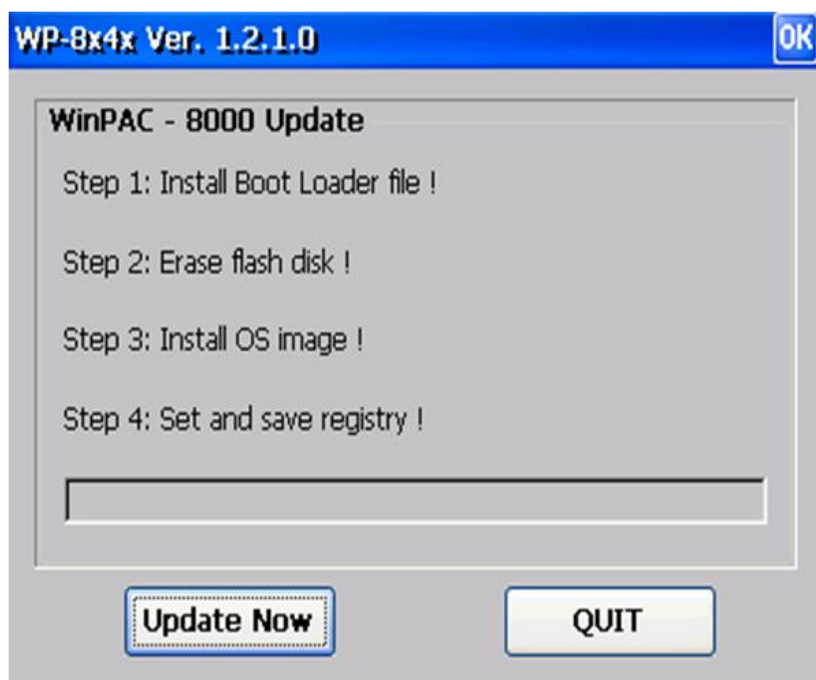

**installation**

### **Tips & Warnings**


---



Please never turn the ViewPAC off during OS load. Besides we recommend you turn off all other application before updating.

---

The installation will perform the following tasks:

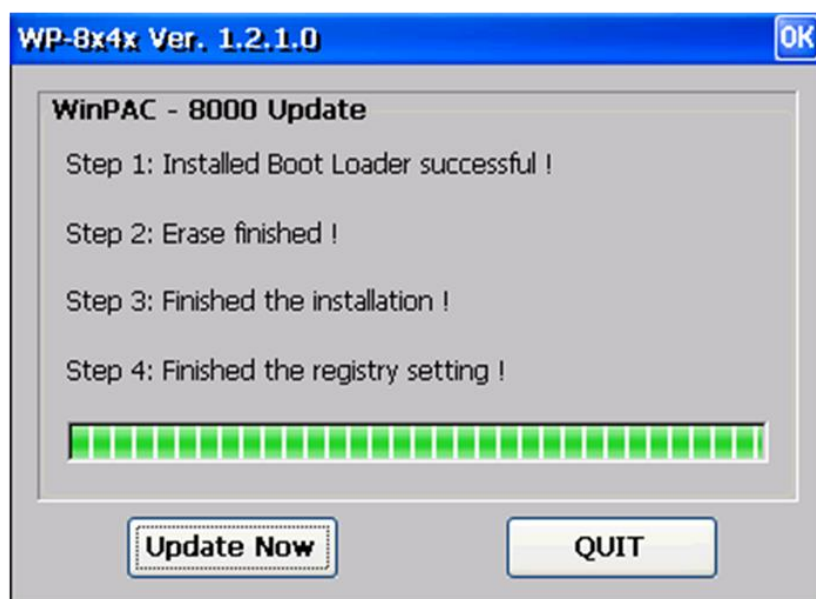

i. Install Boot Loader file

### Important Warning

---



Be careful, if the boot loader broken off in this step and cannot restart in safe mode, you have to send it back to us.

---

ii. Erase flash disk

iii. Install OS image

iv. Set registry settings to default

### Tips & Warnings


---



This step will reset the registry settings to default, all of your before settings will lost.




**Step 7: After completing the above-mentioned tasks, the “Warning !” dialog will appear as follow, after clicking “OK” button to finish updating OS image, be sure the ViewPAC at normal mode**

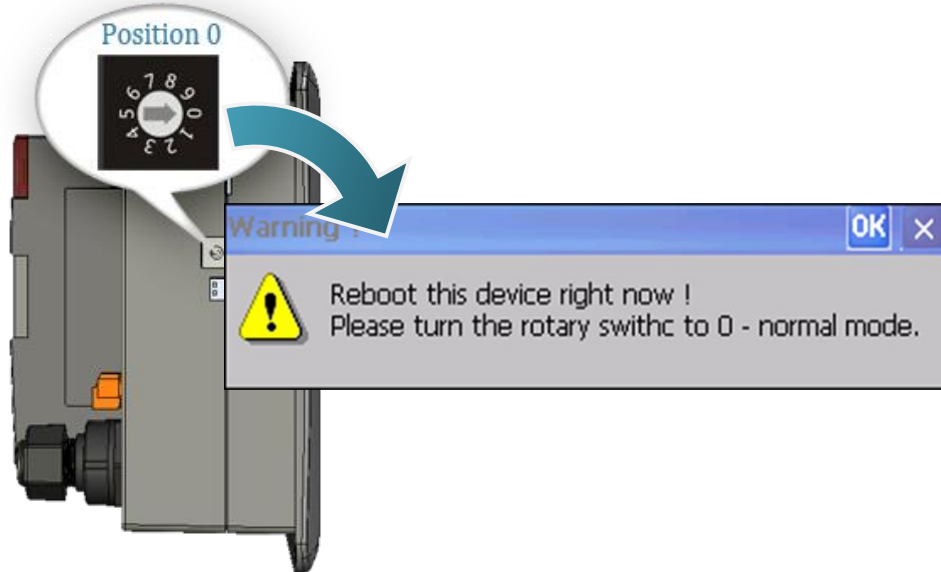

**Step 8: Check the ViewPAC OS version**

Start the ViewPAC\_Utility, and then select the “System Information” tab to check the current OS version.

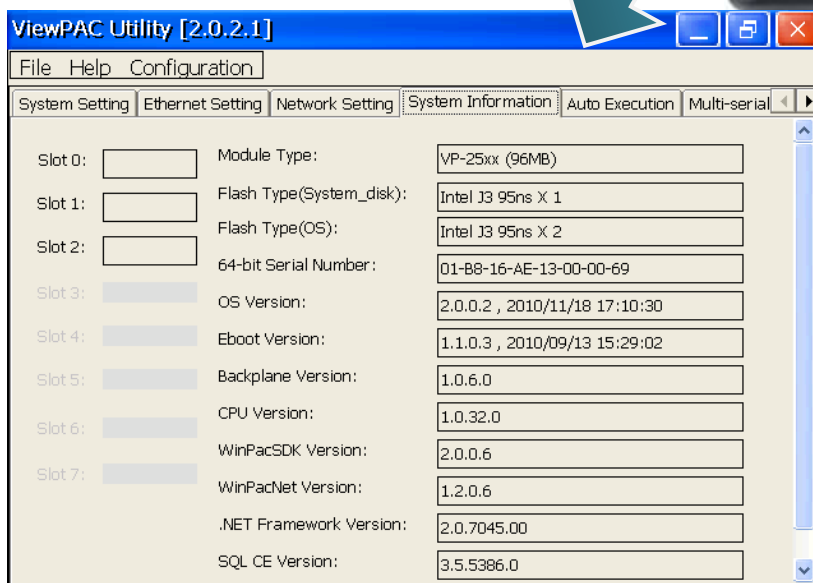



## 7.1.2. Updating the ViewPAC OS image from eshell

There are two different ways of ViewPAC OS image update:

**i. ViewPAC OS updates from files** (Please refer to this section)

We recommend that you use this method for quick and easy to update the ViewPAC OS image

**ii. ViewPAC OS updates from eshell tool** (Please refer to section “6.1.2. Updating the ViewPAC OS image from eshell”)

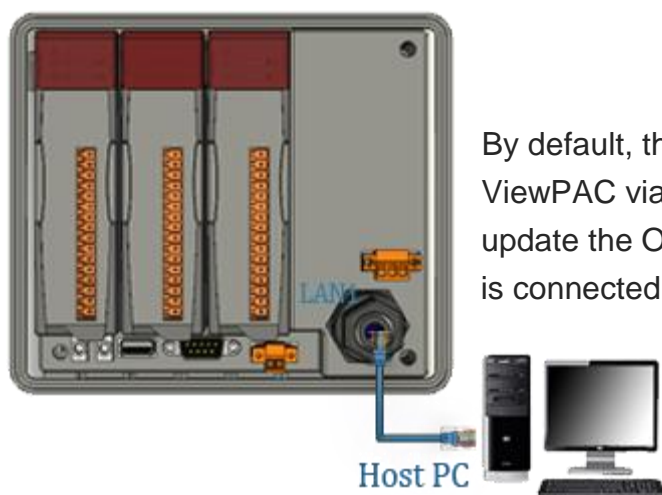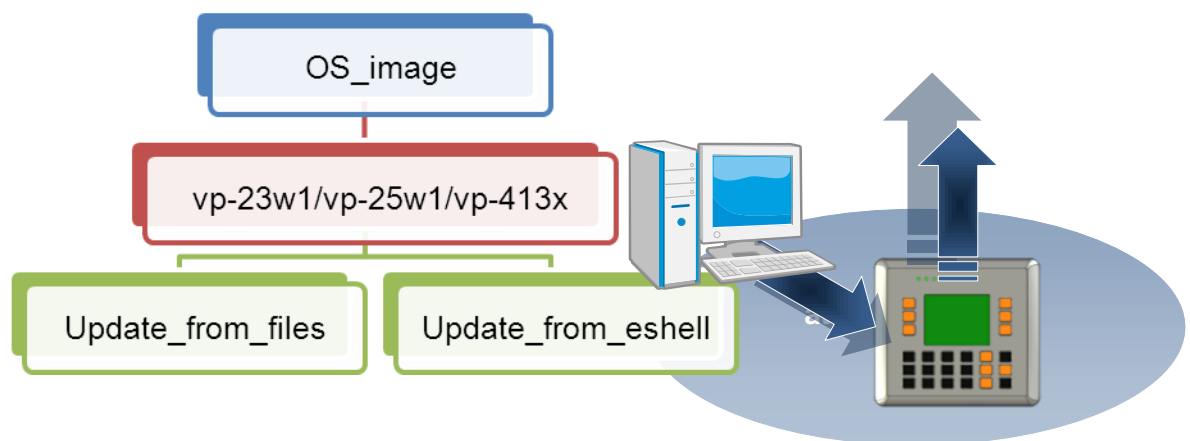

By default, the OS update from Host PC to ViewPAC via Ethernet. Therefore, to update the OS image, make sure Ethernet is connected to the PC.


## Step 1: Get the latest version of the ViewPAC OS image

### For VP-23W1:

The latest version of the installation package can be obtained from:

CD:\Napdos\vp-2000\_ce50\os\_image\vp-23w1\update\_from\_Eshell\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/os\\_image/vp-23w1/update\\_from\\_Eshell/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/os_image/vp-23w1/update_from_Eshell/)

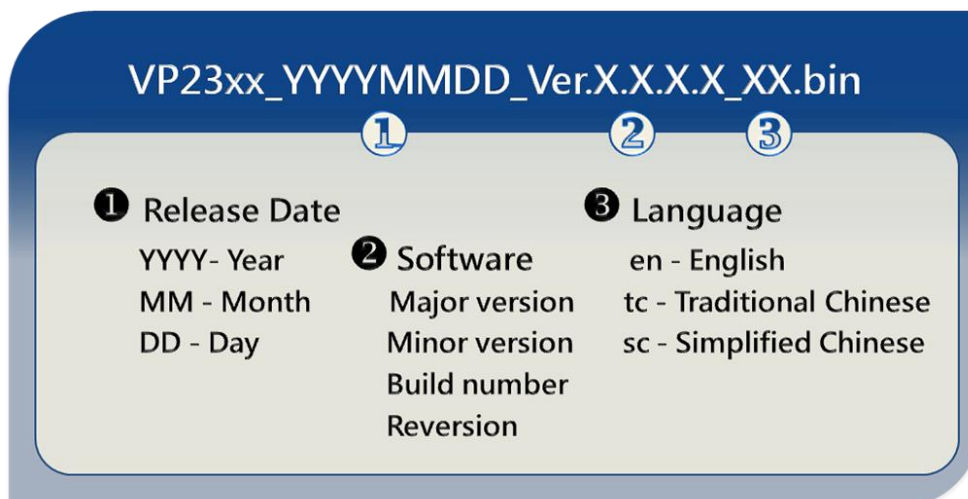

The diagram shows the filename structure: **VP23xx\_YYYYMMDD\_Ver.X.X.X.X\_XX.bin**. It is divided into three numbered sections:


- 1 Release Date**: YYYY - Year, MM - Month, DD - Day
- 2 Software**: Major version, Minor version, Build number, Reversion
- 3 Language**: en - English, tc - Traditional Chinese, sc - Simplified Chinese

### For VP-25W1:

The latest version of the installation package can be obtained from:

CD:\Napdos\vp-2000\_ce50\os\_image\vp-25w1\update\_from\_Eshell\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/os\\_image/vp-25w1/update\\_from\\_Eshell/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/os_image/vp-25w1/update_from_Eshell/)

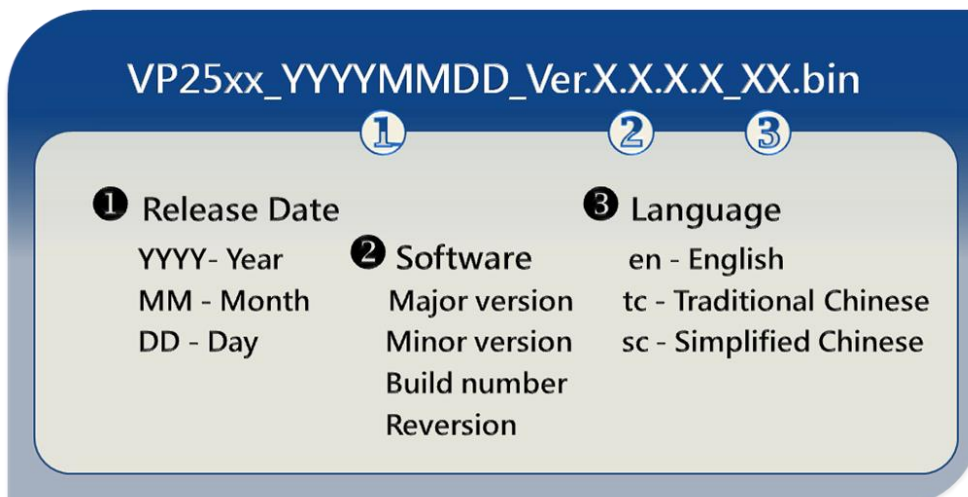

The diagram shows the filename structure: **VP25xx\_YYYYMMDD\_Ver.X.X.X.X\_XX.bin**. It is divided into three numbered sections:

- 1 Release Date**: YYYY - Year, MM - Month, DD - Day
- 2 Software**: Major version, Minor version, Build number, Reversion
- 3 Language**: en - English, tc - Traditional Chinese, sc - Simplified Chinese

## For VP-41xx:

The latest version of the installation package can be obtained from:

CD:\Napdos\vp-2000\_ce50\os\_image\vp-413x\update\_from\_Eshell\

[http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000\\_ce50/os\\_image/vp-413x/update\\_from\\_Eshell/](http://ftp.icpdas.com/pub/cd/winpac/napdos/vp-2000_ce50/os_image/vp-413x/update_from_Eshell/)

### VP41xx\_YYYYMMDD\_Ver.X.X.X.X\_XX.img

<b>1</b>	<b>2</b>	<b>3</b>
<b>1 Release Date</b> YYYY - Year MM - Month DD - Day	<b>2 Software</b> Major version Minor version Build number Reversion	<b>3 Language</b> en - English tc - Traditional Chinese sc - Simplified Chinese

## Step 2: Run the ESHELL software on the Host PC



ESHELL

ESHELL you can be obtained at:

CD:\Napdos\wp-8x4x\_ce50\PC\_Tools\Eshell\

[ftp://ftp.icpdas.com/pub/cd/ViewPAC/napdos/wp-8x4x\\_ce50/pc\\_tools/eshell/](ftp://ftp.icpdas.com/pub/cd/ViewPAC/napdos/wp-8x4x_ce50/pc_tools/eshell/)


### Step 3: Reboot the ViewPAC at update OS mode

Turn the rotary switch to “3”, and then reboot the ViewPAC.




### Step 4: Select the device which you want to update the OS image


After starting the ESHELL software, the “Select Device” dialog will appear, and then select the device which you want.

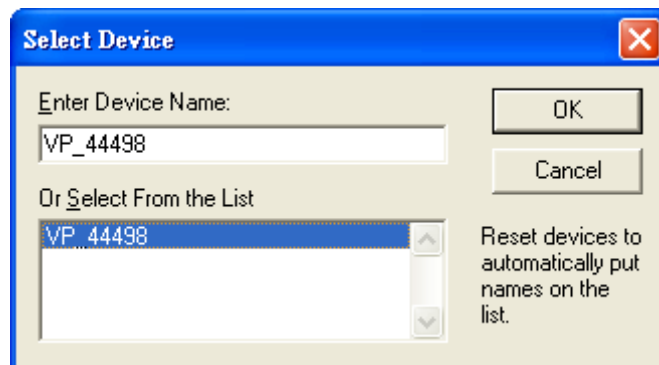

**Step 5: Select the latest version of the OS image**

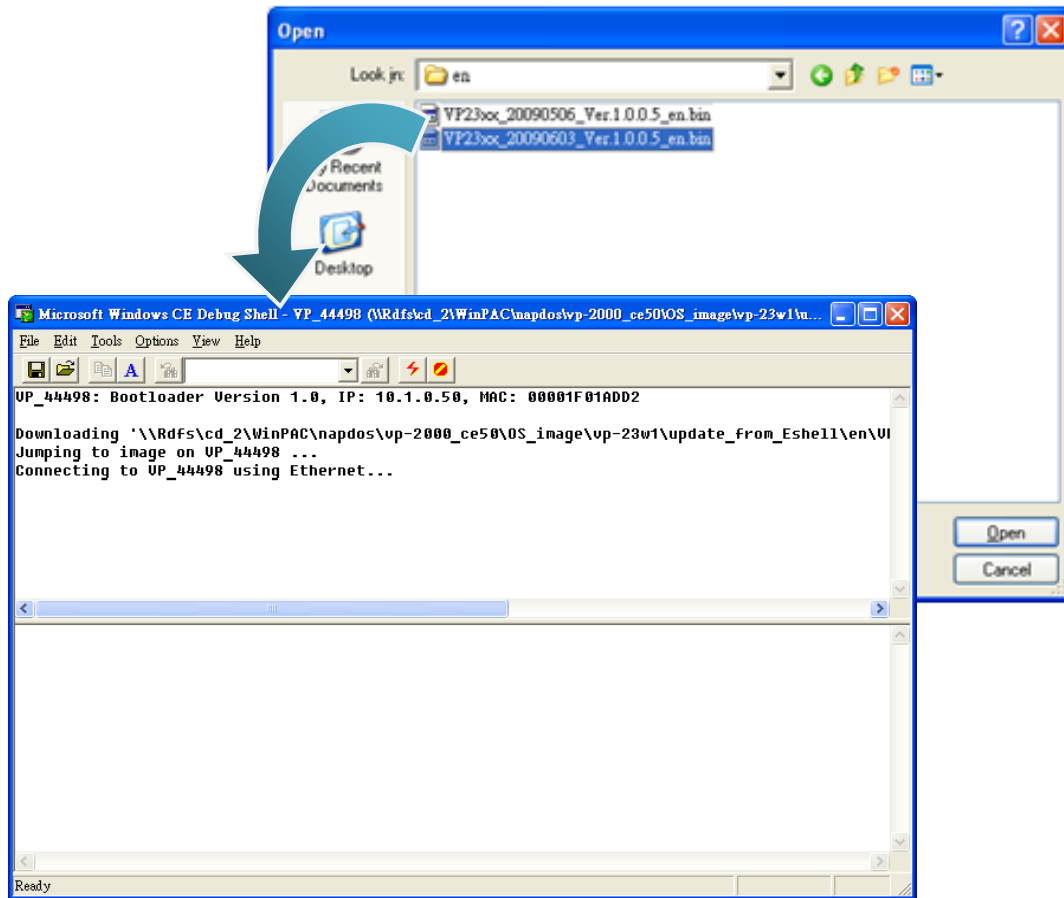


**Step 6: Once the procedure is completed, the “Warning !” dialog box will Appear on ViewPAC screen as below shown, before clicking the “Yes” button, you must first turn the rotary switch to the “0” position**

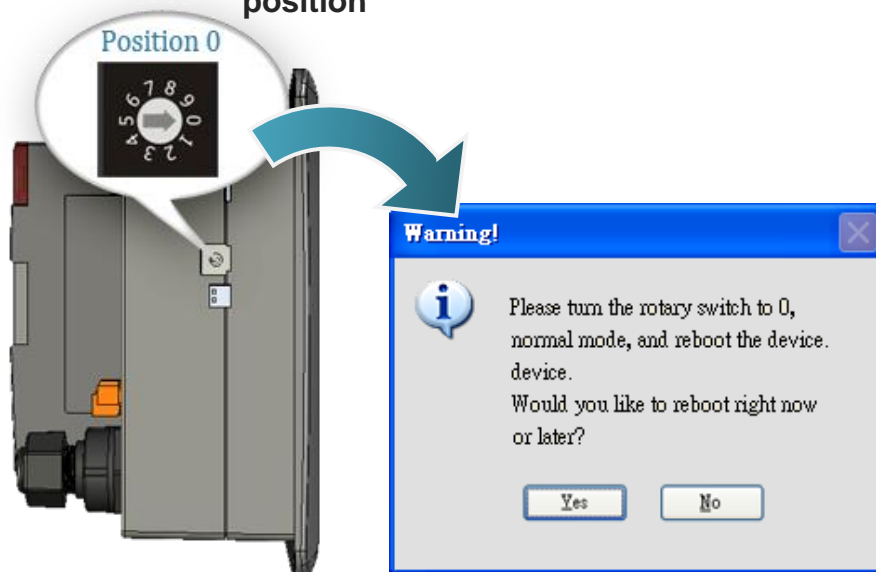

### Step 7: Check the ViewPAC OS version


Start the ViewPAC\_UTILITY, and then select the “System Information” tab to check the current OS version.

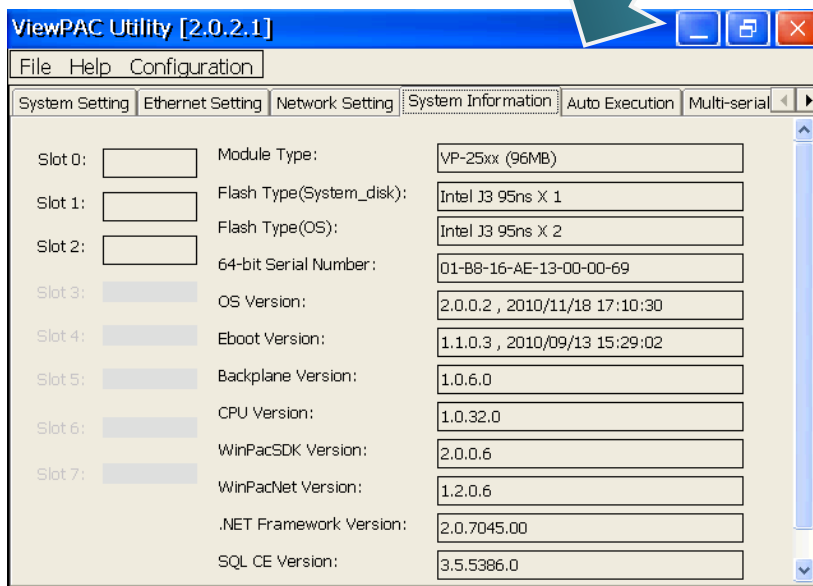

## 7.2. SDKs Updates

The updates files of SDK image are located on:

CD:\Napdos\vp-2000\_ce50\SDK\

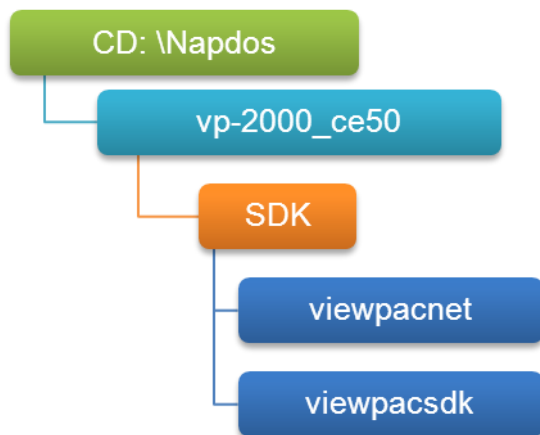

By eVC and donet development tools, the ViewPAC SDK installation is divided into the following two parts:

By eVC and donet development tools, the WinPAC SDK installation is divided into the following two parts:

- i. WinPAC SDK updates for dotnet**
- ii. WinPAC SDK updates for eMbedded Visual C++**



## 7.2.1. WinPAC SDK updates for C# or VB.net

To determine the SDK version that is compatibly running on the WinPAC, you can read the “Release Note” which is located under each SDK folder, these files provides important updated information for what we fixed and added.

### **Step 1: Get the latest version of the C# or VB.net components**

The latest version of the C# or VB.net components can be obtained from:

[ftp://ftp.icpdas.com/pub/cd/WinPAC/napdos/wp-8x4x\\_ce50/sdk/WinPACNet/](ftp://ftp.icpdas.com/pub/cd/WinPAC/napdos/wp-8x4x_ce50/sdk/WinPACNet/)

### **Step 2: Copy the latest version of DLL to Host PC and WinPAC**

The DLL files on Host PC are located at anywhere only the solution can reference it.

The DLL files on WinPAC are located at the same directory as the .exe file.

## 7.2.2. WinPAC SDK updates for eMbedded Visual C++

To determine the SDK version that is compatibly running on the WinPAC, you can read the “Release Note” which is located under each SDK folder, these files provides important updated information for what we fixed and added.

### **Step 1: Get the latest version of the eMbedded Visual C++ components**

The latest version of the eMbedded Visual C++ components can be obtained from:

[ftp://ftp.icpdas.com/pub/cd/WinPAC/napdos/wp-8x4x\\_ce50/sdk/WinPACSDK/](ftp://ftp.icpdas.com/pub/cd/WinPAC/napdos/wp-8x4x_ce50/sdk/WinPACSDK/)

### **Step 2: Copy the latest version of header files and libraries to Host PC**

The header files are located at:

C:\Program Files\Windows CE Tools\wce500\PAC270\Include

The libraries are located at:

C:\Program Files\Windows CE Tools\wce500\PAC270\Lib

### **Step 3: Copy the latest version of DLL files to WinPAC**

The DLL files are located at:

\System\_Disk\ICPDAS\System

# 8. ViewPAC Download Center

This chapter introduces the ViewPAC-2000 Download Center.

Visit the ViewPAC Download Center:

[http://www.icpdas.com/products/PAC/viewpac/download/viewpac/download\\_os\\_images.htm](http://www.icpdas.com/products/PAC/viewpac/download/viewpac/download_os_images.htm)

The screenshot shows the 'ViewPAC Download Center' website. At the top, it says 'ViewPAC Download Center (For WinCE based ViewPAC)'. Below this is a 'Note' section with text about checking compatibility. A navigation bar contains tabs for 'OS images', 'SDK', 'Utility & Tools', 'Demo', 'Documents', and 'System Disk'. The 'Utility & Tools' tab is active, showing a sub-section titled 'ViewPAC Utility and Tools'. This section has another 'Note' and a table for 'ViewPAC Utility' with columns for Version, Last update, Compatibility, HTTP, and FTP. The table lists version 2.0.0.8, updated in Jun. 2009, for compatibility with VP-23Wx / VP-25Wx. Below the table is a description of the tools.

**Note:**  
When you download the software programs, you should notice if the programs conform to your machine. The published date and indicated requirement of a program can help user to determine the compatibility for your ViewPAC. Before you download any program, please read the notes of each online program first to avoid the confused situation.

**Note:**  
Please consider the suitability over your application. If you get any problems caused by updating the ViewPAC Utility software, please feedback to your local seller and ask essential help & services.

ViewPAC Utility			HTTP	FTP
Version	Last update	Compatibility		
2.0.0.8	Jun. 2009	VP-23Wx / VP-25Wx		

Tools to save / view the system information registry and setup the HTTP / FTP path and update non-volatile internal memory within ViewPAC

The following update categories are available from the ViewPAC Download Center.

- ✓ **OS images** Includes updates and the latest version of ViewPAC OS.
- ✓ **ViewPAC SDK** Includes updates and the latest version of each ViewPAC component SDK, such as ViewPAC SDK, NAPOPC\_CE5 SDK, Modbus SDK, etc.
- ✓ **Utility & Tools** Includes updates and the latest version for ViewPAC toolkits


- ✓ **Demo** Includes all related ViewPAC demos.
- ✓ **Documents** Includes updates and the latest version for related ViewPAC documents.
- ✓ **System Disk** Includes updates and the latest version for ViewPAC toolkits

# 9. How to change the batteries

---

RTC and SRAM data is retained by two Li batteries, which can supply continuous power to the 512 KB SRAM to ensure that the data is retained for 5 years. The dual-battery design has the added function of preventing data from being lost while replacing the battery.

The following figures show the location of the two batteries installed in the ViewPAC.

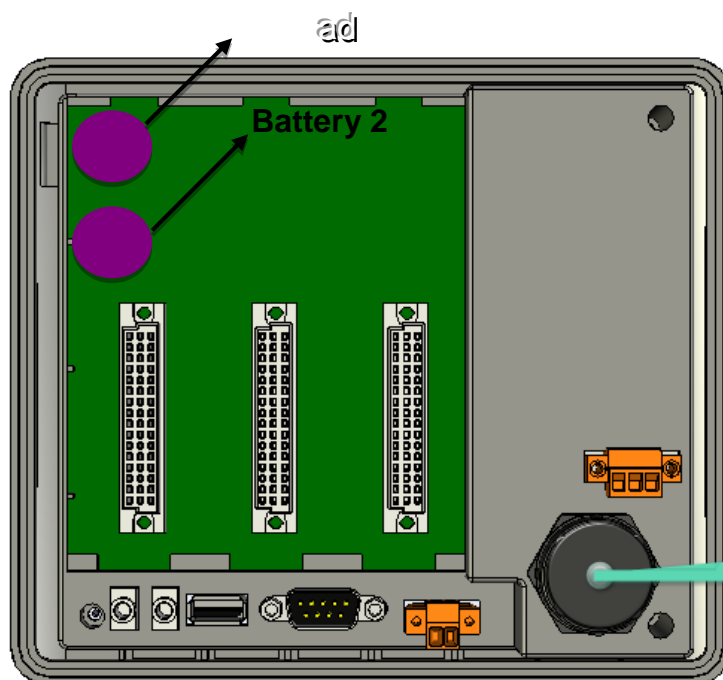

Checking the current battery power:

1. Run the ViewPAC utility and check the Battery1 and Battery2 fields that display the current status of each battery. Refer to Section 3.5 ViewPAC utility “System Settings Tab” for more details. If the power level for either of the batteries is low, both should be replaced. Note which battery has the lowest power level.

2. When programming this, call the `pac_GetBatteryLevel()` API function in the PACSDK.dll to check whether the battery power is low. When the power for either of the batteries is low, it's recommended that the battery is replaced immediately, otherwise the data on the SRAM may be lost or RTC time will be reset.

**Note:**

The battery initial voltage should be around 2.8~3.0V, when below 2.1V, the WinPAC/ViewPAC Utility will show the low power warning. When below 1.5V, the data in the RTC (real time clock) and 512KB SDRAM will be lost.

**1 Replacing the battery without losing data**

- 1.1 Power off the ViewPAC device.
- 1.2 Remove the cover of the module inserted into the slot.
- 1.3 First, remove the battery that is running low on power from the battery holder.
- 1.4 Insert a new battery.
- 1.5 Remove the other battery.
- 1.6 Insert a new battery.

**Notes:**

1. If the battery power for only one of the two batteries is low, you can use this method to replace the battery so as to prevent data from being lost. (In the circuit design for the ViewPAC series, When the power for one of the batteries is low, it will automatically switch to the other one to ensure continued battery power)
2. If both batteries have run out of power, the data will be lost, even if this method is used to replace the batteries.

**2 Replacing the battery – 2**

Back up the SRAM data using a backup utility before replacing the battery. Refer to Section 2.8 “Using the Backup Utility to back up the settings and files” to back up and restore the SRAM data.

- 2.1 Run the backup utility to back up the SRAM data.
- 2.2 Power off the ViewPAC device.
- 2.3 Remove the cover of the module inserted into the slot.
- 2.4 Remove both batteries from their respective holders.
- 2.5 Insert two new batteries.
- 2.6 Power on the ViewPAC device.
- 2.7 Run the backup utility to restore the SRAM data.
- 2.8 Set the RTC time.

**Ordering information**

Battery type: BR1632 (Part number is 2LB010 for ICP DAS)

For more detailed information, contact your local sales office or distributor.

# Appendix A. I-8K and I-87K Modules

---

There are 3 slot options to expand local I/O. And the I/O modules can be parallel bus type (high profile I-8K series) and serial bus type (high profile I-87K series).

The difference between them is

Item	I-8K Series	I-87K Series
Communication interface	Parallel bus	Serial bus
Protocol	-	DCON
Communication speed	Fast	Slow
DI latched function	-	Yes
Counter input (for digital input module)	-	Yes (100 Hz)
Power on value	-	Yes
Safe value	-	Yes
Programmable slew-rate for AO module	-	Yes

## **Appendix B. Application of RS-485 Network**

---

The RS-485 length can be up to 4000 ft or 1.2 km over a single set of twisted-pair cables, if the RS-485 network is over 4000 ft or 1.2Km, the RS-485 repeater must be added to extend the RS-485 network.



## B.1. Basic RS-485 Network

The basic component of the RS-485 network consist of a Master Controller (or using a PC as a host controller), and some RS-485 devices.

### Tips & Warnings

---




If PC/Laptop has no COM port, you can use the I-7561 (USB to RS-485 converter) for connection between ViewPAC and PC/Laptop.

Before using the I-7561 converter, you must install the USB driver. The USB driver can be obtained from:


<ftp://ftp.icpdas.com/pub/cd/8000cd/napdos/7000/756x/>

---

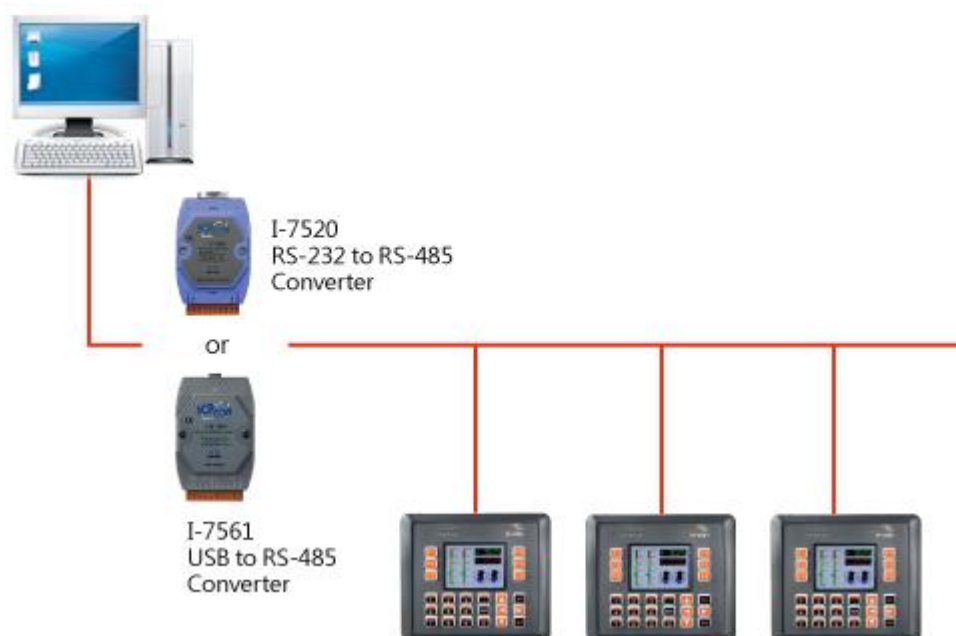


## B.2. Daisy Chain RS-485 Network

All RS-485 devices are wired directly to the main network, If the network is up to 1.2 km, it will need a repeater (7510 series) to extend the network length.

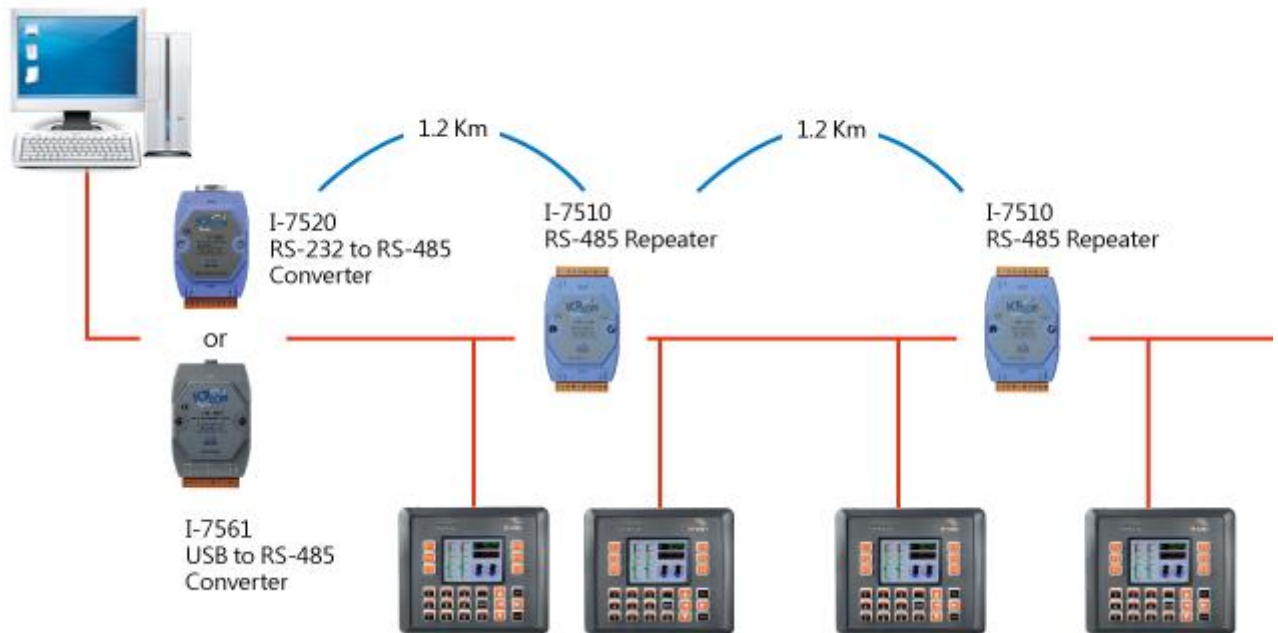


## B.3. Star Type RS-485 Network

There are branches along the main network. In this case, it is better to have a repeater to isolate or filter the noise that is made by devices.

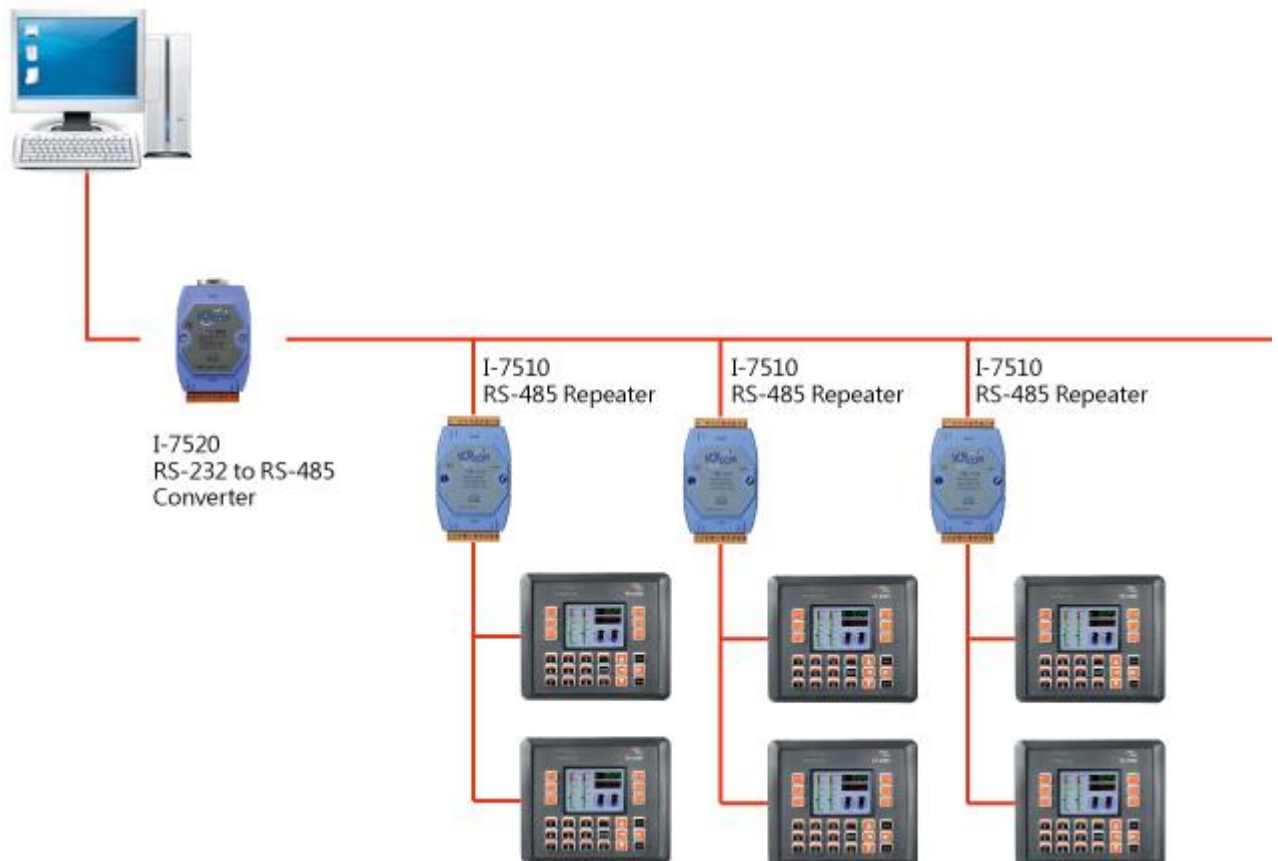


There is a better choice to use 7513 as a RS-485 hub on start type network.

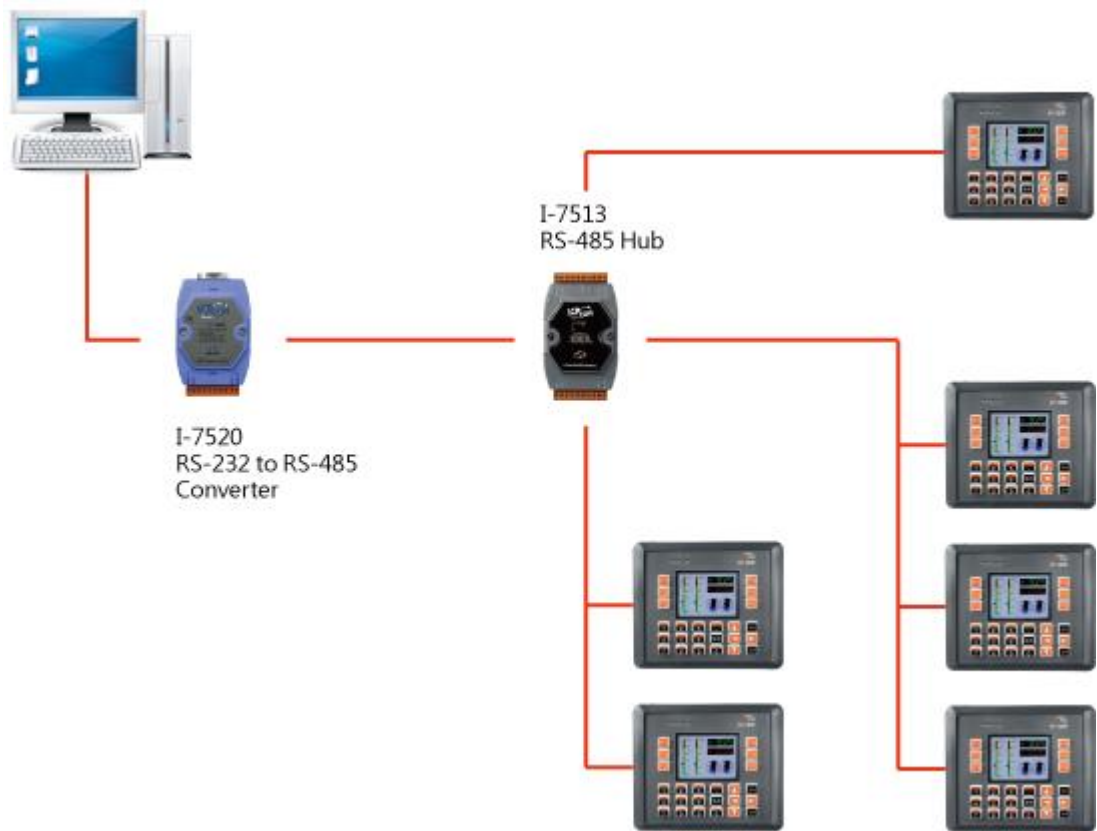

## B.4. Random RS-485 Network

There are branches along the main wire. In this case, it is better to have a repeater to isolate or filter the noise that is made by devices.

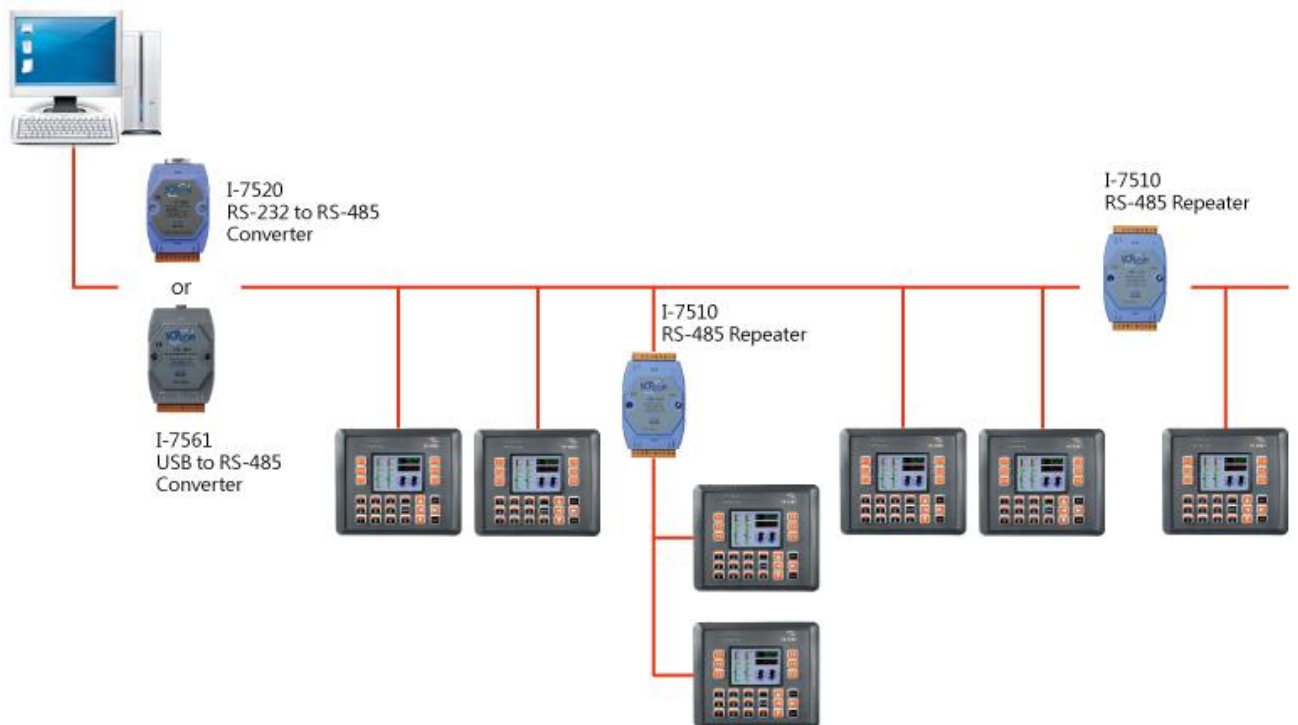


## **B.5. Master/Slaves Settings**

There must be exist one master to have a jumper in the same network. In a master/slave application, “Master” is the default configuration of ViewPAC.

## B.5.1. ViewPAC as a Master (default)


When one of ViewPAC is set to the master mode, then all the other devices on the same network must be set to the slave mode.

Set ViewPAC to the master mode by adjusting the jumpers on the power board of ViewPAC. Refer to the following figure:

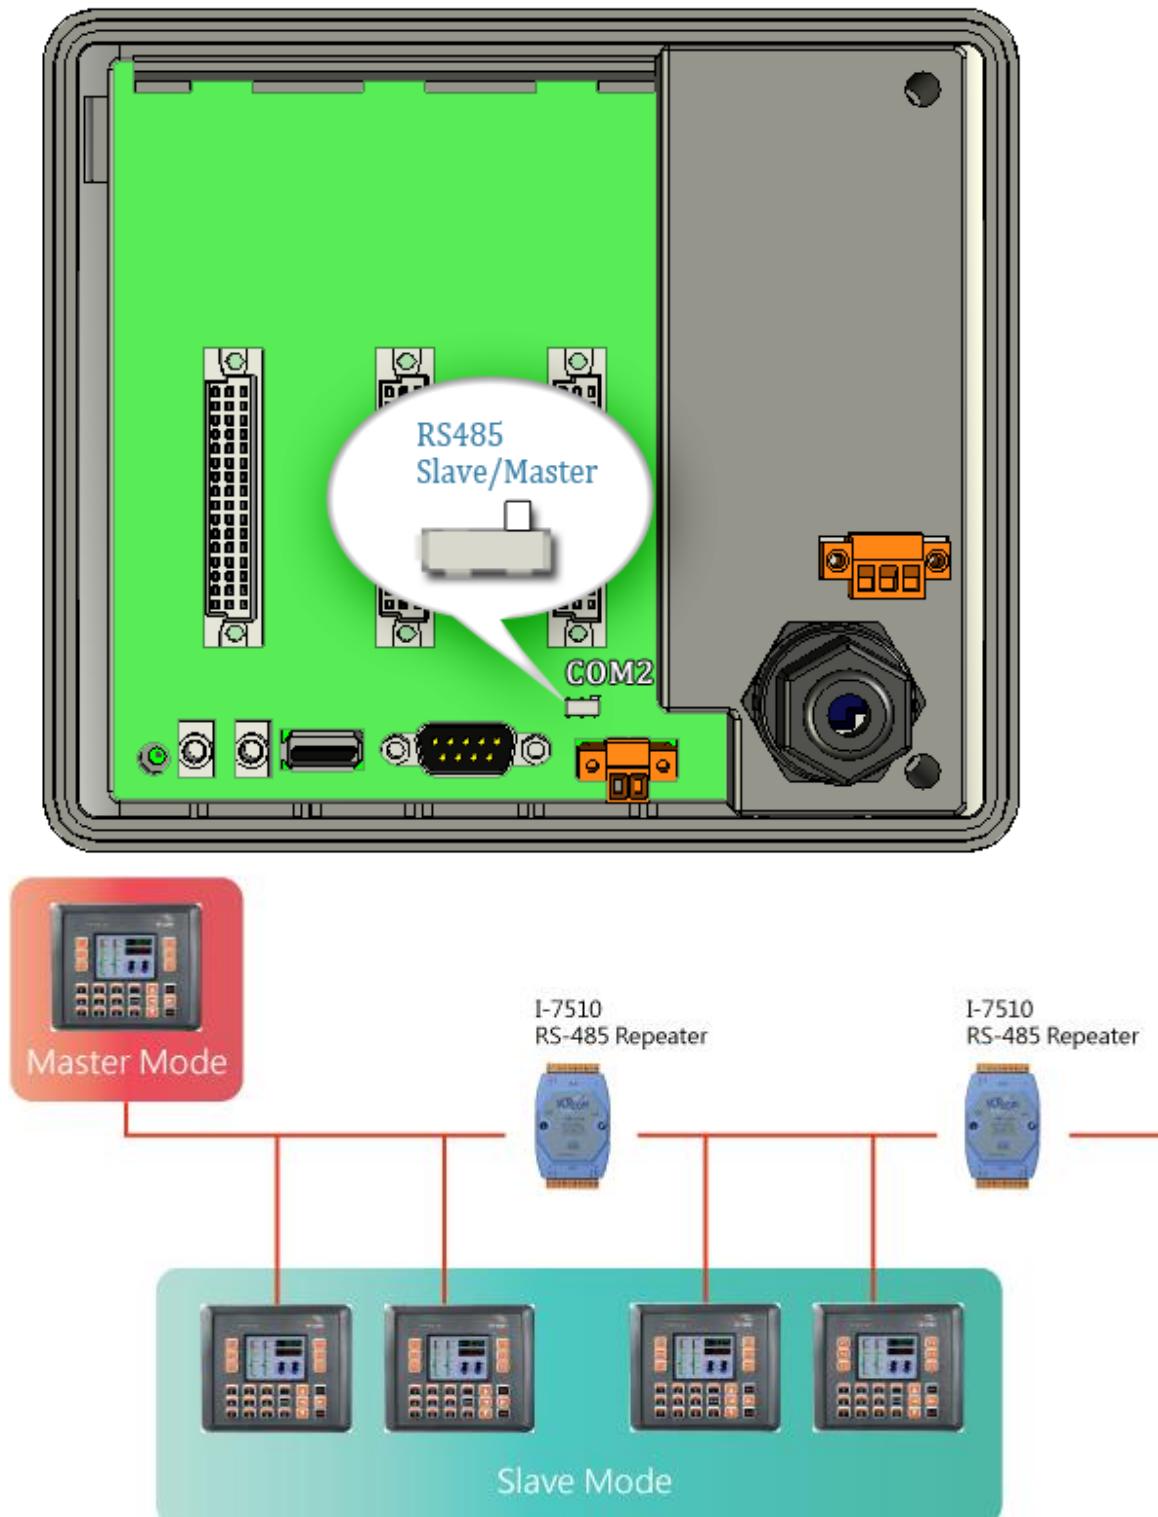


## B.5.2. ViewPAC as a Slave:

Set ViewPAC to the slave mode by adjusting the jumpers on the power board of ViewPAC. Refer to the following figure:

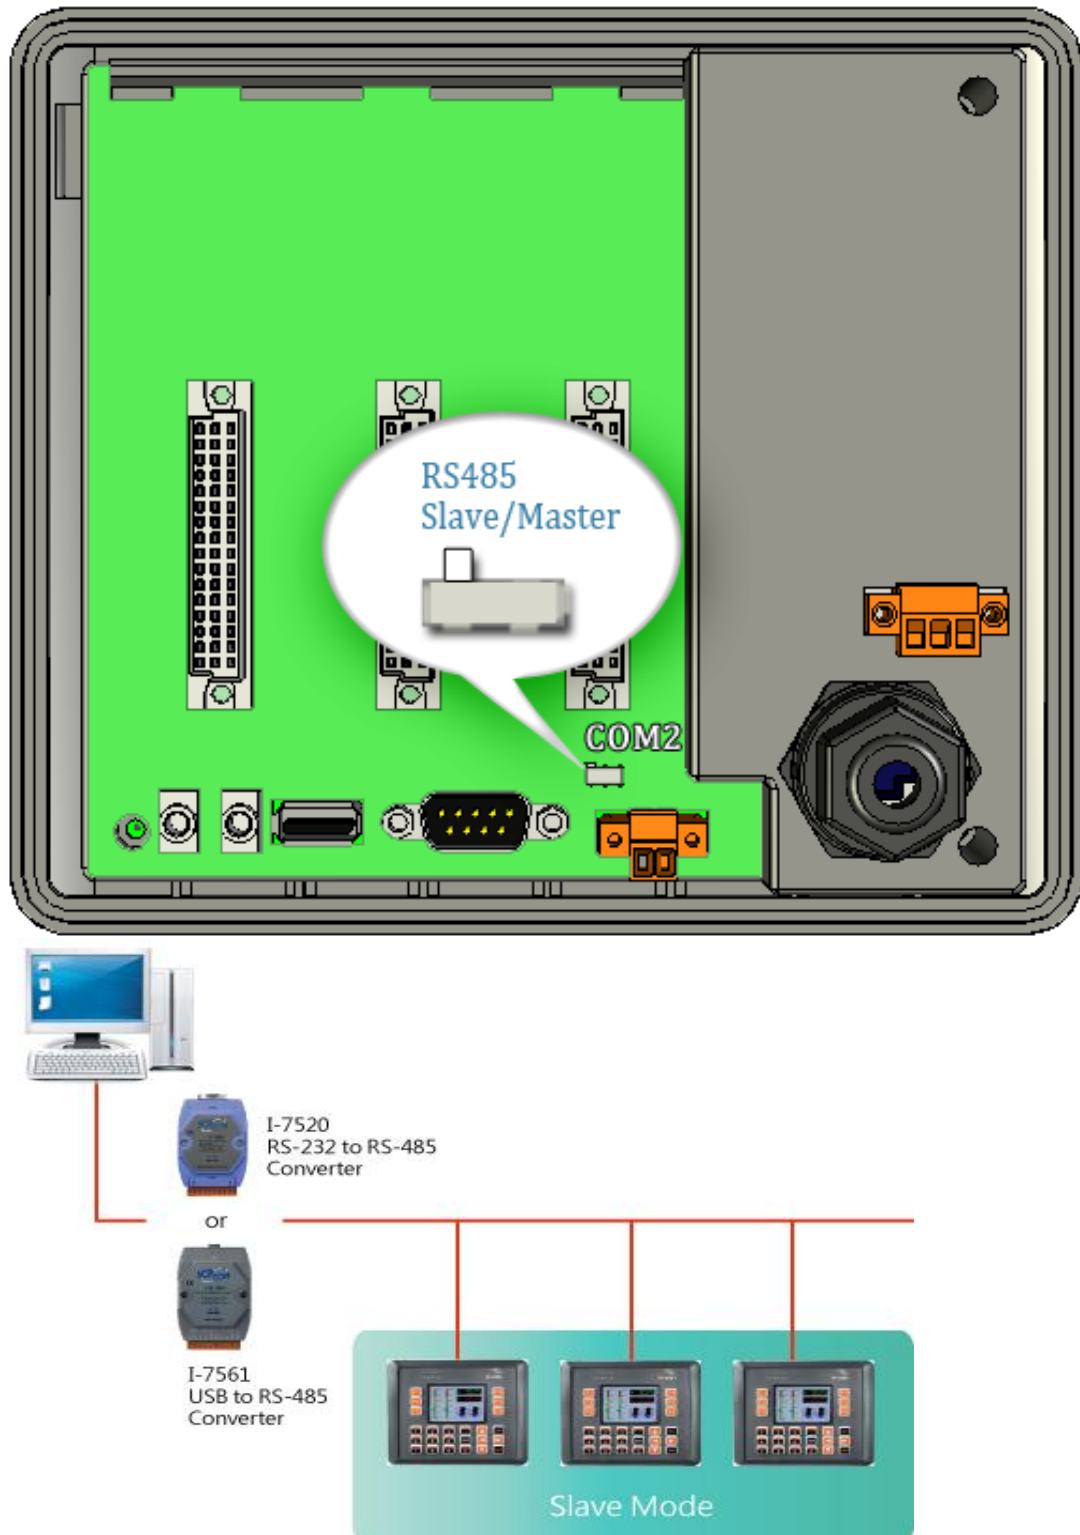



The maximum distance of RS-485 without using a repeater is 1,200 meters (4,000 feet). You can extend that distance by adding an RS-485 Repeater every 1,200 meters as shown below.

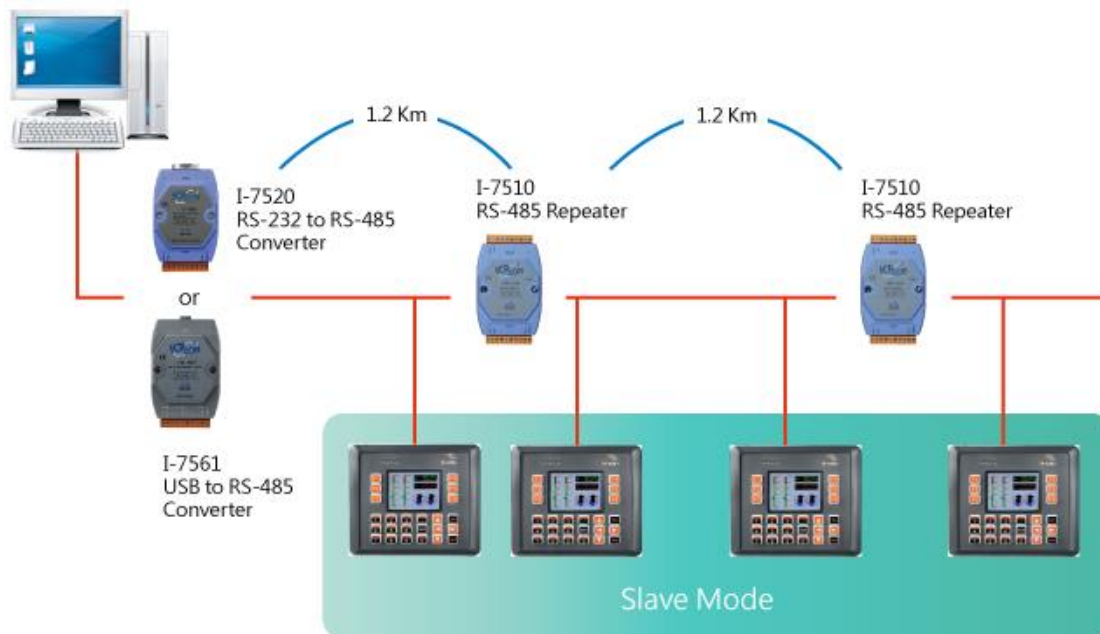

# **Appendix C. Tips – How to**

---

We will continue to add flexibility and support to the ViewPAC that always can be found at:


[http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x\\_ce50/document/faq/general\\_io\\_expansion/](http://ftp.icpdas.com/pub/cd/winpac/napdos/wp-8x4x_ce50/document/faq/general_io_expansion/)

The following sections will present several common application of ViewPAC.

## C.1 How to change the batteries

RTC and SRAM data is retained by two Li batteries, which can supply continuous power to the 512 KB SRAM to ensure that the data is retained for 5 years. The dual-battery design has the added function of preventing data from being lost while replacing the battery.

The right figure shows the location of the two batteries installed in the ViewPAC.

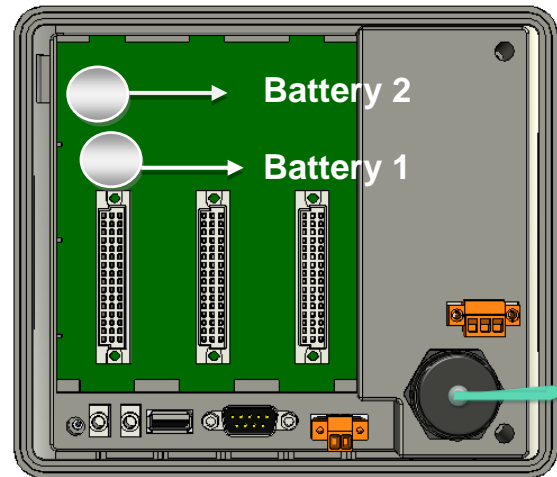

### Checking the current battery power:

1. Run the ViewPAC utility and check the Battery1 and Battery2 fields that display the current status of each battery. Refer to Section 3.5 ViewPAC utility “System Settings Tab” for more details. If the power level for either of the batteries is low, both should be replaced. Note which battery has the lowest power level.
2. When programming this, call the `pac_GetBatteryLevel()` API function in the PACSDK.dll to check whether the battery power is low. When the power for either of the batteries is low, it's recommended that the battery is replaced immediately, otherwise the data on the SRAM may be lost or RTC time will be reset.

### Note:

The battery initial voltage should be around 2.8~3.0V, when below 2.1V, the WinPAC/ViewPAC Utility will show the low power warning. When below 1.5V, the data in the RTC (real time clock) and 512KB SDRAM will be lost.

## Replacing the battery without losing data

1. Power off the ViewPAC device.
2. Remove the cover of the module inserted into the slot.
3. First, remove the battery that is running low on power from the battery holder.
4. Insert a new battery.
5. Remove the other battery.
6. Insert a new battery.

### Notes:

1. If the battery power for only one of the two batteries is low, you can use this method to replace the battery so as to prevent data from being lost. (In the circuit design for the ViewPAC series, When the power for one of the batteries is low, it will automatically switch to the other one to ensure continued battery power)
2. If both batteries have run out of power, the data will be lost, even if this method is used to replace the batteries.

## Replacing the battery – 2

Back up the SRAM data using a backup utility before replacing the battery. Refer to Section 2.8 “Using the Backup Utility to back up the settings and files” to back up and restore the SRAM data.

- 1 Run the backup utility to back up the SRAM data.
- 2 Power off the ViewPAC device.
- 3 Remove the cover of the module inserted into the slot.
- 4 Remove both batteries from their respective holders.
- 5 Insert two new batteries.
- 6 Power on the ViewPAC device.
- 7 Run the backup utility to restore the SRAM data.
- 8 Set the RTC time.

## Ordering information

Battery type: BR1632 (Part number is 2LB010 for ICP DAS)

For more detailed information, contact your local sales office or distributor.


## C.2. How to add a user account to remote login the ViewPAC from PC

### C.2.1. How to add a user account


Here are step by step instructions on how to add a user account.

**Step 1: Run the ViewPAC Utility**


**Step 2: On the Network tab, click Login tab, type the User Name and Password, and then click Add button**

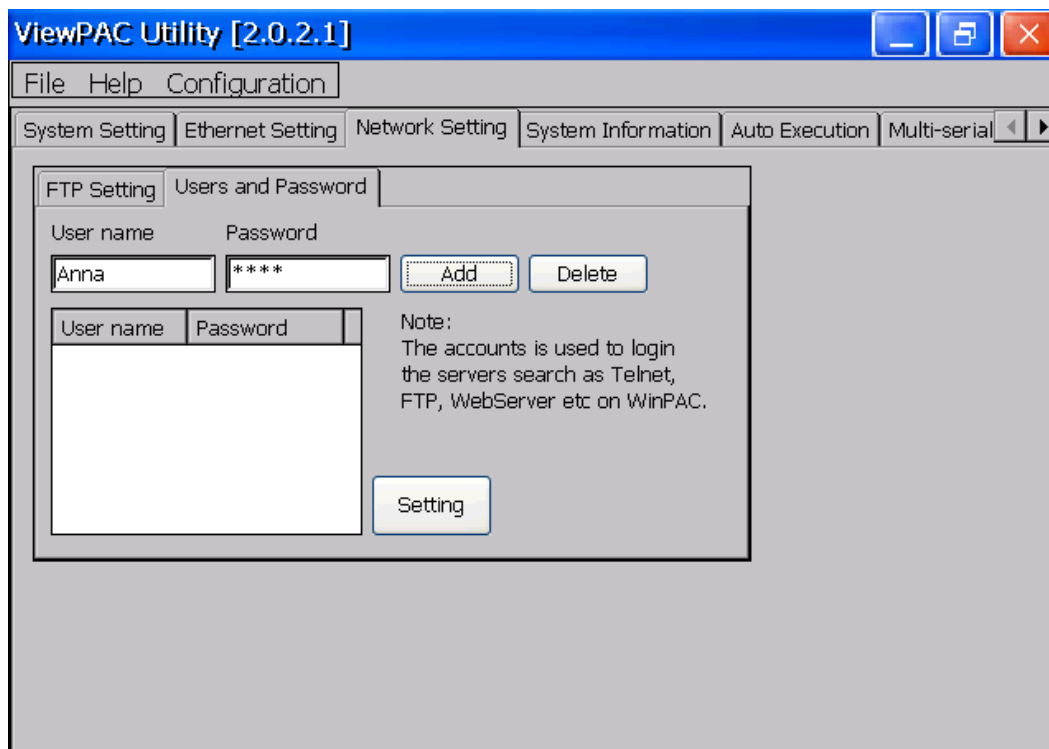

**Step 3: The user has been added to the allowed under the remote login and included in the following list**

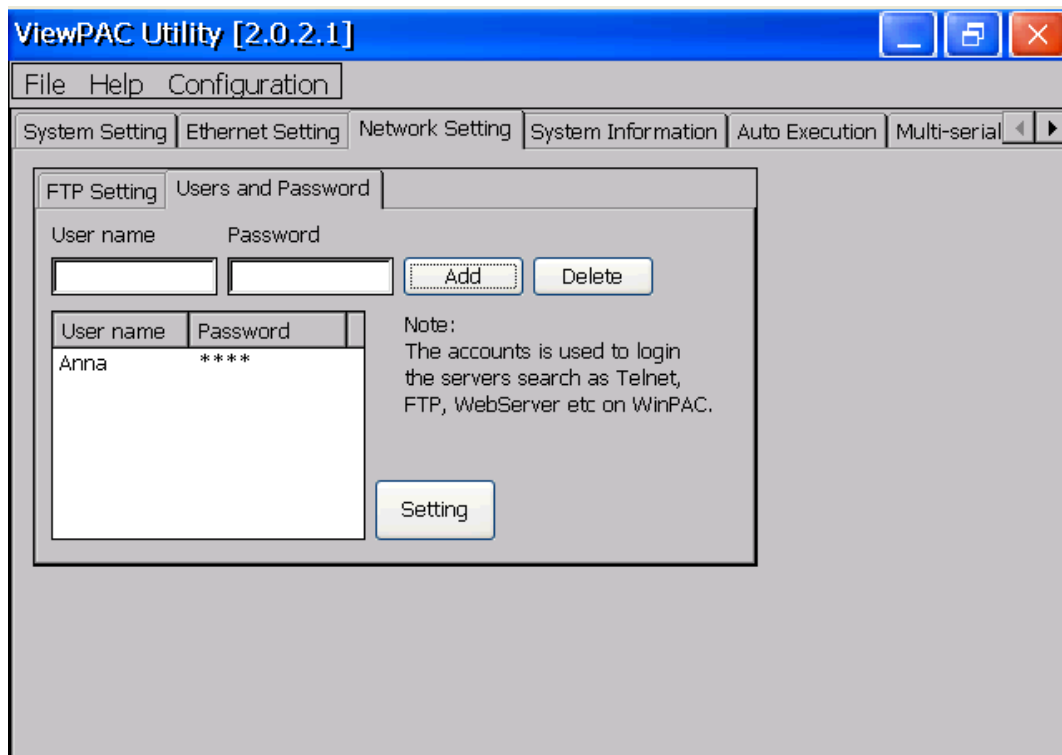


**Step 4: On the File menu, click Save and Reboot for changes to take effect**

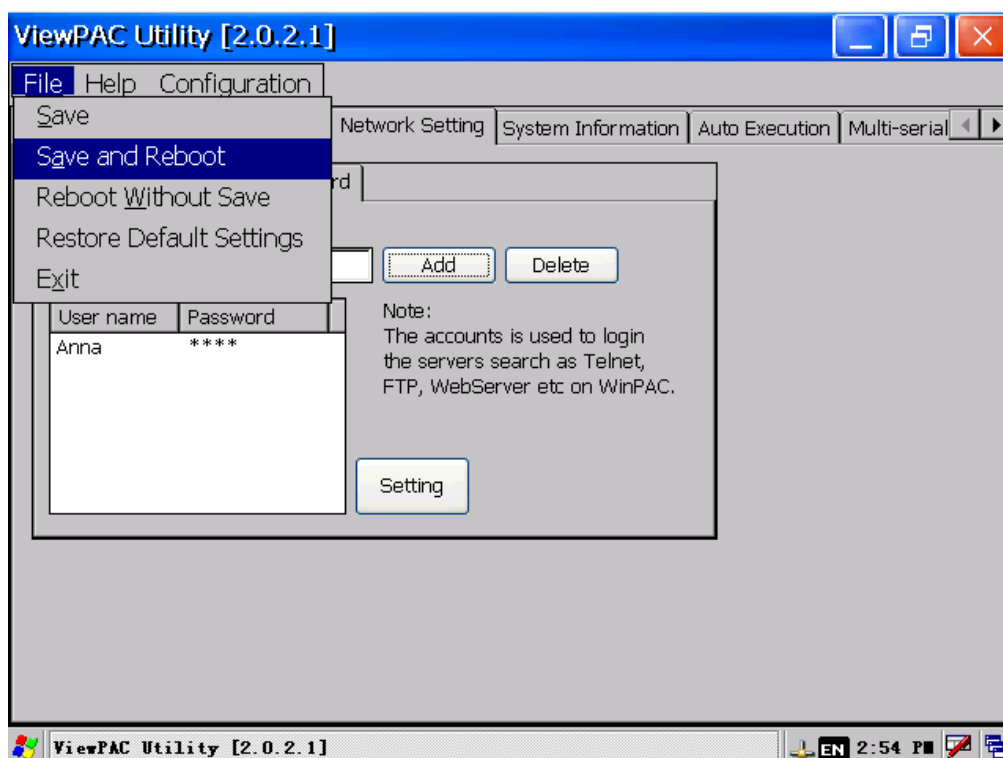


## C.2.2. How to Use telnet to remote login the ViewPAC from PC

Here are step by step instructions on how to use telnet to remote login the XPAC from PC.


**Step 1: On the PC, open a MS-DOS command prompt**

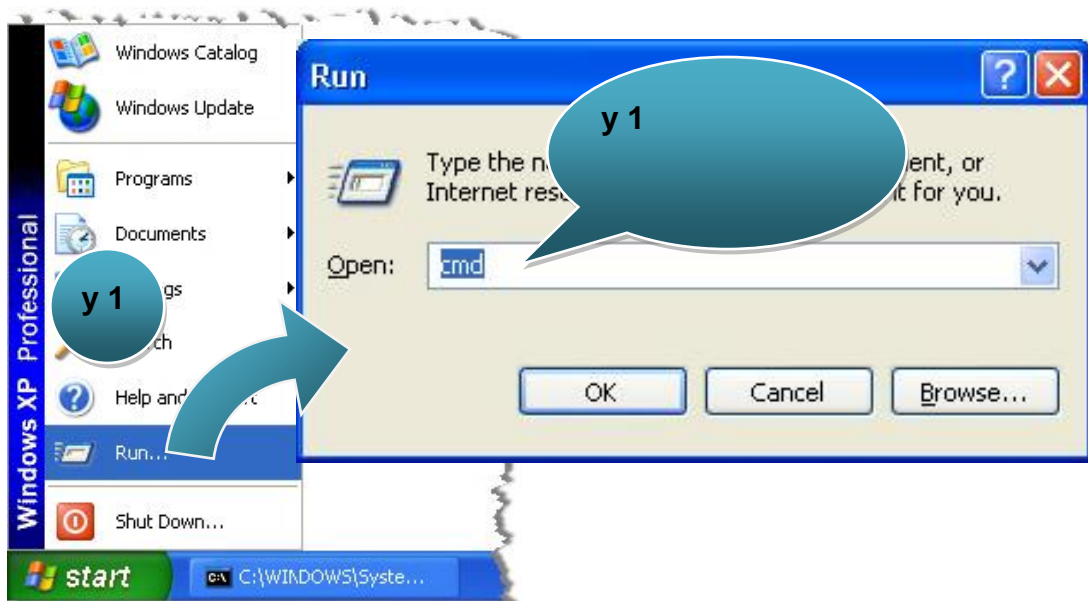

**Step 2: At the command prompt, type “telnet (IP address)”**

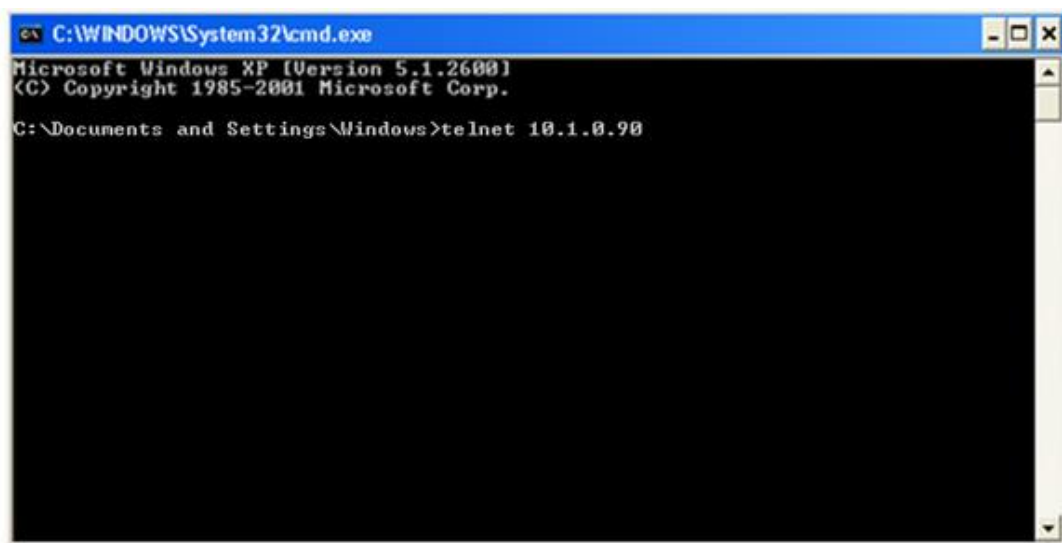


**Step 3: The connection has been set up, and then type the name and password**

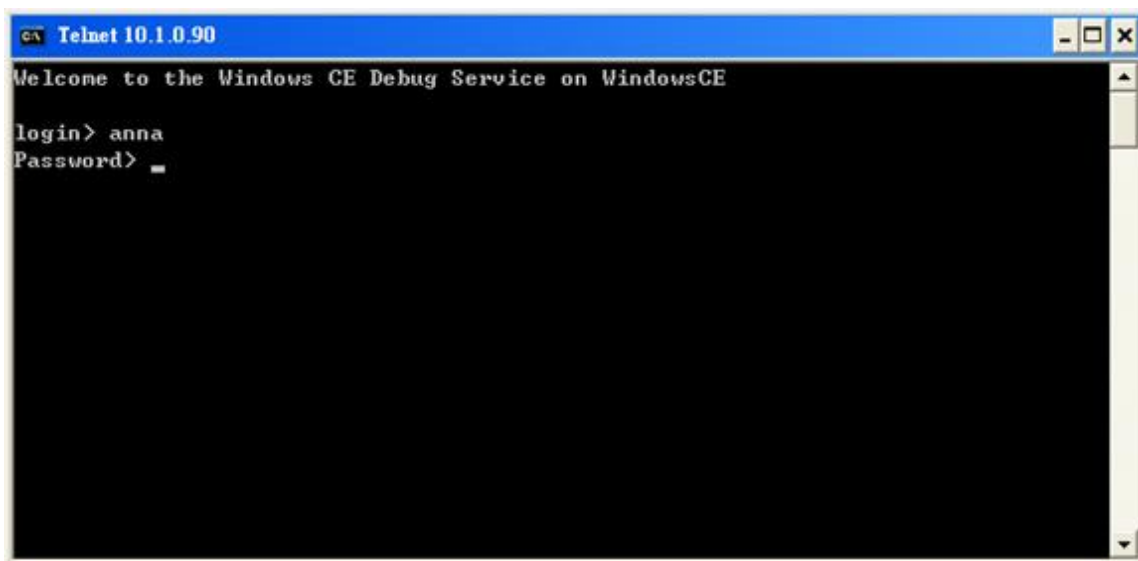

```
GA Telnet 10.1.0.90
Welcome to the Windows CE Debug Service on WindowsCE

login> anna
Password> _
```

**Step 4: The remote login has been completed**

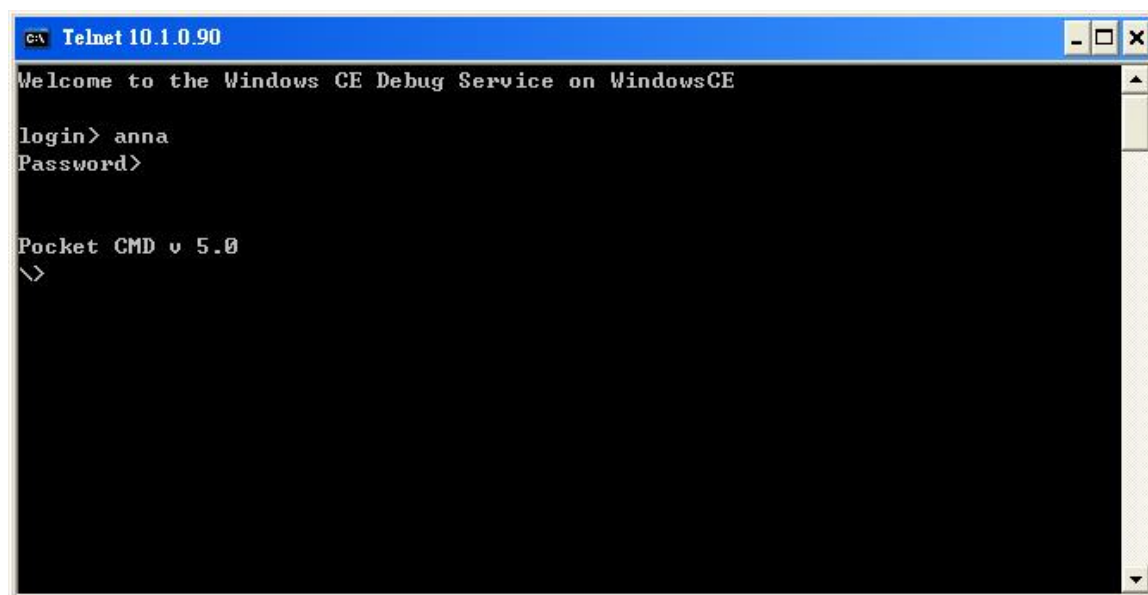

```
GA Telnet 10.1.0.90
Welcome to the Windows CE Debug Service on WindowsCE

login> anna
Password>


Pocket CMD v 5.0
\>
```




### C.2.3. How to remove the user from the login list

Here are step by step instructions on how to remote the user from the login list.

**Step 1: Click a user from the list which you want to remove, and the user will display in the field, and then press Delete to delete the user from the login list**

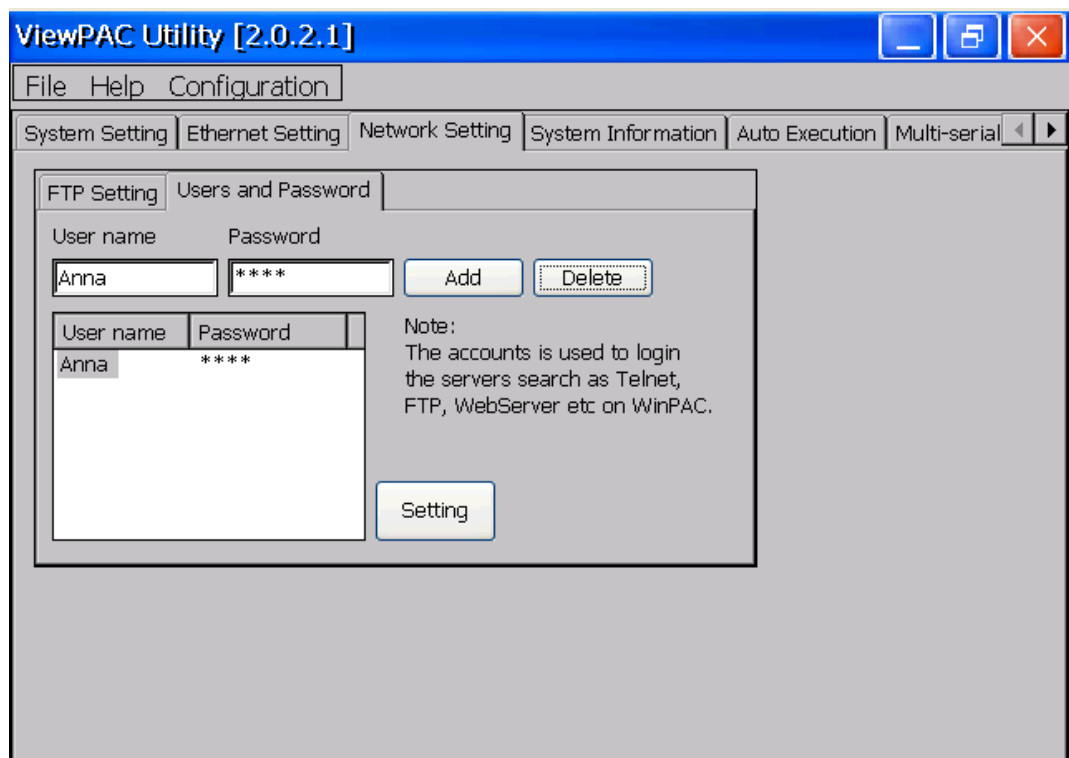

**Step 2: On the File menu, click Save and Reboot for changes to take effect**

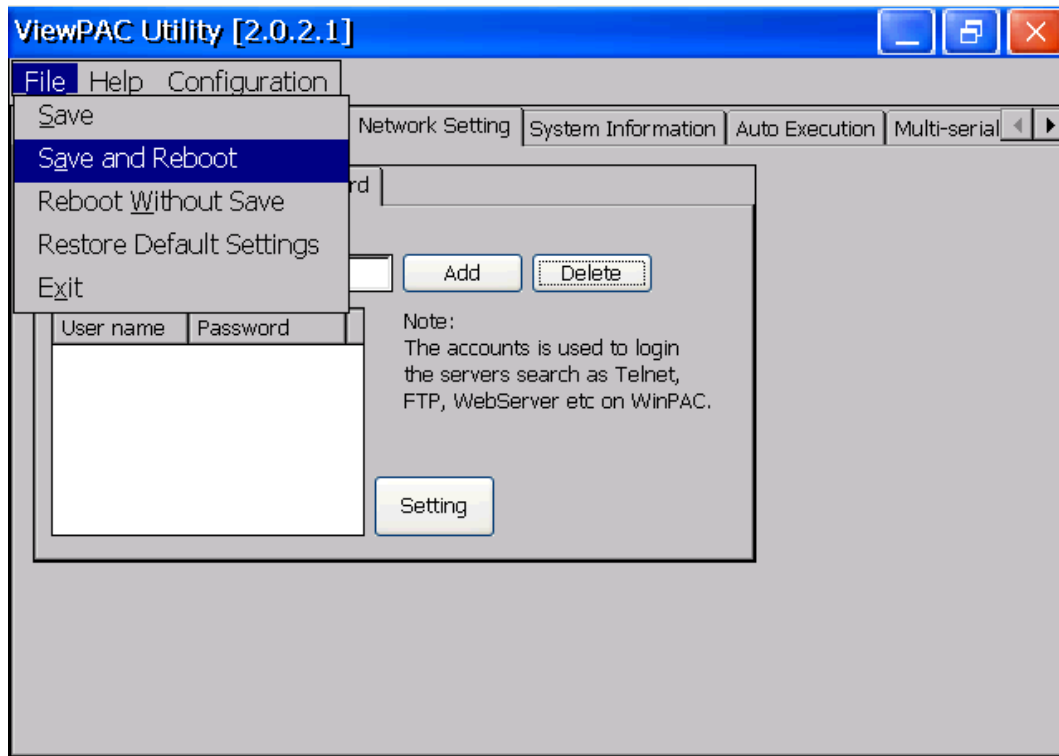

## C.3. How to online debug ViewPAC


Debugging is a process that you use to find and resolve errors, or bugs, in a program.

### C.3.1. Debug ViewPAC programs in EVC++


**Step 1: On the “Tools” menu, click “Configure Platform Manager...” command**




**Step 2: On the “Windows CE Platform Manager Configuration” dialog, click the “Properties...” button**

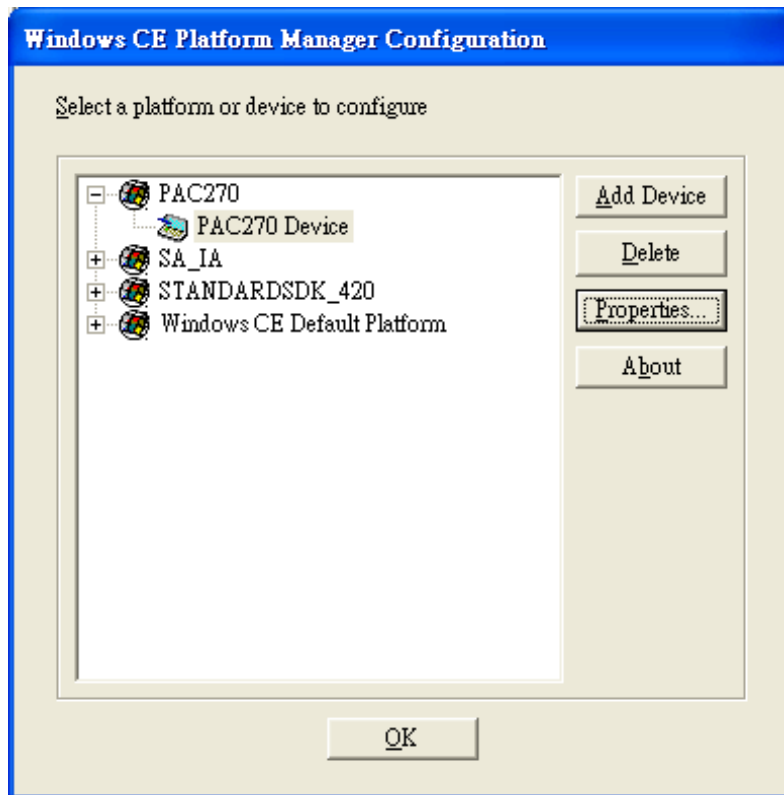


**Step 3: On the “Device Properties” dialog, click the “Configure...” button**

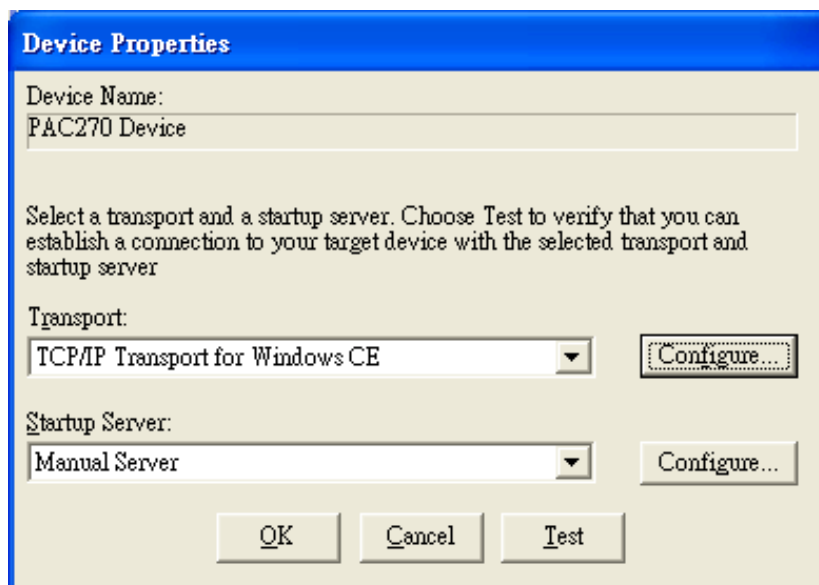


**Step 4: On the “TCP/IP Transport Configuration” dialog, select the “Fixed port” check box, and then click the “OK” button**

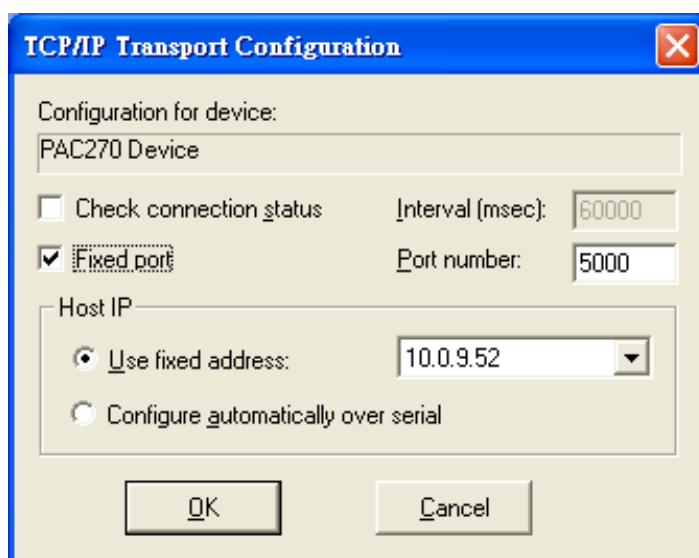


**Step 5: On the “Windows CE Platform Manager Configuration” dialog, click the “Test” button**

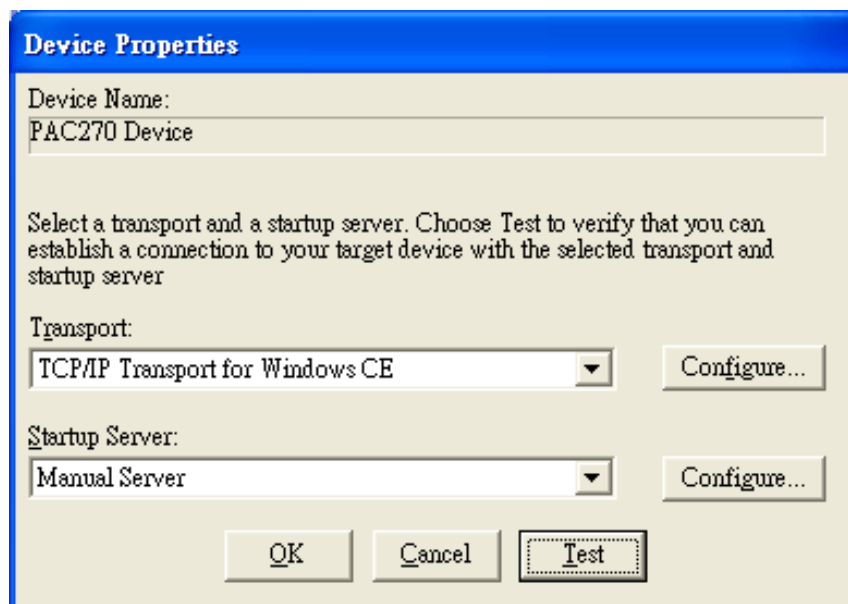


**Step 6: The “Manual Server - Action” dialog will appear displaying a command line, before click the “OK” button to close dialog, turn to the ViewPAC controller side to do the next two-steps**

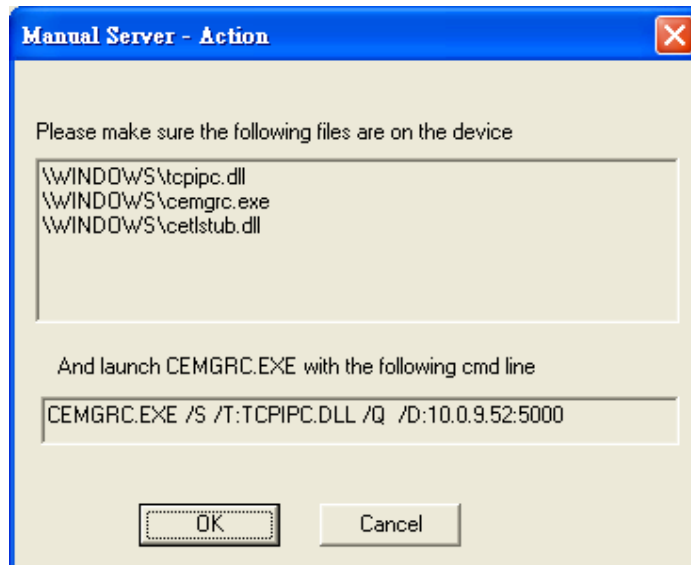


**Step 7: On the ViewPAC controller side, select  the “Start” menu, and then click the “Run...” command**

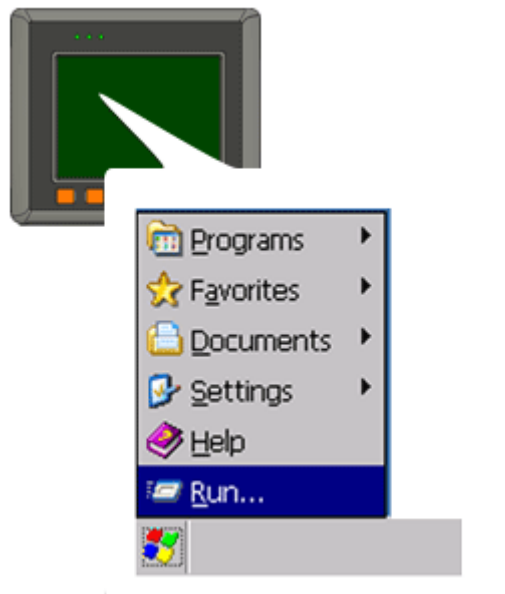

**Step 8: On the “Run” dialog, type the command which displays in step 5 and then click the “OK” button**

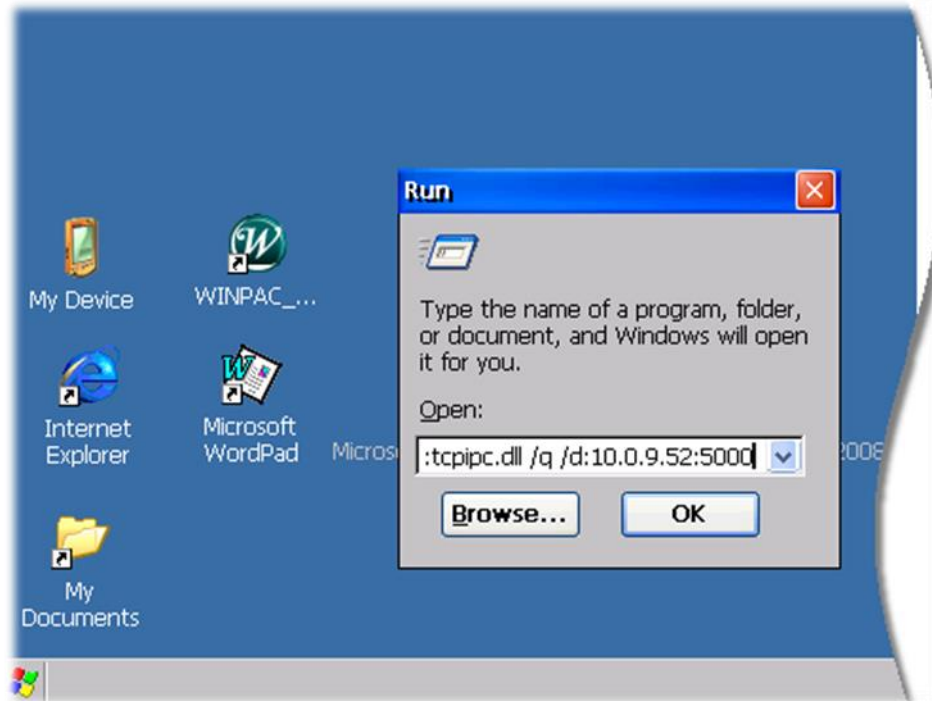


**Step 9: Return to the Host PC side, on the “Manual Server – Action” dialog, click the “OK” button**

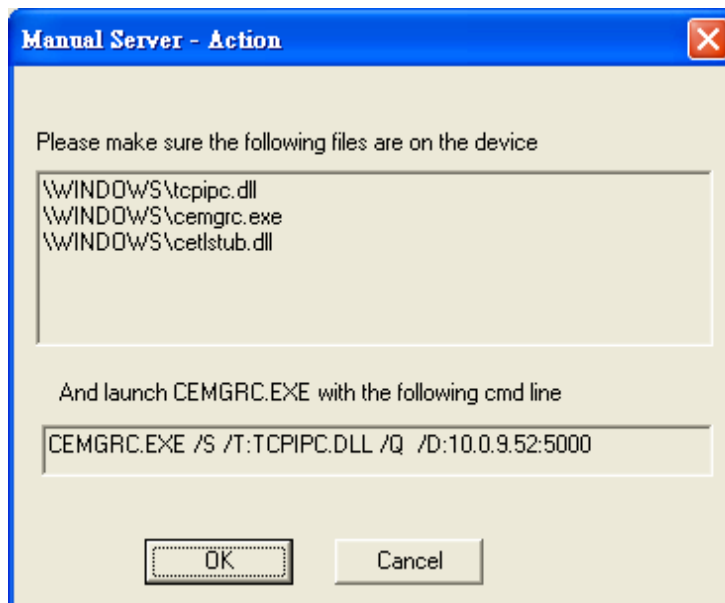

**Step 10: On the “Testing Device Connection” dialog, click the “OK” button**




**Step 11: On the “Device Properties” dialog, click the “OK” button**

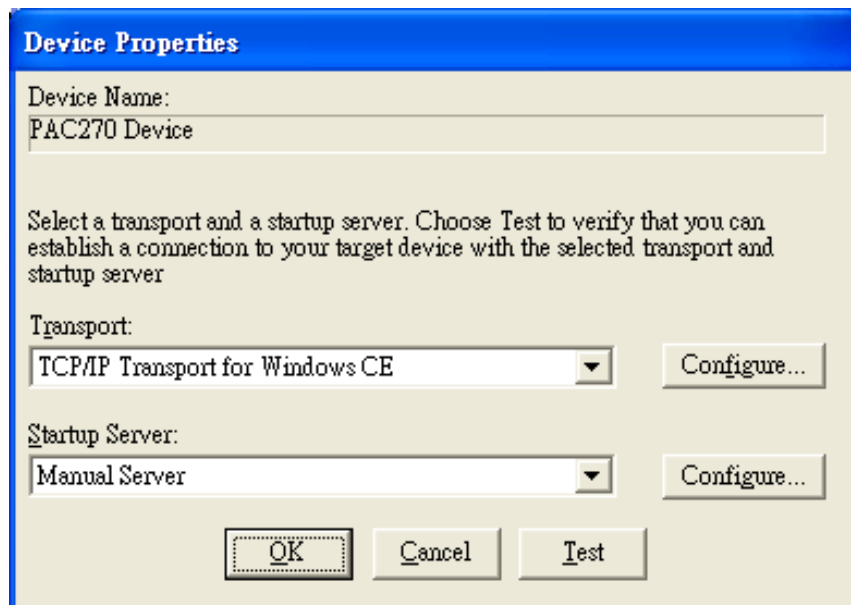





**Step 12: On the “Windows CE platform or device to configure” dialog, click the “OK” button**

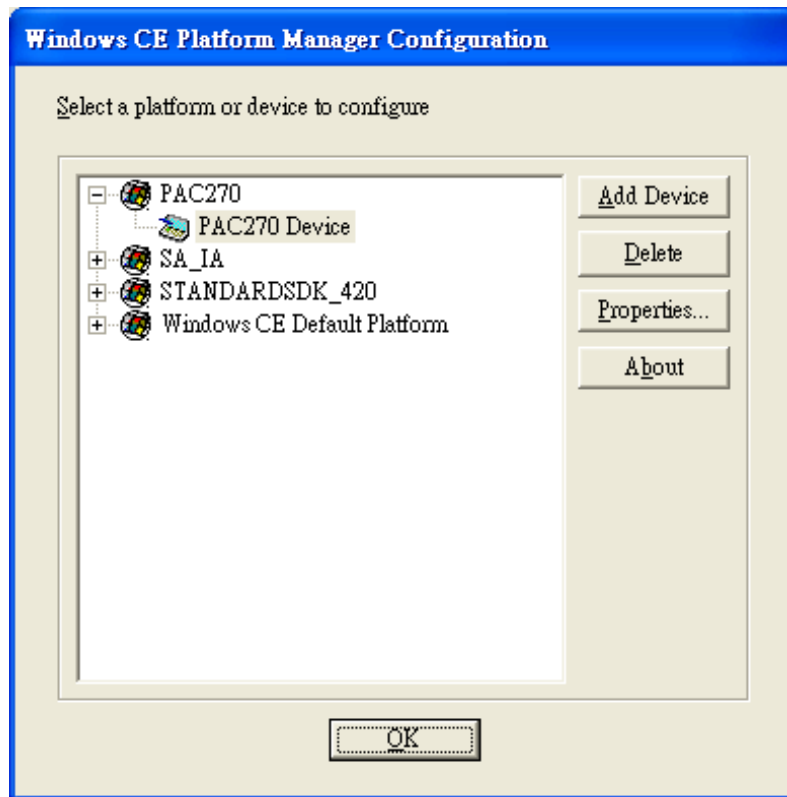


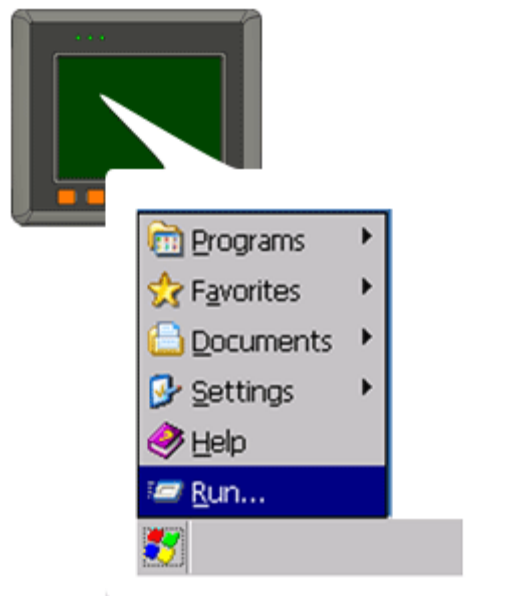
**Step 13: On the “Build” menu, select the “Start Debug” command and then click the “Go” command**

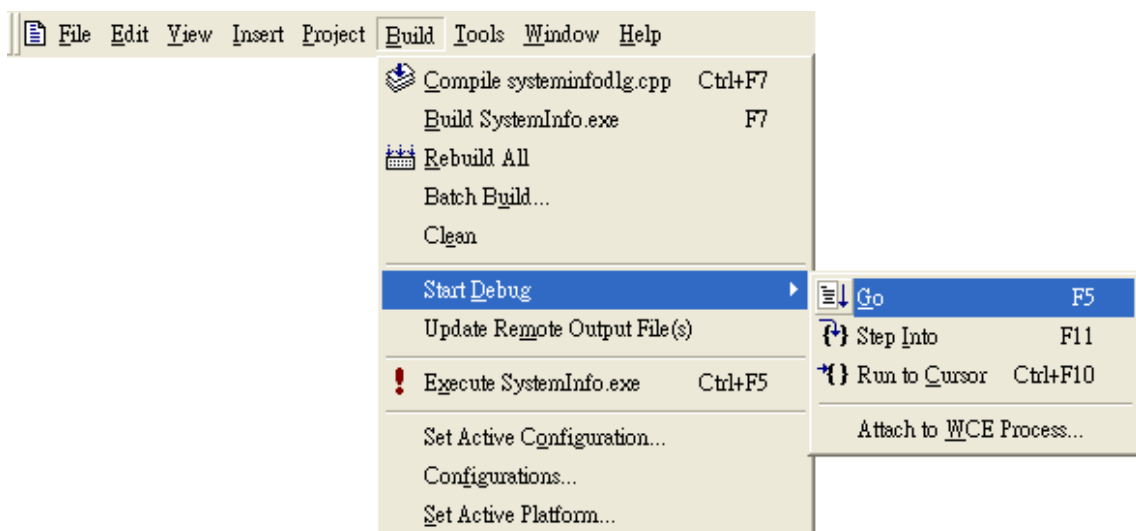


**Step 14:** The “Manual Server - Action” dialog will appear displaying a command line, before click the “OK” button to close dialog, turn to the ViewPAC controller side to do the next two-steps

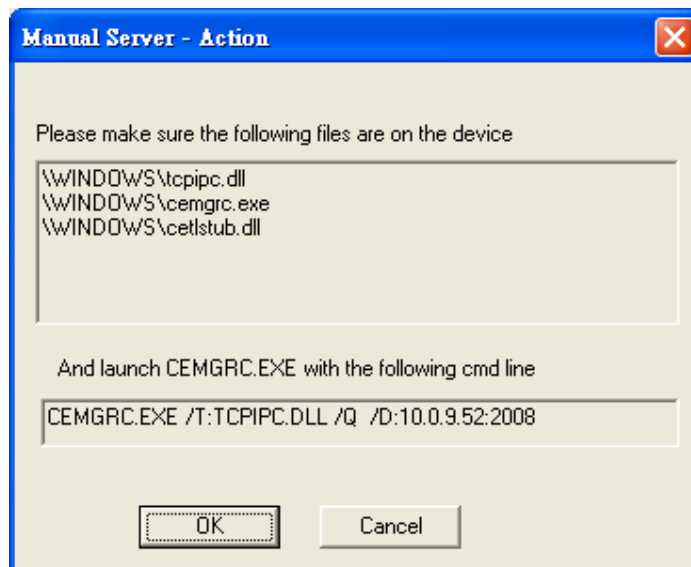


**Step 15:** On the ViewPAC controller side, select the  “Start” menu, and then click the “Run...” command




**Step 16: On the “Run” dialog, type the command which displays in step 5 and then click the “OK” button**

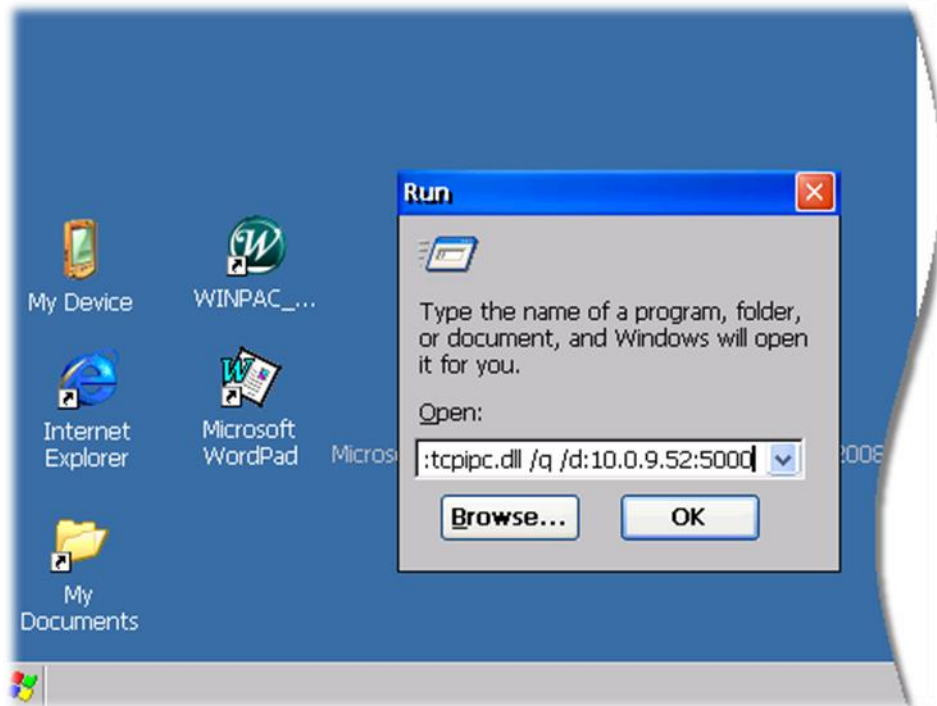

**Step 17: Return to the Host PC side, on the “Manual Server – Action” dialog, click the “OK” button**

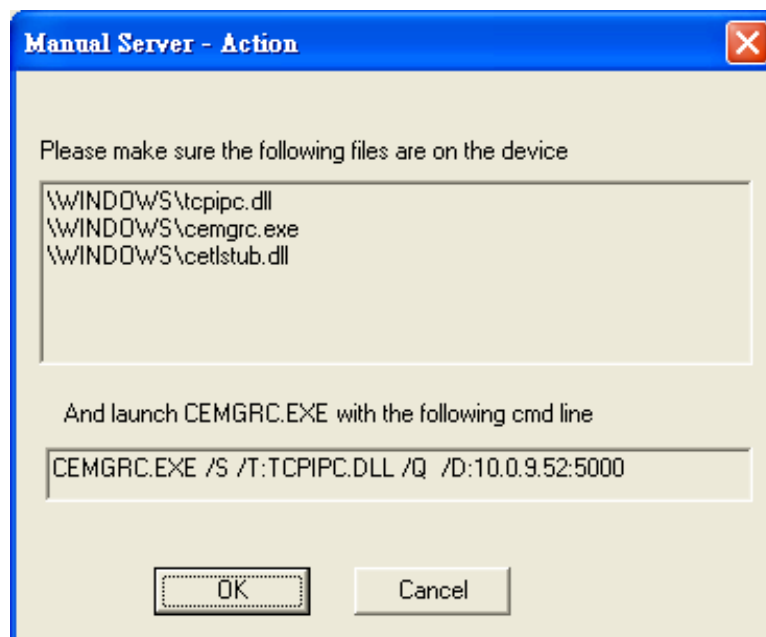

Step 18: On the “Manual Server - Action” dialog, click the “OK” button

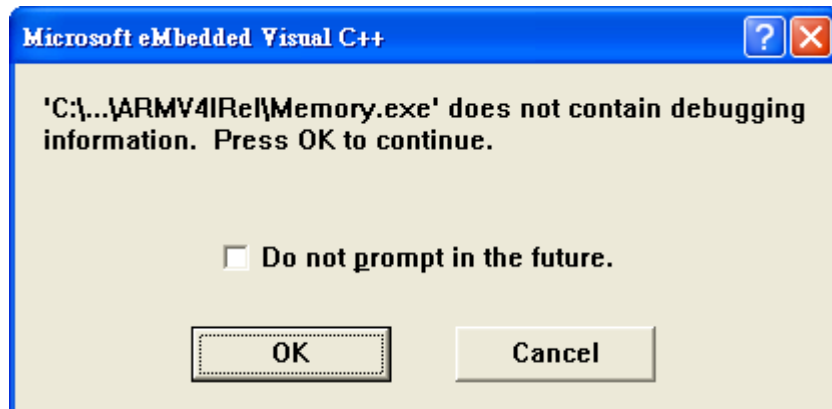


Step 19: Connection established. Then you can debug on line.

## Tips & Warnings

---



If you want to quit the debugger and return to editing, you can click the “Stop Debugging” button from “Debug” menu

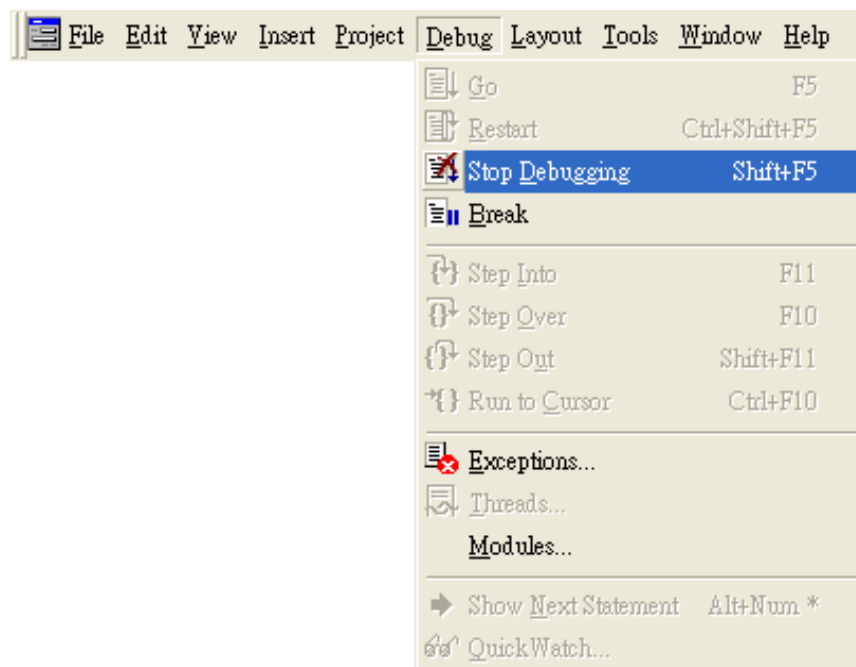

### C.3.2. Debug ViewPAC programs in Visual Studio 2005/2008

Debugging in Visual Studio 2005/2008 are provided by ViewPAC OS image V 1.3.0.4 or later.


**Step 1: Make sure the following file are listed with the matching version numbers**

Path	File
C:\Program Files\Common Files\Microsoft Shared\CoreCon\1.0\Bin	1. ActiveSyncBootstrap.dll 2. ConMan2.dll 3. ConManPS.dll 4. DesktopDMA.dll 5. eDbgTL.dll 6. TcpConnectionC.dll
C:\Program Files\Common Files\Microsoft Shared\CoreCon\1.0\Bin\1033	conmanui.dll
C:\Program Files\Common Files\Microsoft Shared\CoreCon\1.0\Target\wce400\armv4i	1. DeviceDMA.dll 2. eDbgTL.dll 3. TcpConnectionA.dll 4. clientshutdown.exe 5. CMAccept.exe 6. ConmanClient2.exe


**Step 2: If the version matches correctly and the entire file are there, copy the following files to ViewPAC :\ System\_Disk\ICPDAS\System folder**

- ✓ Clientsshutdown.exe
- ✓ ConmanClient2.exe
- ✓ CMaccept.exe
- ✓ eDbgTL.dll
- ✓ TcpConnectionA.dll


**Step 3: On the “Project” menu, click “[Project Name] Properties...” command**

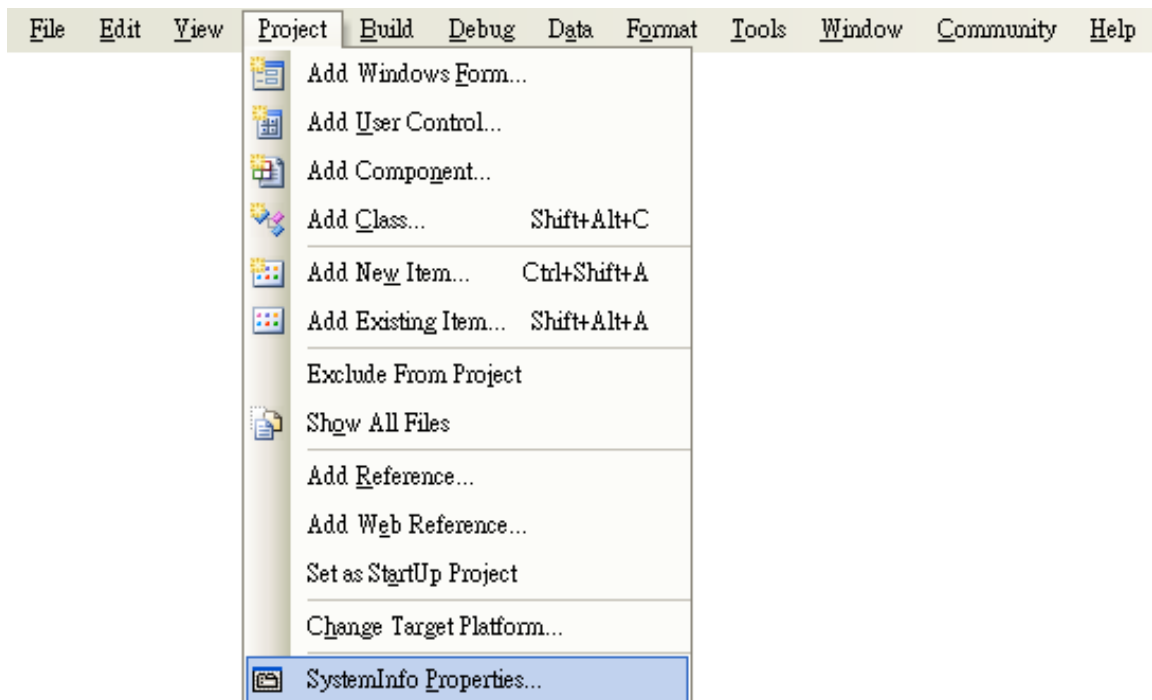


**Step 4: On the “SystemInfo\*” tab, unselect “Deploy the latest version of the .NET compact Framework (including Service Packs)” check box**

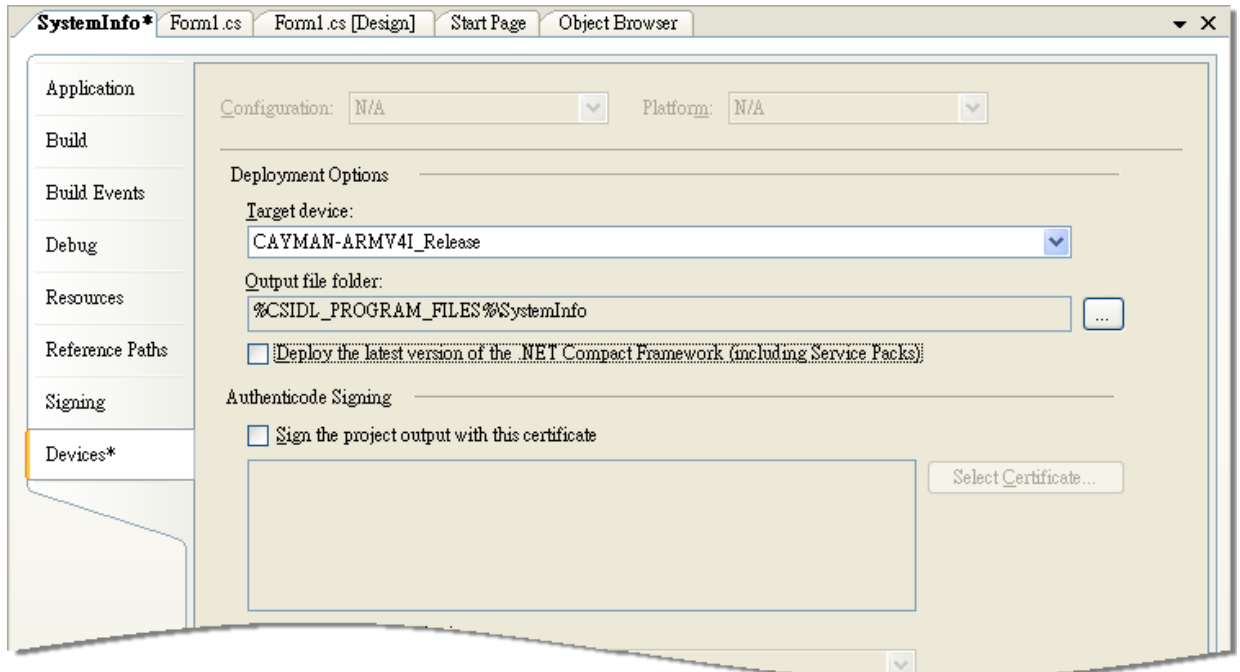


**Step 5: On the “Tools” menu, click “Options...” command**

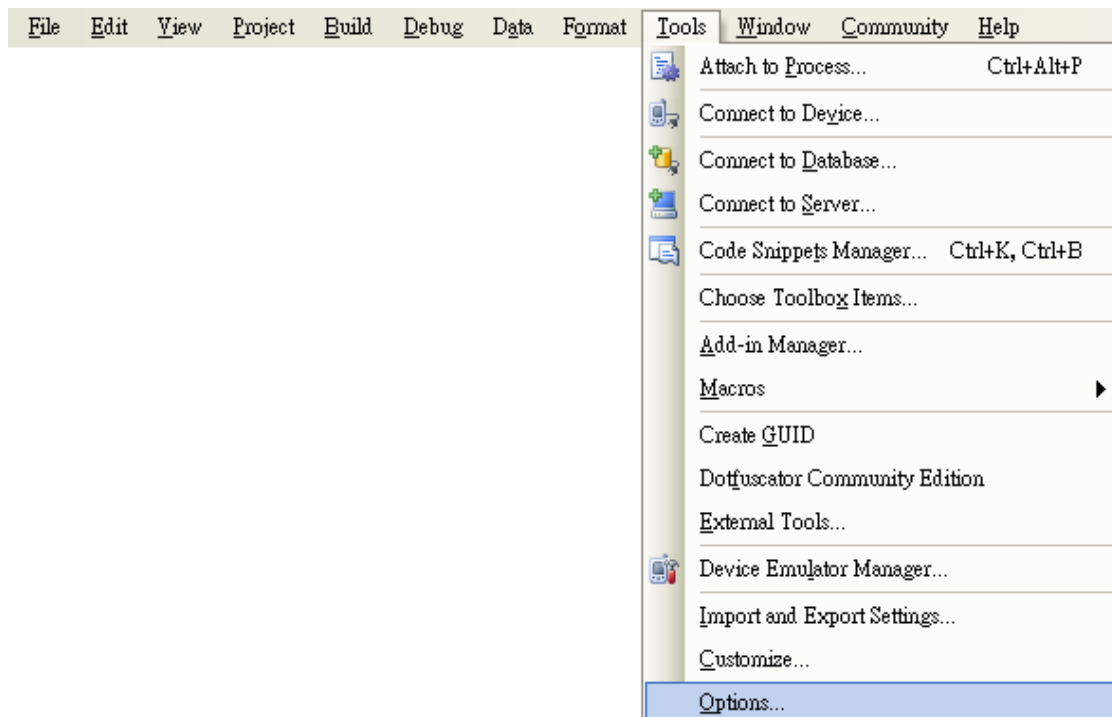

**Step 6: On the “Options” dialog, select “PAC 270” from the “Show devices platform” list, and then click the “Properties...” button**

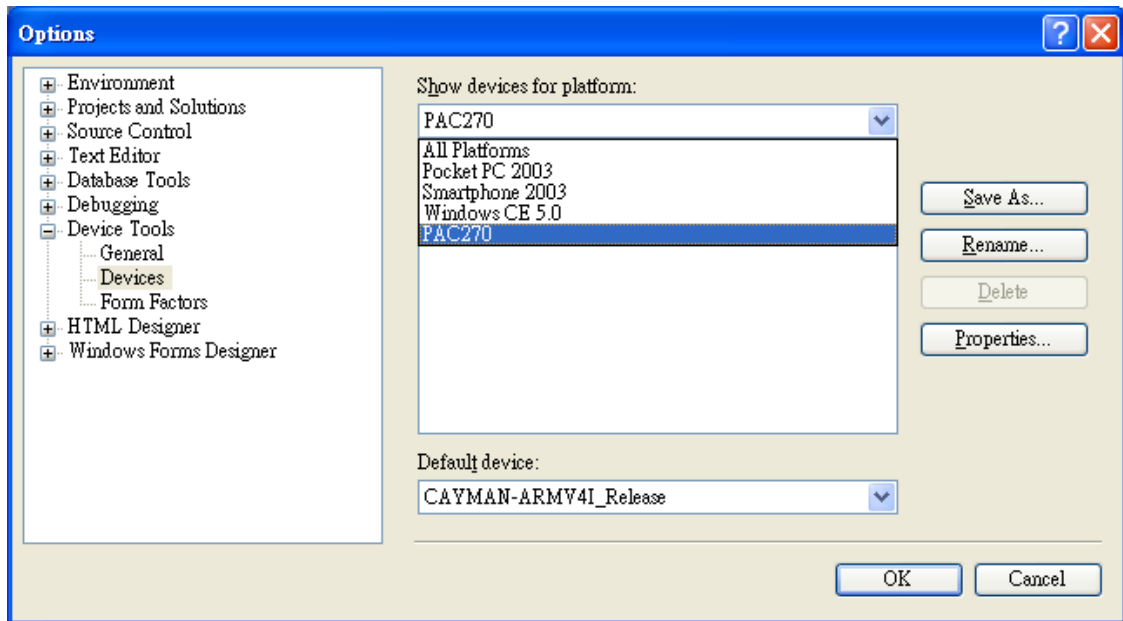


**Step 7: On the “CAYMAN-ARMV4I\_Release Properties” dialog, click the “Configure...” button**

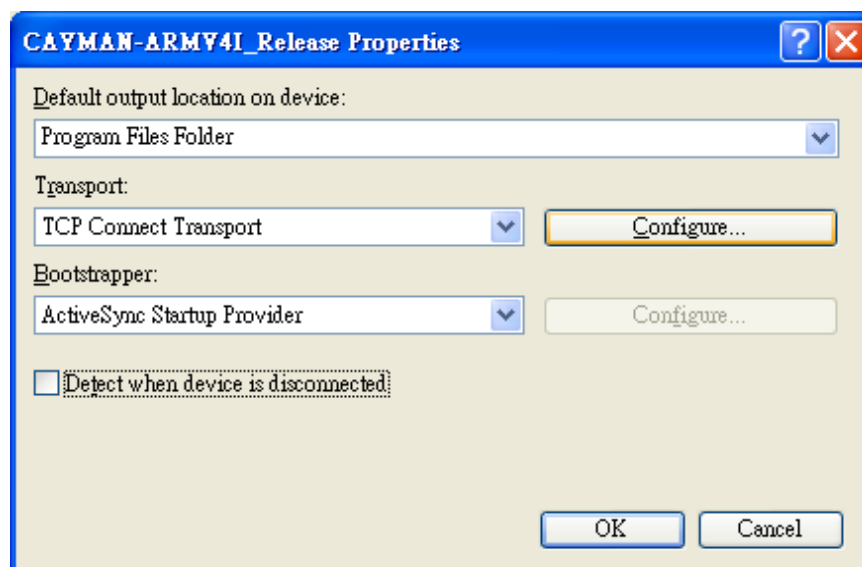





**Step 8: On the “Configure TCP/IP Transport” dialog, select the “Use specific IP address” option and type the IP address of ViewPAC, and then click the “OK” button**

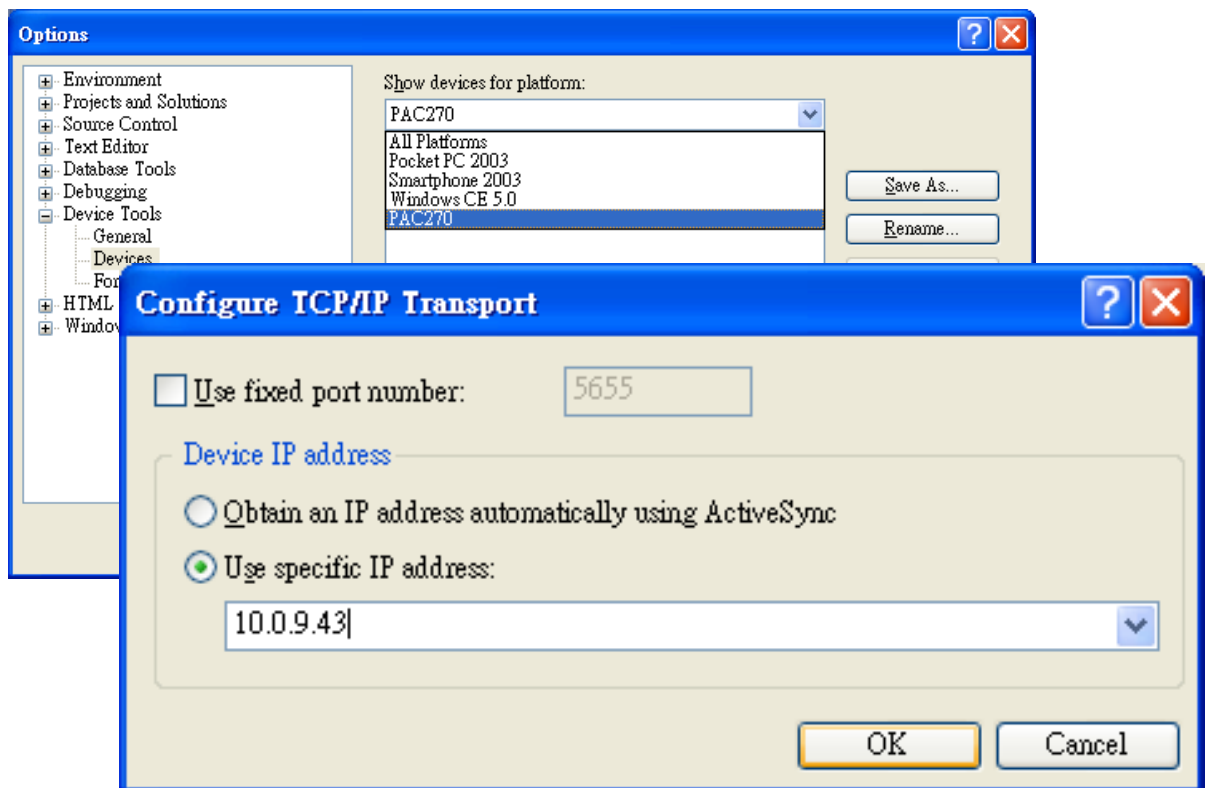


**Step 9: On the “CAYMAN-ARMV4I\_Release Properties” dialog, click the “OK” button**

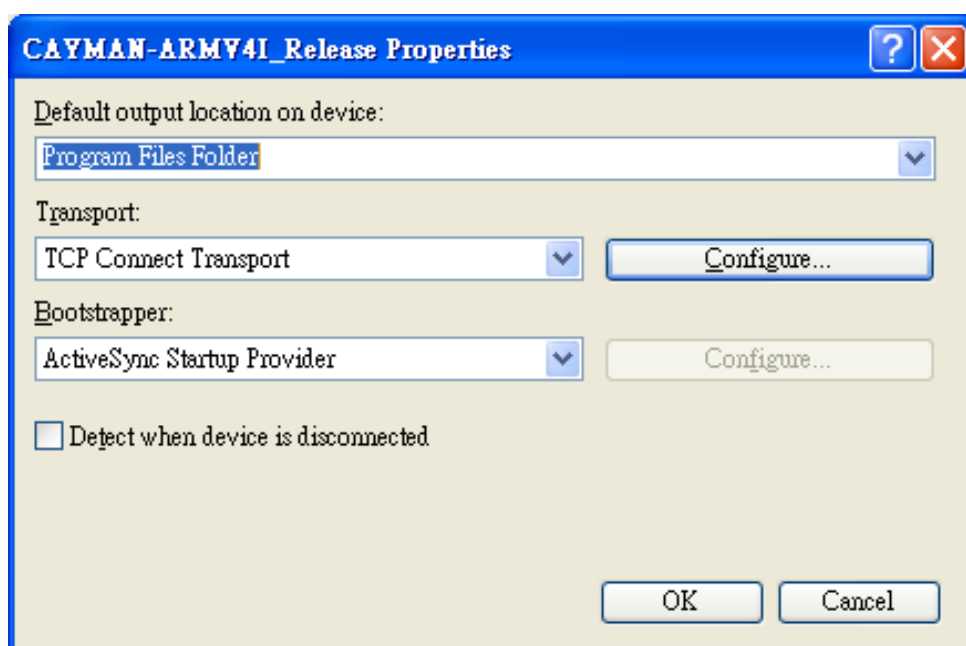


**Step 10: On the “Options” dialog, click the “OK” button**

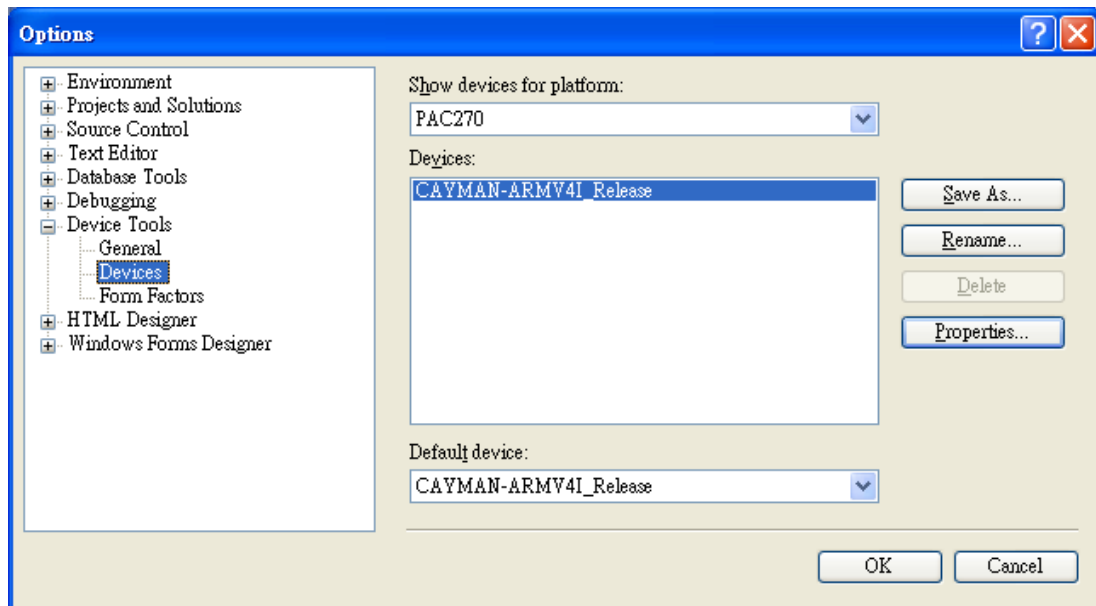


**Step 11: On the ViewPAC controller side, run the “CommanClient2” and the “CMAccept.exe” applications which is located at:  
\\System\_Disk\ICPDAS\System**

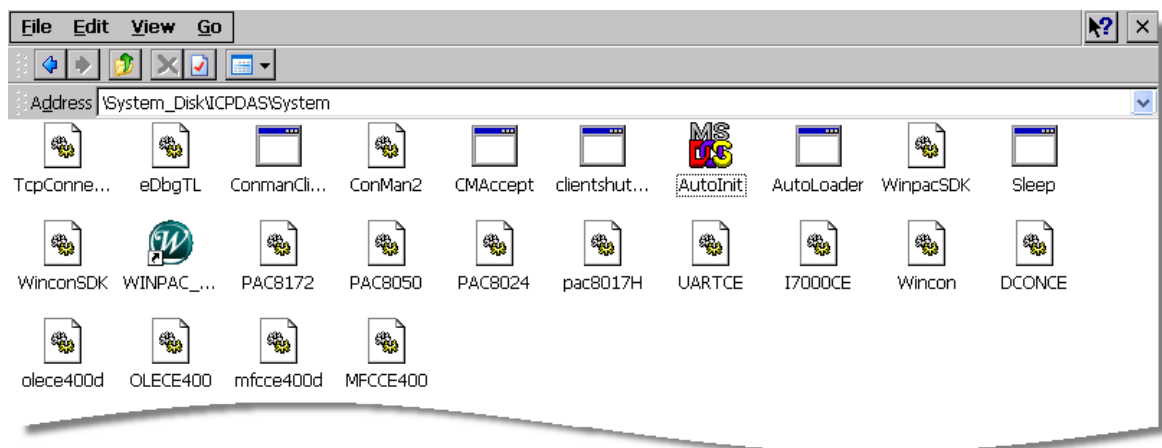


**Step 12: On the “Tools” menu, click “Connect to Device...” command**

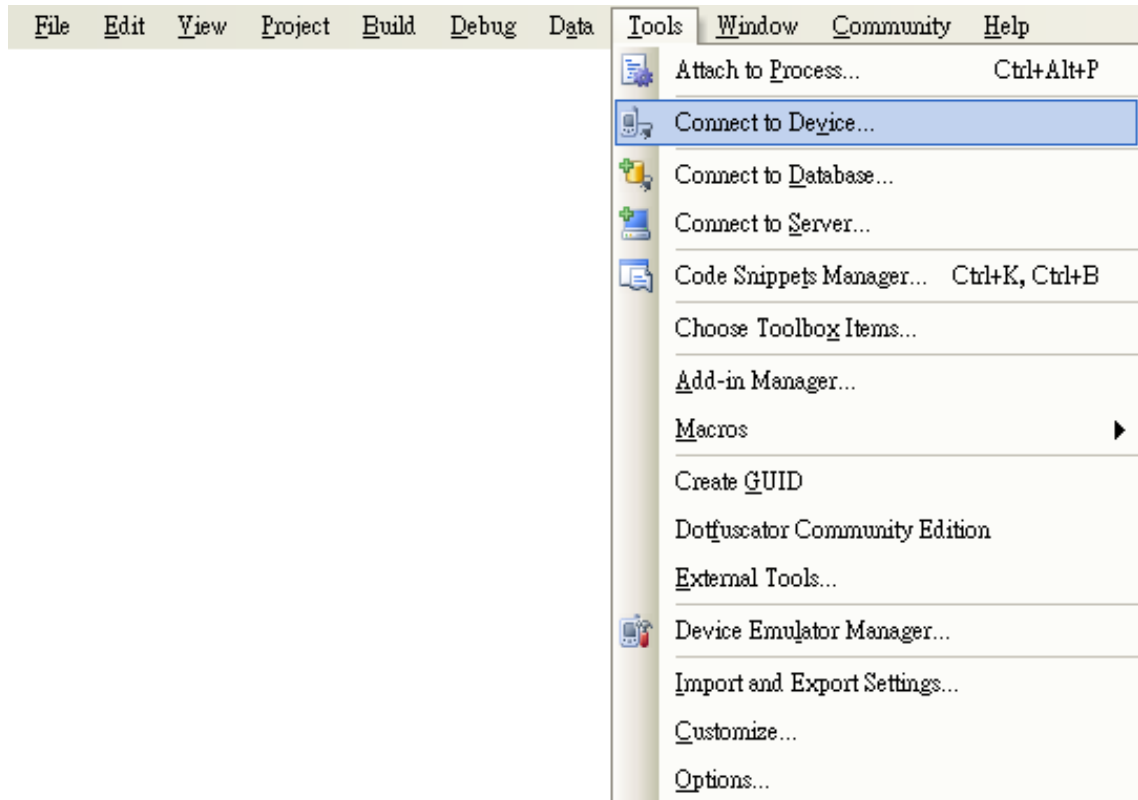

**Step 13: On the “Connect to Device” dialog, select “PAC 270” from “Platform” list and then click the “Connect” button**

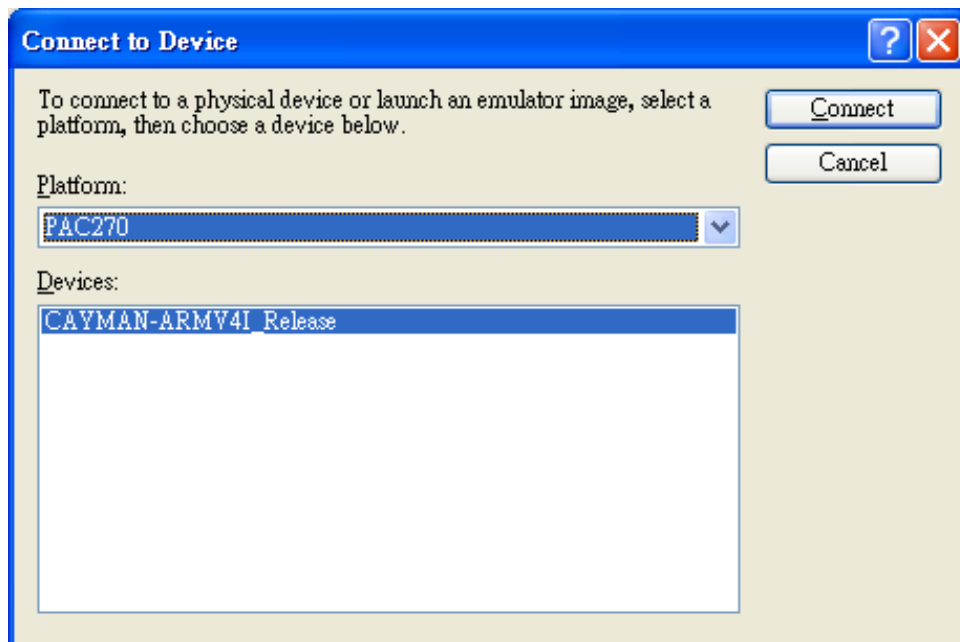


**Step 14: On the “Tools” menu, click “Connect to Device...” command**

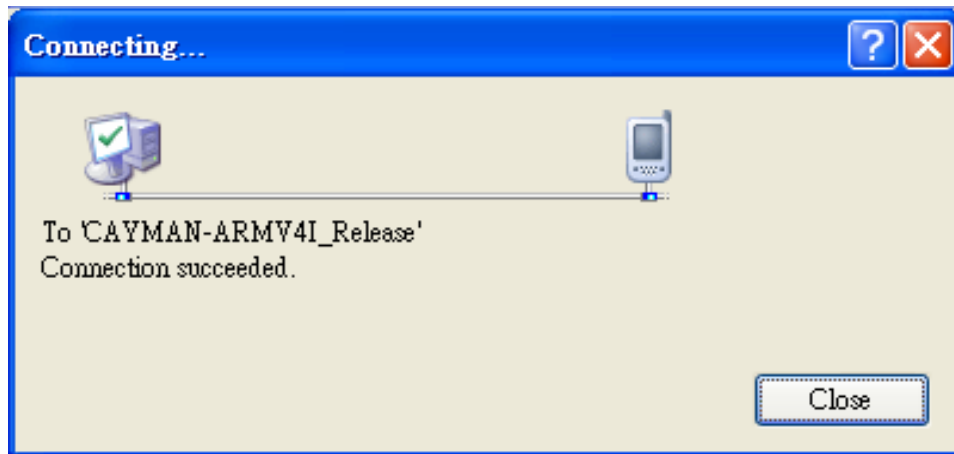

**Step 15: Connection established. Then you can debug on line.**



## FAQ:

If the connection fails shown as follow, return to step 11 to do the action below

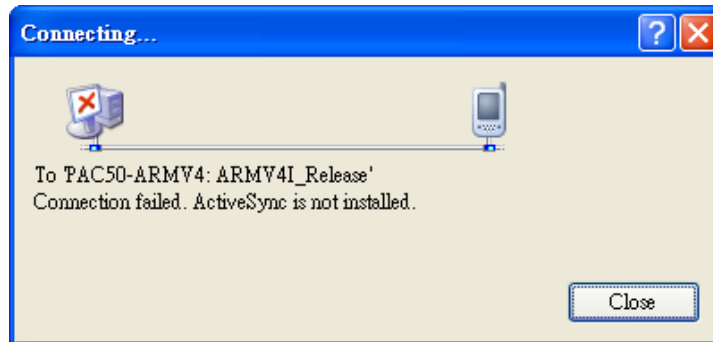

Open the command prompt, run the

**“CommanClient2.exe/transport:tcpconnectiona.dll/property:port=5000/id:Con” at: \System\_Disk\ICPDAS\System, and then run the “CMAccept.exe”**

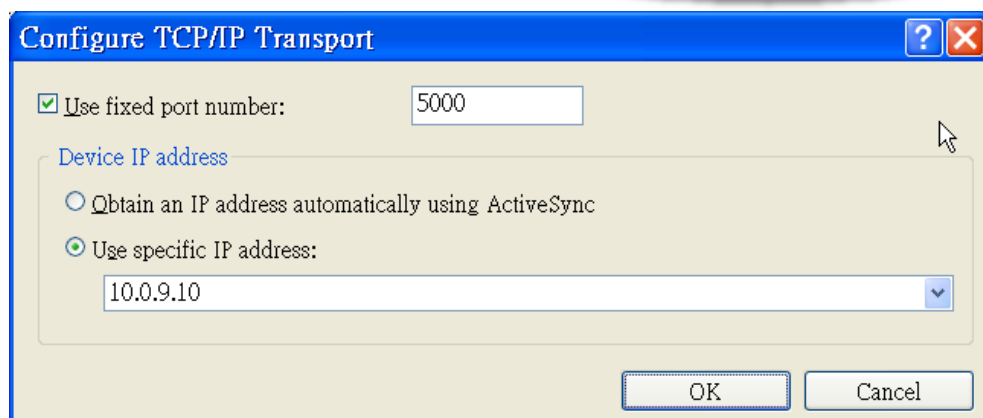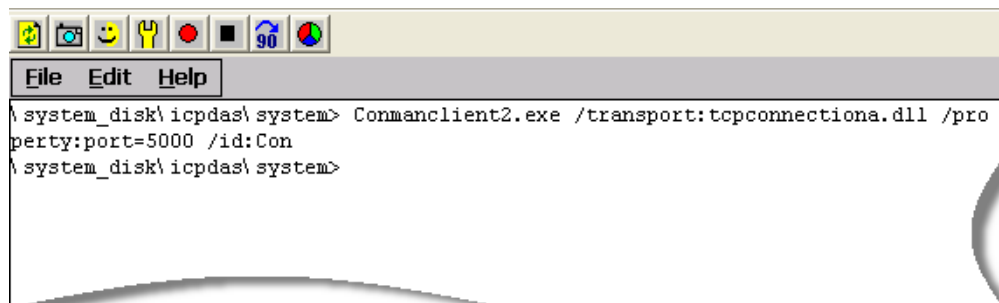

## C.4. How to recompile WinCon programs

To recompile Wincon programs to run on ViewPAC, certain components of the programs require adjustments that divides into two parts:

1. Compiler old programs which ran on Wincon 8x3x and 8x4x
2. Modify .vcp file to upgrade the old WinCon project

### Tips & Warnings

---




In general, you only need to do part 1, after this, if the program still can't be compiled to an application, the part 2 just need to do.

---


### C.4.1. Compiler old programs which ran on Wincon 8x3x and 8x4x

**Step 1: Open project which programmed in WinCon using eMbedded Visual C++**


**Step 2: On the “Build” menu, click “Configurations” command**

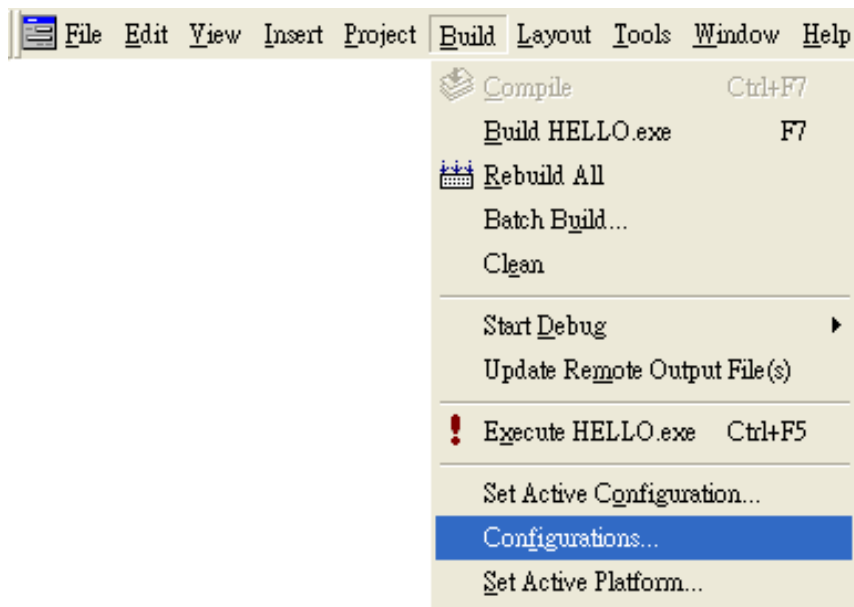


**Step 3: Make sure the CPU type is “STANDARDSDK”**

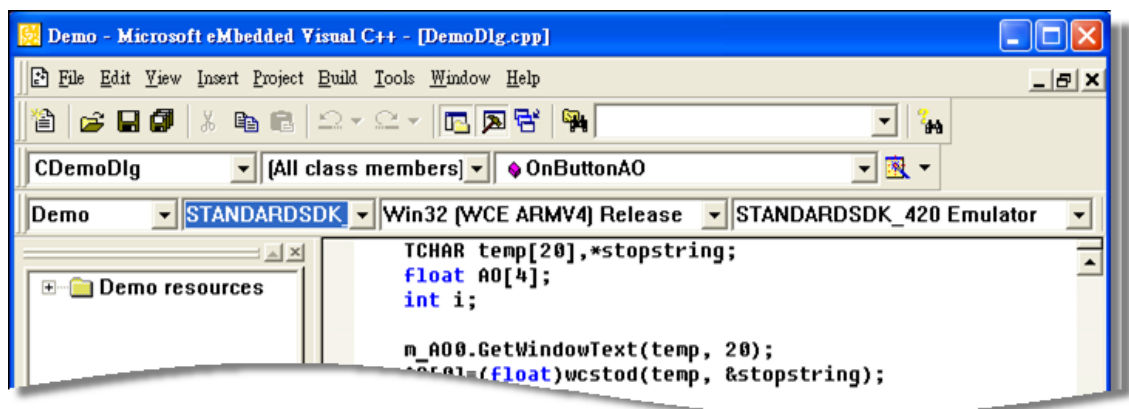

Step 4: On the “Configurations” dialog, click the “Add...” button

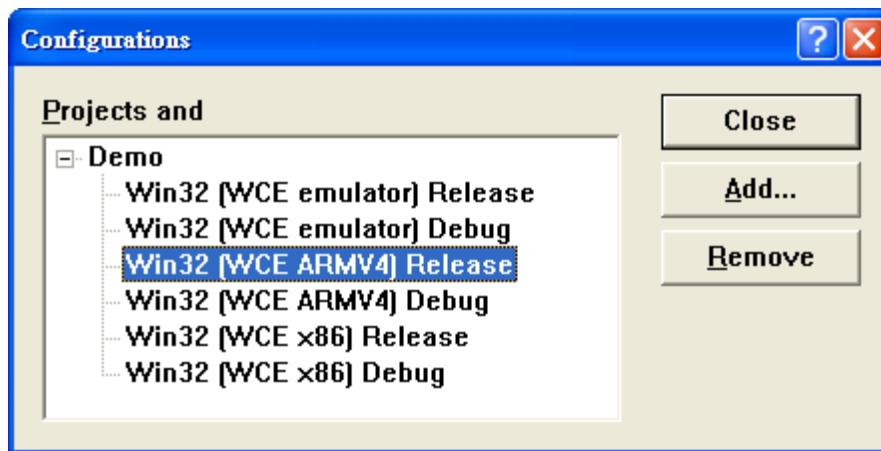


Step 5: On the “Add Project Configuration” dialog, choose one of the CPU type and then click the “OK” button.

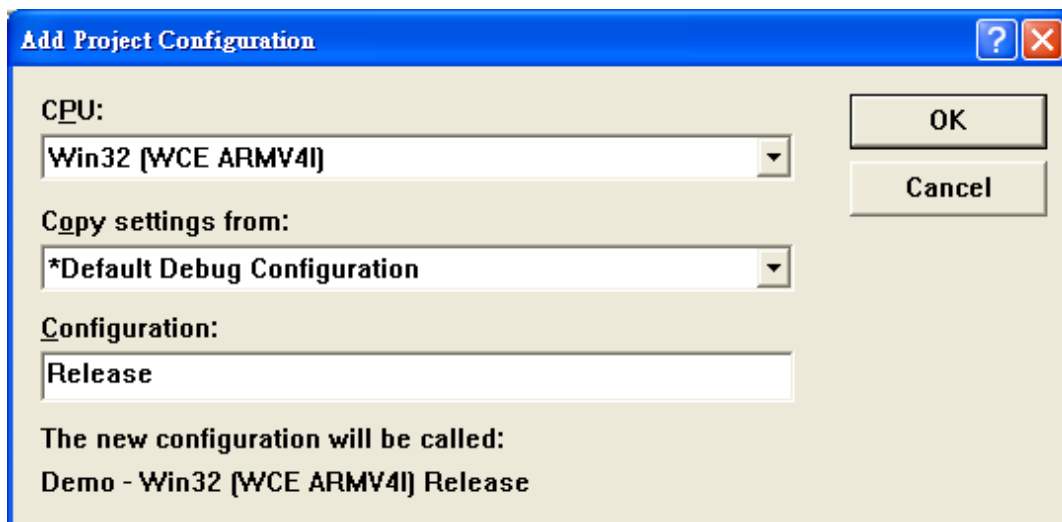





Step 6: On the “Project” menu, click “Settings...” command

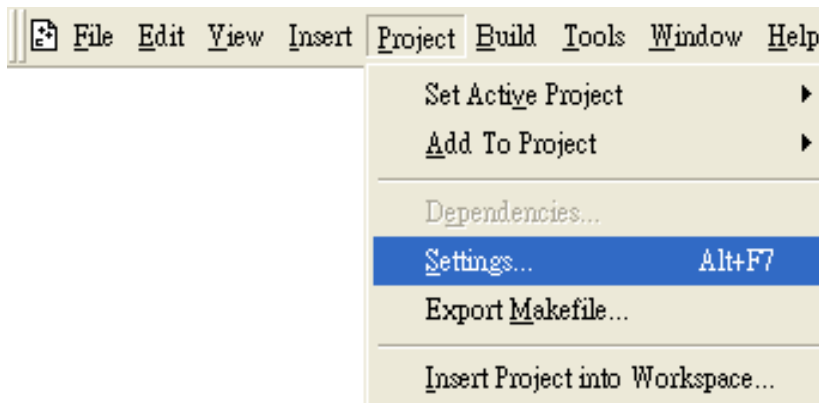


Step 7: On the “Project Settings” dialog, select the “Link” tab and change the value of the “Entry-point symbol” field, “WinMainCRTStartup” to “wWinMainCRTStartup”,

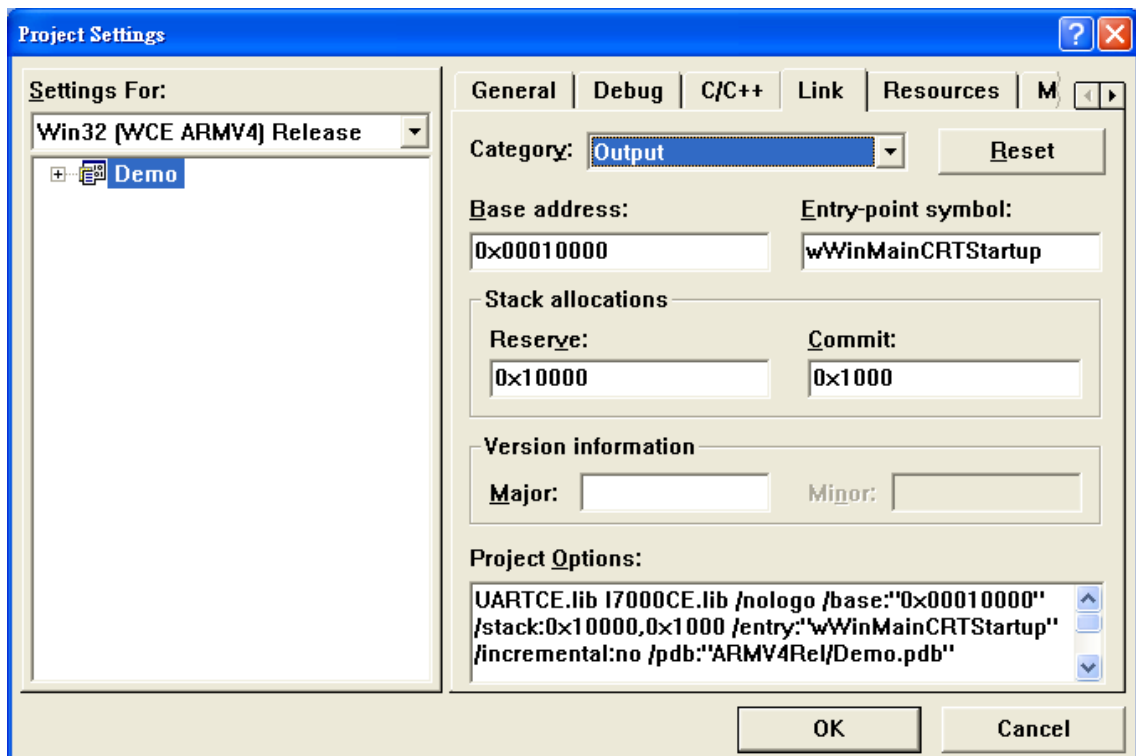


**Step 8:** After performing above-mentioned steps, build the project, your project should build success. If not, it will show error message as follow. Please continue with the following steps

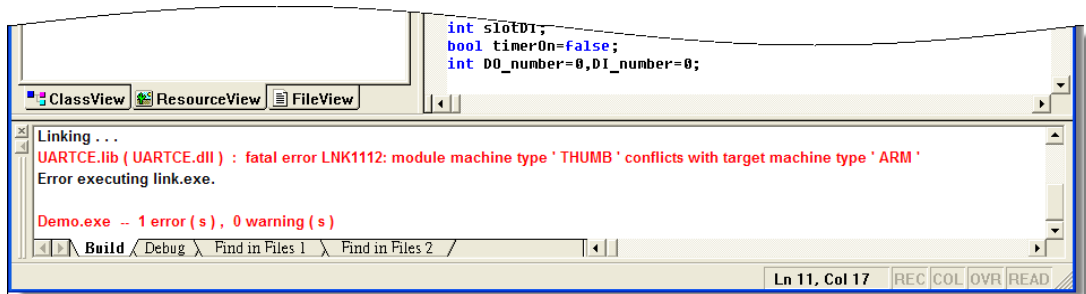

**Step 9:** On the “Project” menu, click “Settings...” command

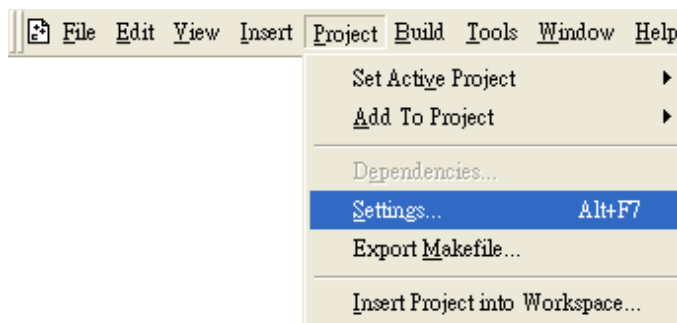

**Step 10:** On the “Project Settings” dialog, select the “Link” tab and change the value of the “Project Options” field, “ARM” to “THUMB”, and then built the project

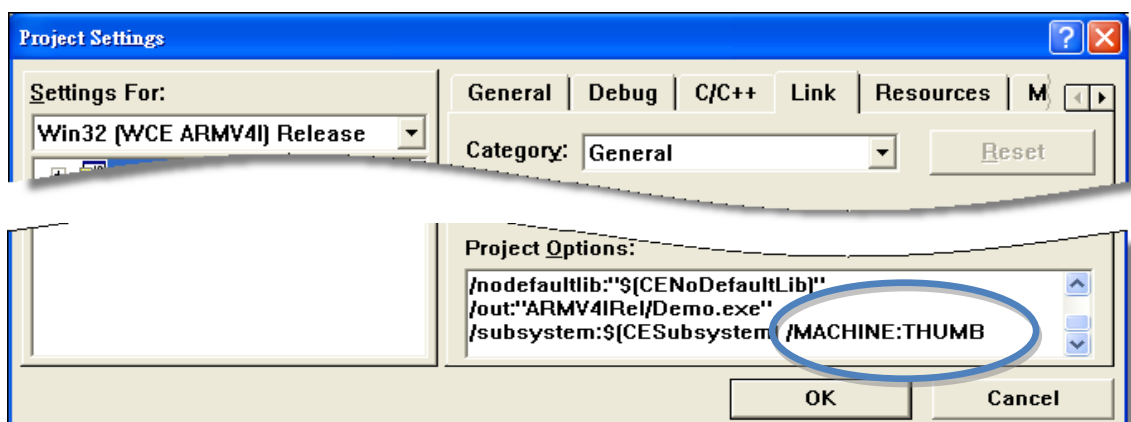

## **C.4.2. Modify .vcp file to upgrade the old WinCon project**

**Step 1: Open a text editor to modify the .vcp file**

**Step 2: In the .vcp file, replace “0xa301” with “0xa501”**

**Step 3: In the .vcp file, replace “ARMV4” with “ARMV4I”**

**Step 4: In the .vcp file, replace “MACHINE:ARM” with “MACHINE:THUMB”**



**Step 5: Save the .vcp file just edited**

**Step 6: Open the old WinCon project and recompile it**



## C.5. How to recalibrate the touch screen

The touch screen has function with the default calibration. It is necessary to calibrate your screen when it works not precise.


The calibration process is different from the PCB version, so before starting the calibration process, you must first check with the PCB version, as follows:
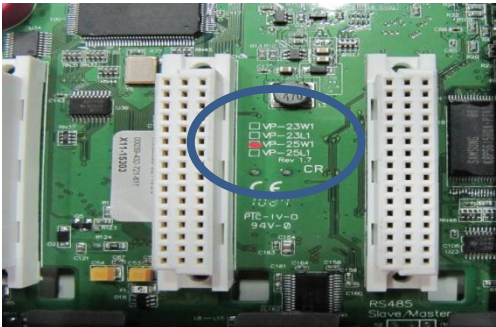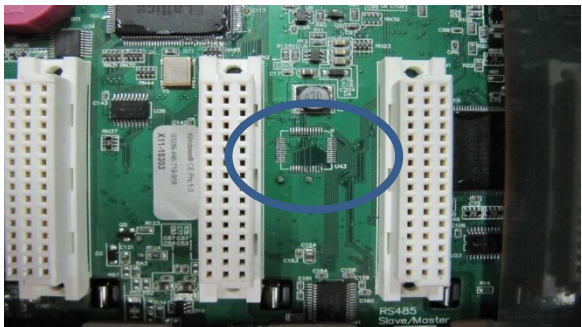
<p><b>The latest version - PCB 1.7 or later</b></p> <p>If your PCB version is 1.7 or later, there is a rev number sticker between the I/O slots.</p> 	<p><b>The earlier version - PCB 1.5</b></p> <p>If your PCB version is 1.5, there is no rev number sticker between the I/O slots.</p> 
---	--


After checking the PCB version, then select the calibration process that corresponds to your PCB version.
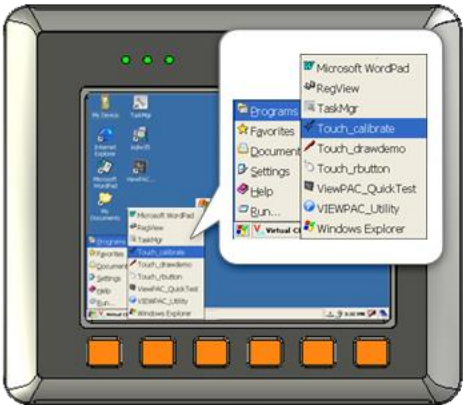
<p><b>The latest version (PCB 2.0 or later)</b></p> <p>1) Run the Touch_calibrate</p> 	<p><b>The earlier version (PCB 1.7 or earlier)</b></p> <p>1) Open the Control Panel</p> 
---	--

- 2) Click the 4 Points or the 9 Points button.

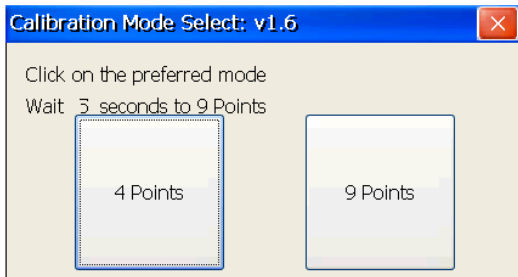


- 3) Tap the touch pen in the exact center of each of the calibration markers (+)

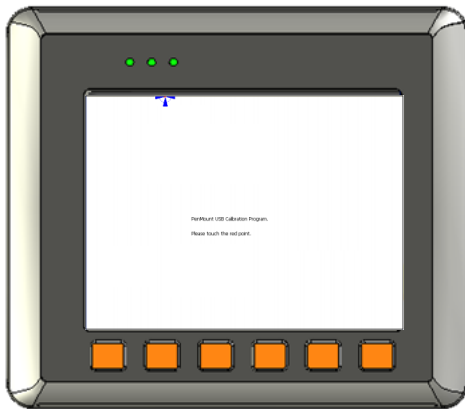

- 2) Run the Stylus.




- 3) Tap the touch pen in the exact center of each of the calibration markers (+)

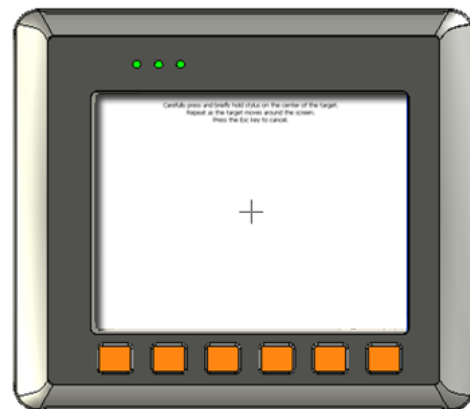

- 4) Touch the panel to finish the calibration program

- 5) Run the View PAC Utility to save the settings and reboot the View PAC

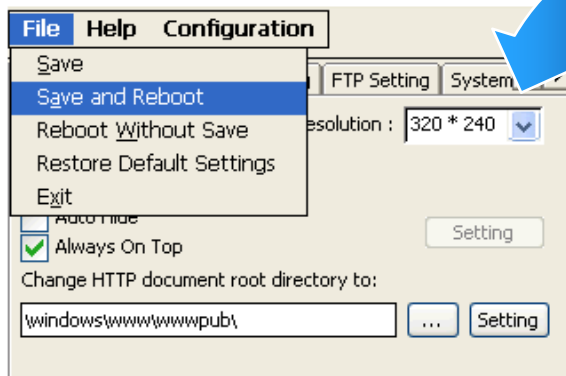

## C.6. How to use the printer

ViewPAC have ability to access the printer, you can connect to the printer via Ethernet network or USB.

### Tips & Warnings

---



ViewPAC only supports HP Laser Jet Printers which support PCL6 driver. The following printer support is released by HP

- HP LaserJet 4000 series/HP LaserJet 4100 series
- HP LaserJet 2100 series/HP LaserJet 2200 series
- HP LaserJet 1200
- HP LaserJet 3200/HP LaserJet 3300
- HP LaserJet 4200 series/HP LaserJet 4300 series
- HP LaserJet 5000 series/HP LaserJet 5100 series
- HP LaserJet 8000 series
- HP LaserJet 9000 series printers

If you need the latest support of HP PCL6 printer, you can refer to following link


<http://h20000.www2.hp.com/bizsupport/TechSupport/Document.jsp?objectID=bpl04568>

---

## C.6.1. How to use network printer


To use a shared network printer, please perform the following steps:

**Step 1: On the Host PC, check the name of the Host PC and the shared printer**

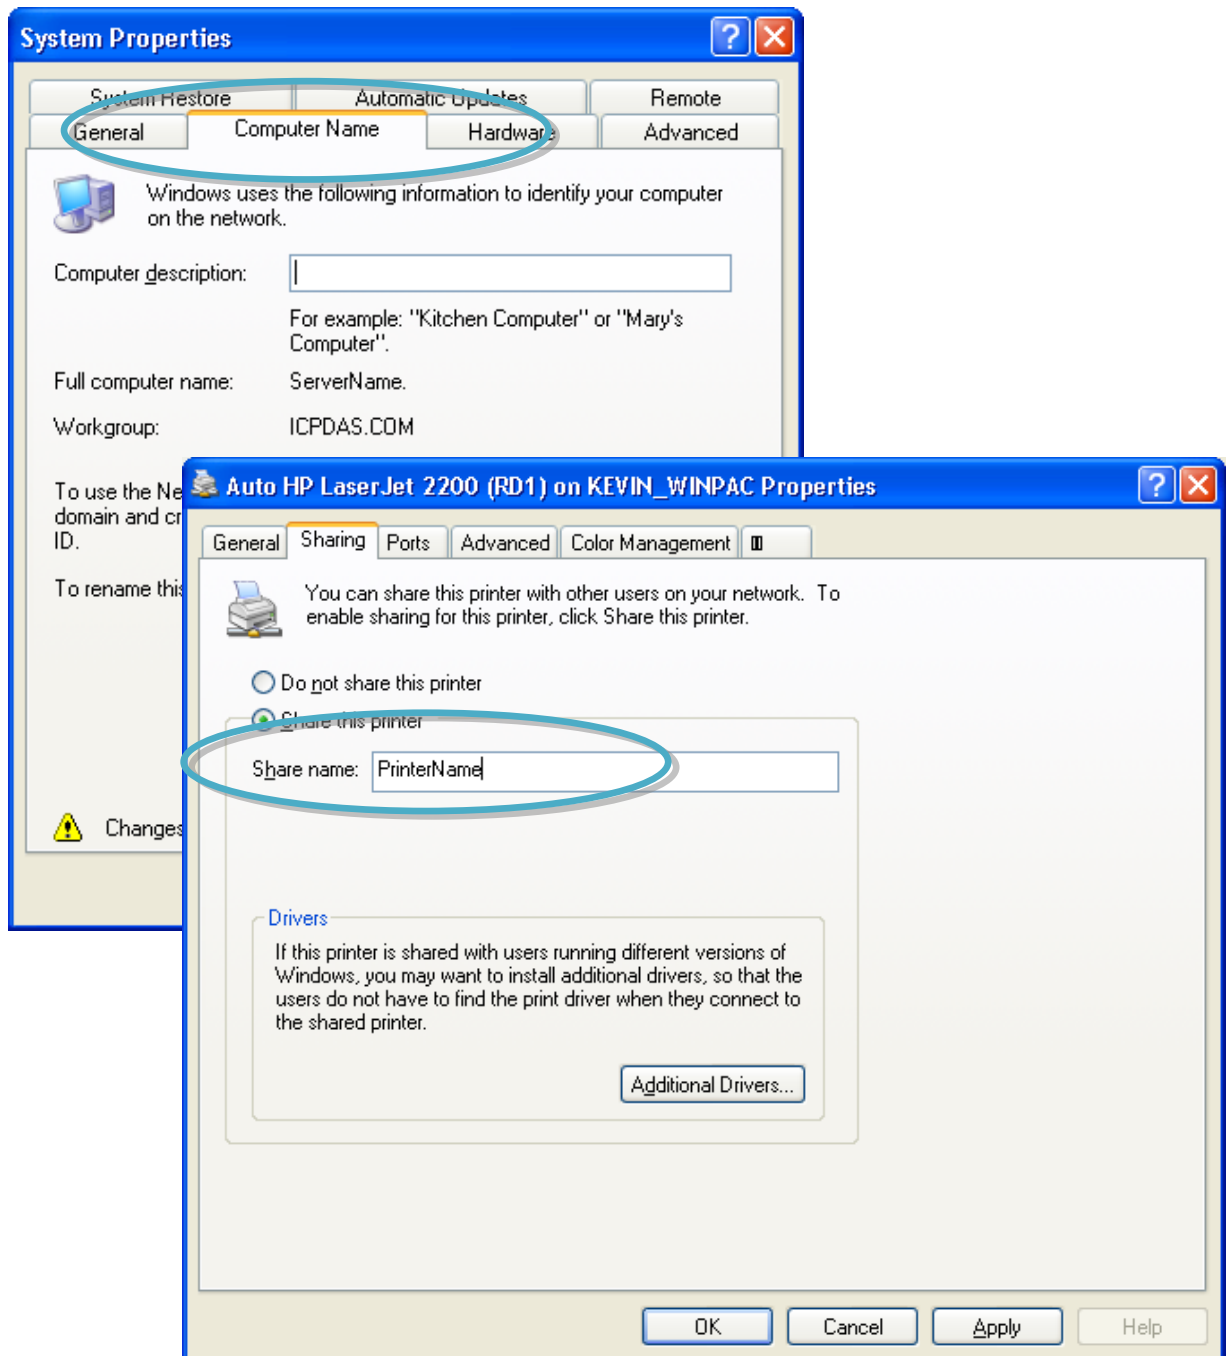

**Step 2: On the ViewPAC, open a WordPad format file**

**Step 3: On the ViewPAC, open a WordPad format file**

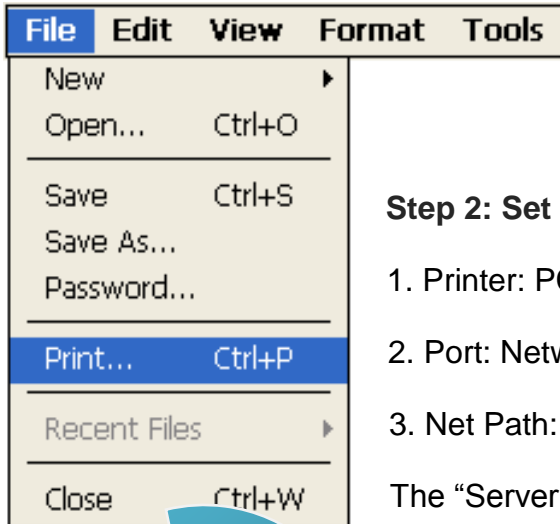

**Step 2: Set up the printer**

1. Printer: PCL Laser
2. Port: Network
3. Net Path: [\\ServerName\PrinterName](#)


The "ServerName" is your PC's name or IP.

The "PrinterName" is your printer's shared name of your PC

4. Paper Size: Select the paper size



**Test !!!**

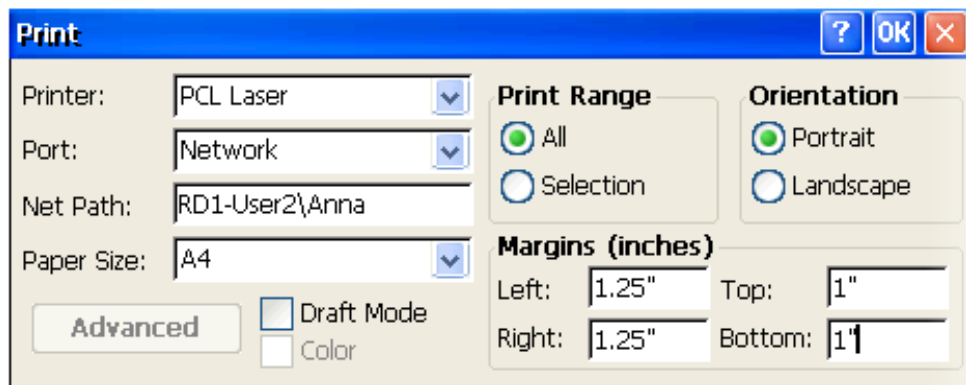




## C.6.2. How to use printer via USB

To use a shared network printer via USB, please perform the following steps:

**Step 1: On the ViewPAC, open a WordPad format file**

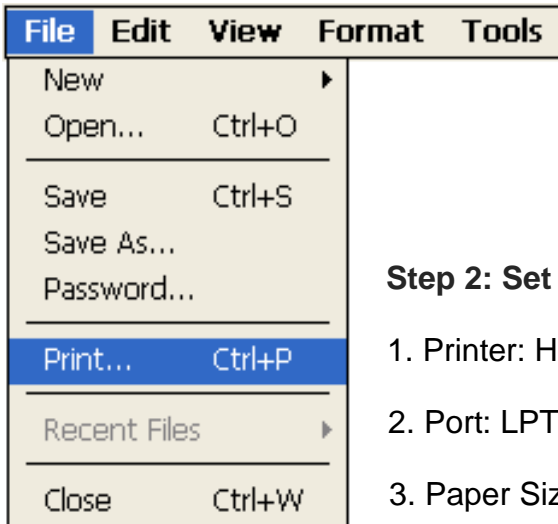


**Step 2: Set up the printer**

1. Printer: Hewlett-Packard LaserJet
2. Port: LPT1
3. Paper Size: Select the paper size




**Test !!!**

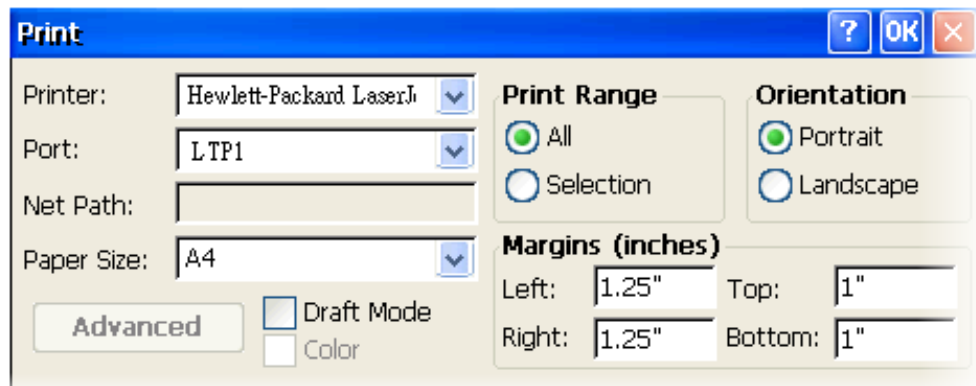

## C.7. How to use services tool

The services tool can help you turn on, turn off and monitor the WinCE services.

### Step 1: Open a MS-DOS command prompt

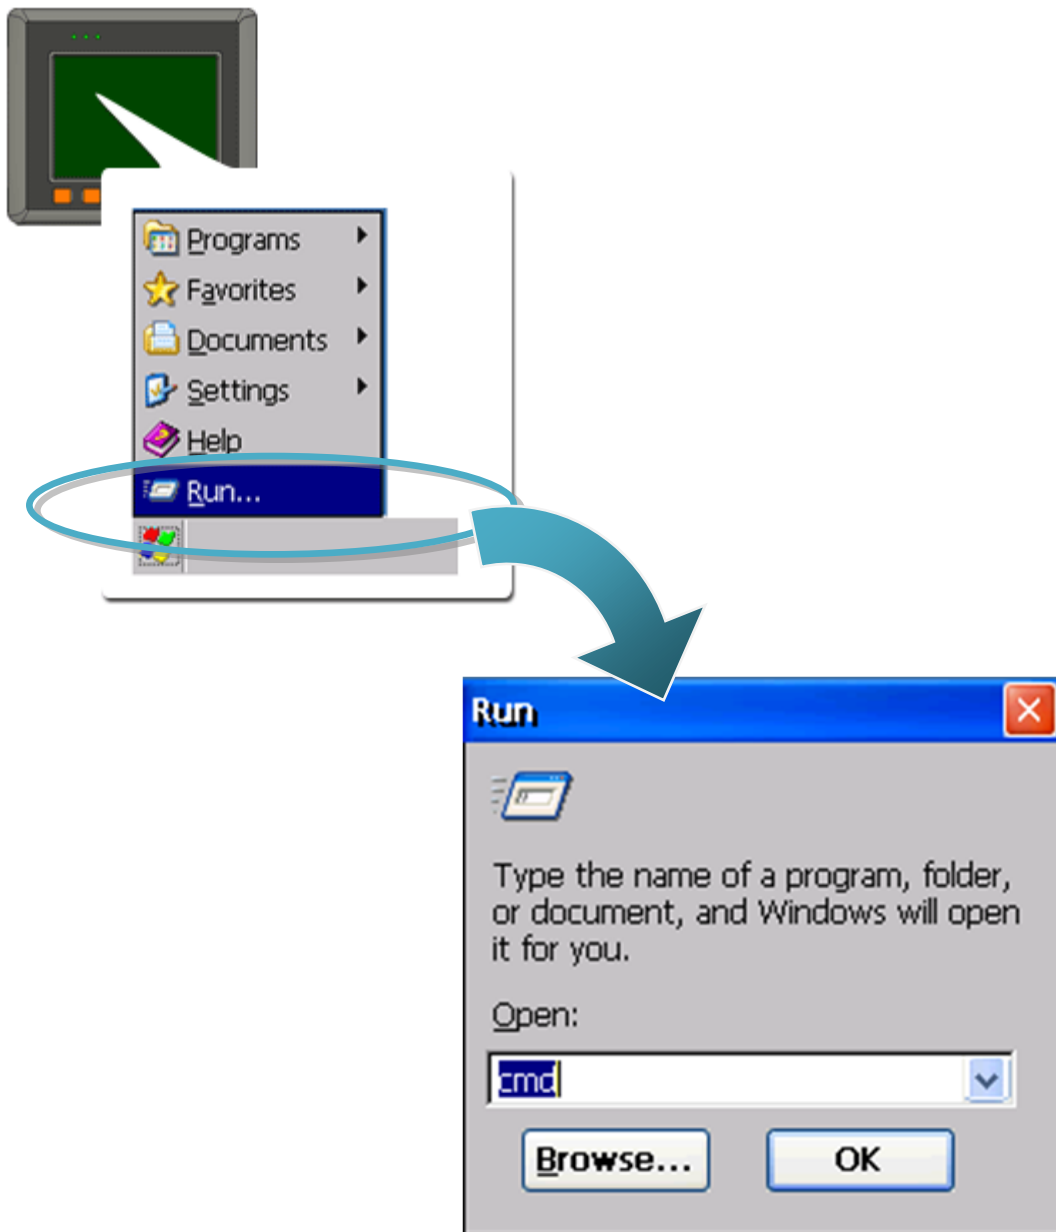

## Step 2: List all services

[Syntax] services list

```
File Edit Help
Pocket CMD v 5.0
\> services list
NFYO: 0x00030110    NOTIFY.Dll    Running
HTPO: 0x00031570    HTTPD.DLL    Running
CRDO: 0x00032070    credsvc.dll   Running
MMQ1: 0x00036790    MSMQD.Dll    Off
OBX0: 0x00036b20    OBEXSrVr.dll Off
FTPO: 0x00037770    FTPD.Dll     Running
TELO: 0x00037ac0    TELNETD.Dll  Running
SMB0: 0x0003c3e0    smbserver.dll Running
NTPO: 0x0003fff0    timesvc.dll  Running
\>
```

## Step 3: Type the commands to configure service

[Syntax] services stop <services name>

For example, turn on the “FTP” service:

services stop FTPO:

```
File Edit Help
Pocket CMD v 5.0
\> services stop FTPO:
\> services list
NFYO: 0x00030110    NOTIFY.Dll    Running
HTPO: 0x00031570    HTTPD.DLL    Running
CRDO: 0x00032070    credsvc.dll   Running
MMQ1: 0x00036790    MSMQD.Dll    Off
OBX0: 0x00036b20    OBEXSrVr.dll Off
FTPO: 0x00037770    FTPD.Dll     Off
TELO: 0x00037ac0    TELNETD.Dll  Running
SMB0: 0x0003c3e0    smbserver.dll Running
NTPO: 0x0003fff0    timesvc.dll  Running
\>
```

## Tips & Warnings

---



For more information about using services tool, you just type “services help”

```
File Edit Help
Pocket CMD v 5.0
\> services help
Commands:
    help - print this text
    list - lists loaded services
    load <service name> - activates a service that is inactive
    stop <service instance> stops/pauses a service (does not unload)
    start <service instance> - starts/resumes a service
    refresh <service instance> - causes service to refresh its config
    unload <service instance> - causes service to be unloaded and
    register <service name> - service will be automatically loaded
reboot
    unregister <service name> - service will not be automatically
next reboot
    command <service name> [arg1 arg2 ...] - send service-specific
o service
    help <service name> - get information on what service-specific
are supported

    <service name> - service's name in the registry (i.e. HTTPD)
    <service instance> - particular instantiation (i.e. HTTP0:)

Flags:
    -f <file name>
    -s silent
    -d output to debugger

\> █
```

# Appendix D. Revision History

---

Revision	Date	Description
1.0.1	August 2009	Initial issue
1.0.2	September 2009	Added information about the support of the printer driver in section C.4
1.0.3	December 2009	<ol style="list-style-type: none"><li>1. Modified the operating modes in section 2.5</li><li>2. Added the requirements of the ViewPAC SDK in section 4.3.</li></ol>
1.0.4	February 2010	<ol style="list-style-type: none"><li>1. Modified the specification of the Dual Battery Backup SRAM features in section 1.1.</li><li>2. Modified information about Operating Environment in section 1.2.</li></ol>
1.0.5	January 2011	<ol style="list-style-type: none"><li>1. Added information on how to use Backup Utility to back up the settings and files in section 2.9.</li><li>2. Added information about a caution of using System_Disk in section 2.10.</li><li>3. Added information about the ViewPAC Utility functionality in section in section 3.5.2.</li><li>4. Deleted information on how to establish a new telnet and FTP account in section C.1.</li><li>5. Added information on how to add a user account to remote login the ViewPAC from PC in section C.1.</li></ol>
1.0.6	July 2011	<ol style="list-style-type: none"><li>1. Added information on the Overview in section 1.4.</li><li>2. Modified information about the application of RS-485 network in appendix E.</li></ol>
1.0.7	February 2012	<ol style="list-style-type: none"><li>1. Modified the features of the ViewPAC in section .1.1.</li><li>2. Modified the specification of the ViewPAC in section 1.2.</li></ol>
1.0.8	July 2012	<ol style="list-style-type: none"><li>1. Added information about COM2 in section 1.3.</li><li>2. Added information about how to use the printer in appendix C.4.</li></ol>
1.0.9	October 2012	Modified information about ViewPAC Platform SDKs in chapter 4.

1.0.10	November 2012	Added information about VP-4131 in section 1.2, 1.3, 1.4 and 2.1 Added the ViewPAC Utility function in in section 3.5.2
1.0.11	September 2013	1. Update ViewPAC utility information in section 3.5. 2. Added limitations for using Visual Studio in section 4.1. 3. Added battery change in section 9
1.0.12	January 2014	1. Added information about battery.
1.0.13	July 2017	1. Added information about the SDK selection in chapter 6. 2. Changed the Waterproof installation process in section 2.1.1.4